

FACILITIES SHOP

SPANISH FORK CITY

433 SOUTH MAIN STREET

SPANISH FORK, 84660



DRAWING INDEX

GENERAL	G1.1 COVER SHEET
	G1.2 CODE ANALYSIS
	G1.3 ACCESSIBILITY REQUIREMENTS
CIVIL	C-001 CIVIL TITLE SHEET
	C-002 LEGENDS & NOTES
	V-101 SURVEY CONTROL
	C-101 SITE PLAN
	C-201 GRADING AND DRAINAGE
	C-202 PEDESTRIAN PATH GRADING
	C-301 UTILITY PLAN
	C-501 DETAILS
	C-502 DETAILS
	C-503 DETAILS
	C-504 DETAILS
	6F01 6F01 SITE ELECTRICAL DRAWINGS
ARCHITECTURAL	A2.1 MAIN LEVEL FLOOR PLAN
	A2.2 MEZZANINE FLOOR PLAN
	A3.1 CONSTRUCTION TYPES
	A3.2 ROOM FINISH SCHEDULE, LARGE SCALE FLOOR PLANS & INT. ELEVATIONS
	A3.3 DOOR & WINDOW SCHEDULES & DETAILS
	A4.1 EXTERIOR ELEVATIONS
	A5.1 BUILDING SECTIONS
	A5.2 BUILDING SECTIONS
	A7.1 ROOF PLAN
	A8.1 MAIN FLOOR - REFLECTED CEILING PLAN
	A9.1 LARGE SCALE STAIR PLANS AND SECTIONS
STRUCTURAL	S-001 GENERAL NOTES
	S-002 SCHEDULES CONCRETE
	S-003 SCHEDULES WOOD
	S-101 FOOTING AND FOUNDATION PLAN
	S-201 MEZZANINE FRAMING PLAN
	S-301 FOUNDATION DETAILS
	S-311 FRAMING DETAILS
MECHANICAL	M0.1 MECHANICAL NOTES AND LEGENDS
	M1.1 MECHANICAL FLOOR PLAN
	M1.2 MECHANICAL MEZZANINE PLAN
	M5.1 MECHANICAL DETAILS
	M5.2 MECHANICAL DETAILS
	M6.1 MECHANICAL SCHEDULES
PLUMBING	P0.1 PLUMBING NOTES AND LEGENDS
	P1.1 PLUMBING FLOOR PLAN
	P1.2 PLUMBING MEZZANINE PLAN
	P5.1 PLUMBING DETAILS
	P5.2 MECHANICAL DETAILS
	P6.1 PLUMBING SCHEDULES AND SCHEMATICS
ELECTRICAL	E0.1 ELECTRICAL NOTES AND LEGENDS
	E1.1 ELECTRICAL FLOOR PLAN
	E1.2 ELECTRICAL MEZZANINE PLAN
	E4.1 ENLARGED FLOOR PLANS
	E5.1 ELECTRICAL DETAILS
	E5.2 ELECTRICAL DETAILS
	E5.3 ELECTRICAL DETAILS
	E6.1 ELECTRICAL SCHEDULES
	E7.1 ELECTRICAL SPECIFICATIONS

CIVIL ENGINEER

JONES AND DeMILLE
775 WEST SPRING CREEK PLACE, #200A
SPRINGVILLE, UTAH 84663
MATT LAURENDEAU, PE
801.692.0219
matt@jonesanddemille.com

ARCHITECT

WPA ARCHITECTURE
475 NORTH FREEDOM BLVD.
PROVO, UTAH 84601
BRUCE T. FALLON, AIA, LEED AP
801.374.0800
bfallon@wpa-architecture.com

OWNER

SPANISH FORK CITY
40 SOUTH MAIN STREET
SPANISH FORK, UTAH 84660
JOSH ROBINSON
801.804.4576
jrobinson@spanishfork.org

STRUCTURAL ENGINEER

TBSE
233 NORTH 1250 WEST, #201
CENTERTVILLE, UTAH 84014
LUKE BALLING, S.E.
801.738.8795
lballing@tbse.us

MECHANICAL ENGINEER

ROYAL ENGINEERING
1837 SOUTH EAST BAY BLVD.
PROVO, UTAH 84606
CHRIS FALSLEV
801.375.7228
chris.falslev@royaleng.com


ELECTRICAL ENGINEER

ROYAL ENGINEERING
1837 SOUTH EAST BAY BLVD.
PROVO, UTAH 84606
DAVID SUEARINGEN
david.suearingen@royaleng.com
THAIGHT4PV@UT.COM

PROJECT LOCATION



VICINITY MAP



GENERAL NOTES

- A. ALL EXIT ACCESS DOORS AND EXITS SHALL BE OPENABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR ANY SPECIAL KNOWLEDGE OR EFFORT. USE OF MANUAL FLUSH BOLTS, EDGE BOLTS, TOP OR BOTTOM BOLTS, ETC. IS PROHIBITED.
- B. GLAZING IN DOORS OR IN FIXED OR OPERABLE PANELS ADJACENT TO A DOOR WHERE THE NEAREST EXPOSED EDGE IS WITHIN A 24 INCH ARC OF THE DOOR AND WHERE THE BOTTOM EXPOSED EDGE IS LESS THAN 60 INCHES ABOVE THE WALKING SURFACE MUST BE TEMPERED.
- C. TANK TYPE WATER CLOSETS SHALL HAVE A MAXIMUM WATER USE OF 1.6 GALLONS PER FLUSH. SHOWERS SHALL HAVE A MAXIMUM FLOW OF 2.5 GALLONS PER MINUTE.
- D. BURNING OF CONSTRUCTION WASTE MATERIALS IS PROHIBITED AT ALL TIMES.
- E. PROVIDE ONE RECESSED 2-A FIRE EXTINGUISHER FOR EVERY 3,000 SQ. FT. OF FLOOR AREA WITH A MAXIMUM TRAVEL DISTANCE OF 75 FEET TO AN EXTINGUISHER.
- F. STORAGE OF EQUIPMENT, SOILS, CONSTRUCTION MATERIALS ON PUBLIC RIGHT-OF-WAY (STREETS/SIDEWALKS) OR EASEMENT IS EXPRESSLY PROHIBITED.
- G. GENERAL CONTRACTOR TO PROCURE ALL REQUIRED PERMITS FROM AUTHORITY HAVING JURISDICTION, INCLUDING BUT NOT LIMITED TO BUILDING, ENGINEERING, RIGHT OF WAY, AND OTHER PERMITS REQUIRED FOR SUB-CONTRACTOR WORK.
- H. GENERAL CONTRACTOR TO PROVIDE REQUIRED FIRE EXTINGUISHERS TO BE PRESENT DURING CONSTRUCTION.
- I. DIMENSIONS ARE SHOWN TO FACE OF STUD, UNLESS NOTED OTHERWISE.
- J. ALL APPLICABLE ELEMENTS OF THE AMERICANS WITH DISABILITIES ACT ACCESSIBILITY GUIDELINES WILL BE ADHERED TO.
- K. SEE ELECTRICAL DRAWINGS FOR RELATED SITE UTILITIES.
- L. COMPLY WITH SPANISH FORK CITY STANDARDS, SPECIFICATIONS, AND DRAWINGS.
- M. COMPLY WITH REQUIREMENTS OF PROJECT GEO-TECHNICAL REPORT.
- N. FINISH GRADE AND FINISH SIDEWALKS TO SLOPE AWAY FROM BUILDING WITH POSITIVE DRAINAGE.

PROJECT DATA

SITE ADDRESS: 433 SOUTH MAIN STREET
SPANISH FORK, UT 84660
PARCEL NUMBER: Z1619-0029
ZONING: P-F
GENERAL PLAN: AGRICULTURAL
EXISTING USE: VACANT
PROPOSED USE: OFFICE/MAINTENANCE BUILDING
LAND AREA: 2.49 ACRES

BID/PERMIT SET - 05.19.2023

G1.1

COVER SHEET

FACILITIES SHOP

SPANISH FORK CITY

SPANISH FORK, UTAH 84660

433 SOUTH MAIN STREET



WPA Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

Alan R. Poulsen
Bruce T. Fallon



Date: 05.22.2023
Revision:

These plans, drawings, and designs are the exclusive property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

CODE ANALYSIS

APPLICABLE CODES

2018 INTERNATIONAL BUILDING CODE (IBC)	2018 INTERNATIONAL FIRE CODE
2018 INTERNATIONAL PLUMBING CODE	2020 NATIONAL ELECTRICAL CODE (NEC)
2018 INTERNATIONAL MECHANICAL CODE	AMERICAN'S WITH DISABILITIES ACT
2018 INTERNATIONAL ENERGY CONSERVATION CODE	ICC/ANSI A117.1 - 2009

OCCUPANCIES AND TYPE OF CONSTRUCTION (IBC CHAPTERS 3 & 6)
 MAIN OCCUPANCY: S-2
 CONSTRUCTION TYPE: VB

AREA OF BUILDING (IBC CHAPTER 5)
 ACTUAL AREA BREAKDOWN BY AREA (PER DEFINITION 'AREA, BUILDING' IBC CH. 2)

LOCATION:	TOTAL AREA:
MAIN FLOOR	6,763 SQ. FT.
MEZZANINE	100 SQ. FT.
TOTAL BUILDING AREA:	11,869 SQ. FT.

ACTUAL AREA BREAKDOWN BY OCCUPANCY (PER DEFINITION 'AREA, BUILDING' IBC CH. 2)

LOCATION:	B	F-1	S-2	TOTAL AREA:
MAIN FLOOR	1,139 SQ. FT.	805 SQ. FT.	4,819 SQ. FT.	6,763 SQ. FT.
MEZZANINE	0 SQ. FT.	0 SQ. FT.	100 SQ. FT.	100 SQ. FT.
TOTAL BUILDING AREA:	1,139 SQ. FT.	805 SQ. FT.	5,819 SQ. FT.	7,463 SQ. FT.

ALLOWABLE BUILDING AREA (IBC SECTION 506)
 B OCCUPANCY (N6): 9,000 SQ. FT. (ALLOWABLE AREA PER FLOOR)
 F-1 OCCUPANCY (N6): 8,500 SQ. FT. (ALLOWABLE AREA PER FLOOR)
 S-2 OCCUPANCY (N6): 13,500 SQ. FT. (ALLOWABLE AREA PER FLOOR)

AREA CALCULATIONS
AREA MODIFICATIONS BY OCCUPANCY
 NO INCREASE REQUIRED AS SIZE OF BUILDING WITHIN ALLOWABLE BUILDING AREA FOR OCCUPANCY AND A BUILDING OF ONE STORY ABOVE GRADE PLANE.

HEIGHT OF BUILDING (TABLES 504.3 AND 504.4, SECTION 504)

	TOTAL ALLOWABLE HEIGHT	ACTUAL HEIGHT
HEIGHT IN STORIES	2 STORIES	1 STORY
HEIGHT IN FEET	40' - 0"	21' - 0"

NOTE: THE BUILDING WILL NOT BE FIRE SPRINKLED PER SECTION 903.3.1.1 (NFPA-13).

FIRE-RESISTANCE OF EXTERIOR WALLS AND OPENINGS (SECTIONS 601 AND 704.8)
FIRE RESISTANCE RATING FOR EXTERIOR WALLS

EXTERIOR BEARING WALL	(TABLE 601)	
NORTH, EAST, SOUTH & WEST EXTERIOR WALLS		NOT REQUIRED
EXTERIOR NON-BEARING WALL	(TABLES 601 AND 602)	NOT REQUIRED

NOTE: FIRE SEPARATION DISTANCE IS GREATER THAN 10 FEET ON ALL SIDES

PROTECTION OF EXTERIOR WALL OPENINGS
 NO PROTECTION IS REQUIRED OF EXTERIOR WALL OPENINGS AS ALL FIRE SEPARATION DISTANCES, EXCEPT FOR THE NORTH ELEVATION ARE GREATER THAN 20 FEET AS SHOWN ON IBC TABLE 705.8.

NORTH ELEVATION REQUIRED 15 PERCENT FOR EXTERIOR WALLS 10 FEET TO LESS THAN 15 FEET.
 TOTAL WALL AREA: 1,131 SQ. FT.
 TOTAL WALL OPENINGS: 128 SQ. FT. (1.4 PERCENT) - NO PROTECTION REQUIRED

OCCUPANCY SEPARATIONS (TABLE 508.4)
 NONE REQUIRED



FIRE RATED CONSTRUCTION (IBC TABLE 601)

BUILDING ELEMENT	RATING	CODE REFERENCE
HORIZONTAL SEPARATION (R OCCUPANCY ONLY)	NON-RATED	SECTION 403.3
OCCUPANCY SEPARATION (FIRE PARTITIONS)	NOT REQUIRED	SECTION 508
MECHANICAL ROOM SEPARATION	NOT REQUIRED	TABLE 509
PRIMARY STRUCTURAL FRAME PROTECTION	NON-RATED	TABLE 601
BEARING WALLS - EXTERIOR	NON-RATED	TABLE 601
BEARING WALLS - INTERIOR	NON-RATED	TABLE 601
FLOOR CONSTRUCTION	NON-RATED	TABLE 601
ROOF CONSTRUCTION	NON-RATED	TABLE 601
NON-BEARING WALLS - EXTERIOR	NON-RATED	TABLE 602
NON-BEARING WALLS - INTERIOR	NON-RATED	TABLE 602
PROTECTION OF EXTERIOR OPENINGS	NOT REQUIRED	SECTION / TABLE 705.8
FIRE WALLS	NOT REQUIRED	TABLE 706.4
FIRE BARRIERS	NOT REQUIRED	SECTION 107
FIRE PARTITIONS	NOT REQUIRED	SECTION 108
HORIZONTAL ASSEMBLIES	NON-RATED	SECTION 111.2
VERTICAL OPENINGS (FIRE BARRIER)	NOT REQUIRED	SECTION 112
SHAFT ENCLOSURES (FIRE BARRIER)	NOT REQUIRED	SECTION 113
AUTOMATIC SPRINKLER SYSTEM	NO	SECTION 903
FIRE RATED CORRIDORS (FIRE PARTITIONS)	NOT REQUIRED	TABLE 1020.1
INTERIOR EXIT STAIRWAYS (FIRE BARRIER)	NOT REQUIRED	SECTION 1023

PLUMBING FIXTURE CALCULATIONS:


OCCUPANT LOAD: 46

WATER CLOSETS:	FACTORY & INDUSTRIAL REQUIRED - 1 PER 100 OCCUPANTS
	REQUIRED: 1
	PROVIDED: 2
LAVATORIES:	FACTORY & INDUSTRIAL REQUIRED - 1 PER 100 OCCUPANTS
	REQUIRED: 1
	PROVIDED: 2
DRINKING FOUNTAIN:	FACTORY & INDUSTRIAL REQUIRED - 1 PER 400 OCCUPANTS
	REQUIRED: 1
	PROVIDED: 2
SERVICE SINK:	FACTORY & INDUSTRIAL REQUIRED - 1
	REQUIRED: 1
	PROVIDED: 1

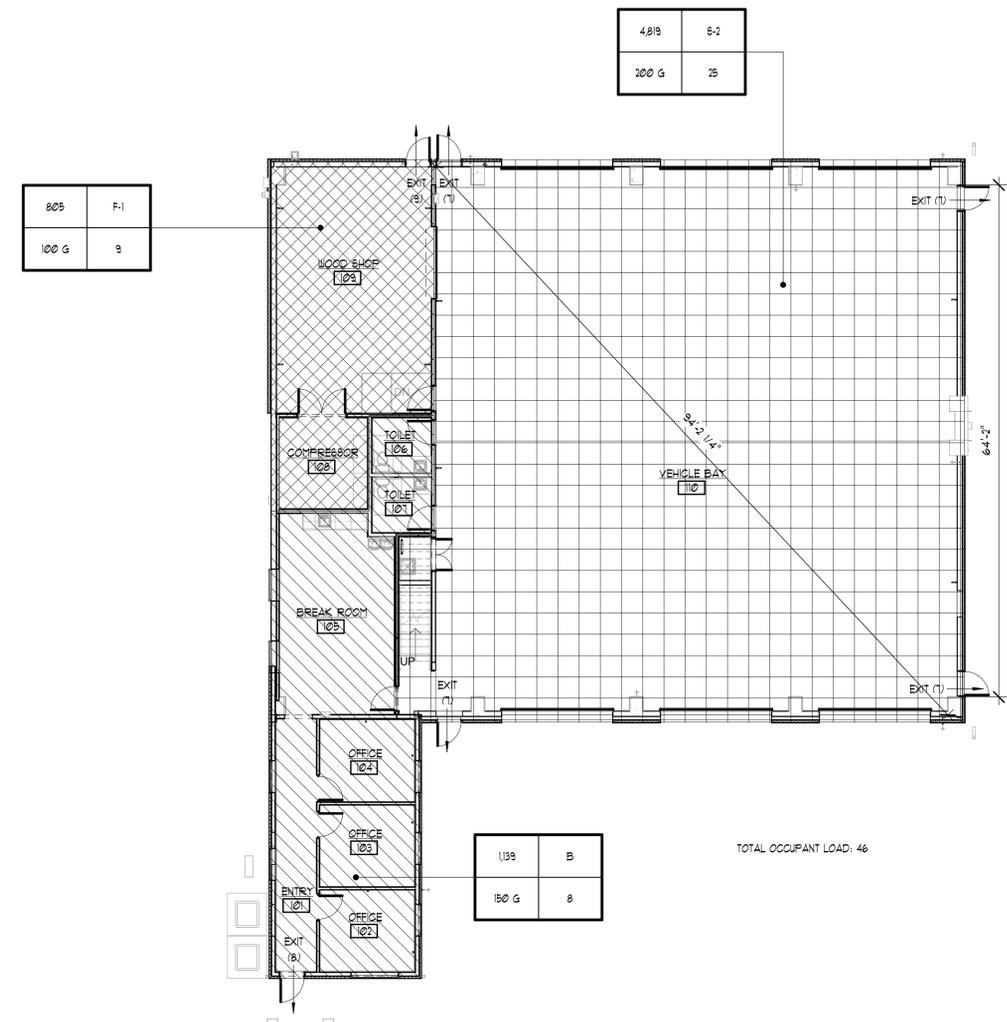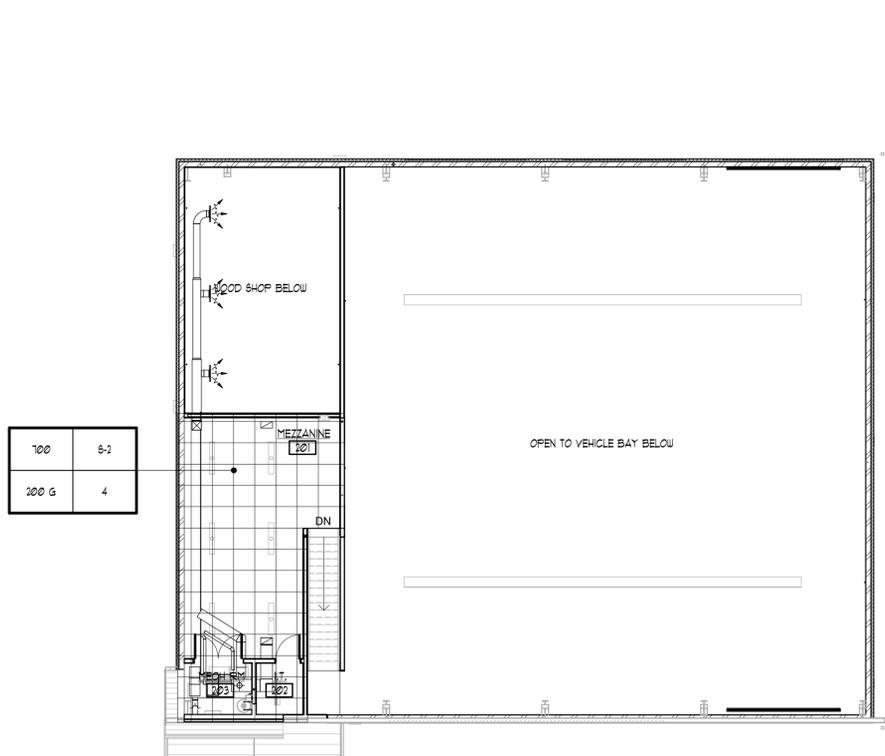

2 MEZZANINE LEVEL - CODE ANALYSIS
 3/32" = 1'-0"

1 MAIN FLOOR - CODE ANALYSIS
 3/32" = 1'-0"

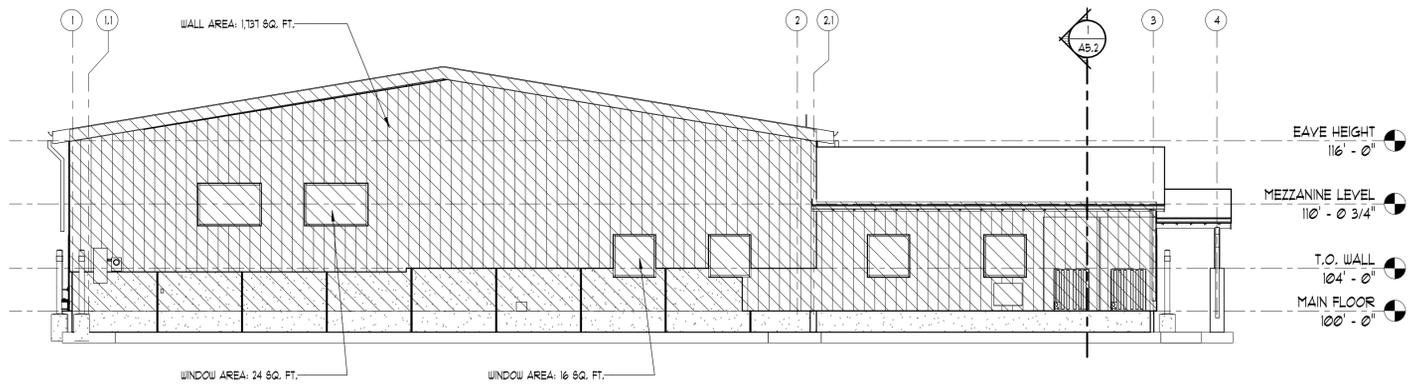

3 NORTH ELEVATION - CODE ANALYSIS
 1/8" = 1'-0"

These plans, drawings and designs are the exclusive property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 05.22.2023
 Revision:

Alan R. Poulsen
 Bruce T. Fallon

WPA Architecture
 475 North Freedom Blvd.
 Provo, Utah 84601
 Tel: (801) 374-0800
 info@wpa-architecture.com

SPANISH FORK, UTAH 84660

FACILITIES SHOP
 SPANISH FORK CITY

433 SOUTH MAIN STREET

G1.2

CODE ANALYSIS

BID/PERMIT SET - 05.19.2023

ACCESSIBILITY CLEARANCE NOTES

(ICC/ANSI A117.1-2009)


- 1] 60" DIAMETER WHEELCHAIR TURNING SPACE (304.3.1)
- 2] 30" X 48" CLEARANCE FOR WATER CLOSET (1004.11.3.1.2.2) + 1004.11.3.1.2.2.2)
- 3] 30" X 48" CLEAR FLOOR SPACE FOR FORWARD APPROACH TO SINK/APPLIANCE SPACE/APPLIANCE (305.3, 606.2, 1003.12.3, 1003.12.4, 1003.12.5.2)
- 4] 30" X 48" CLEAR FLOOR SPACE FOR PARALLEL/ADJACENT APPROACH TO SINK/APPLIANCE (305.3, 1004.10, 1004.11.1, 1004.12.2)
- 5] 30" X 48" CLEAR FLOOR SPACE BEYOND SWING OF DOOR FOR INDIVIDUAL USE (603.2.2 EXCEPTION, 1003.11.2 EXCEPTION)

- 6] 36" X 60" CLEARANCE FOR WATER CLOSET (604.3.1)
 - 7] 66" X 60" CLEARANCE FOR WATER CLOSET (1003.11.2.4.4)
- NOTE: CLEAR FLOOR OR GROUND SPACES, CLEARANCE AT FIXTURES, AND WHEELCHAIR TURNING SPACES SHALL BE PERMITTED TO OVERLAP (603.2.2, 1003.11.2.4.4, 1004.11.3.1.2.2.4)


ADA REFERENCES

(ICC/ANSI A117.1-2009)


- 1. DRINKING FOUNTAIN - 602
- 2. RESTROOM - 603-606
- MIRROR - 603.3
- WATER CLOSET - 604
- GRAB BARS - 604.5
- DISPENSER - 604.1
- LAVATORY - 606

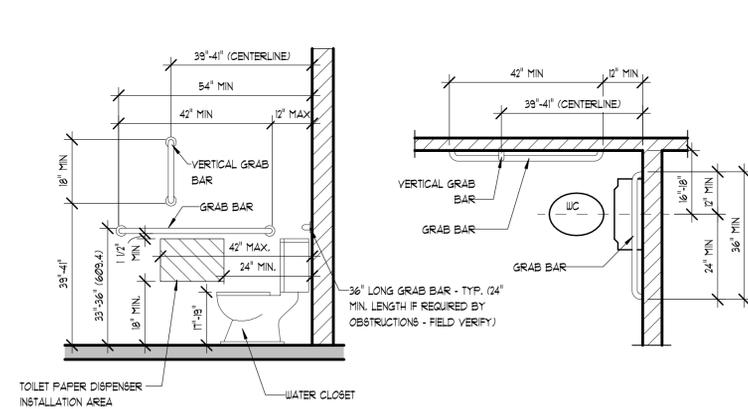


1 ACCESSIBLE TOILET CLEARANCES
1/2" = 1'-0"

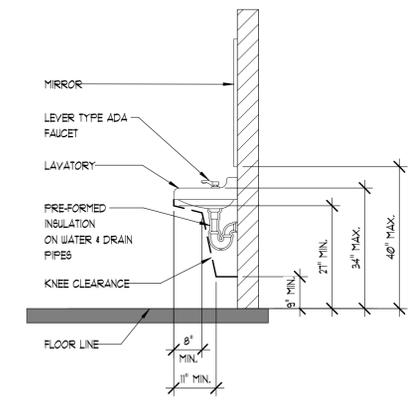


2 ACCESSIBLE VANITY CLEARANCES
1/2" = 1'-0"

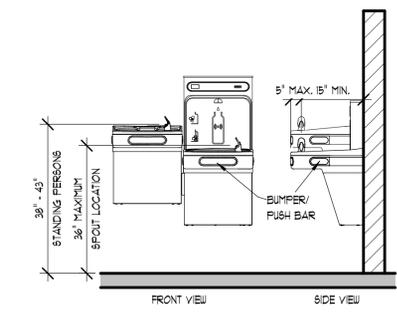


3 ACCESSIBLE DRINKING FOUNTAIN
1/2" = 1'-0"

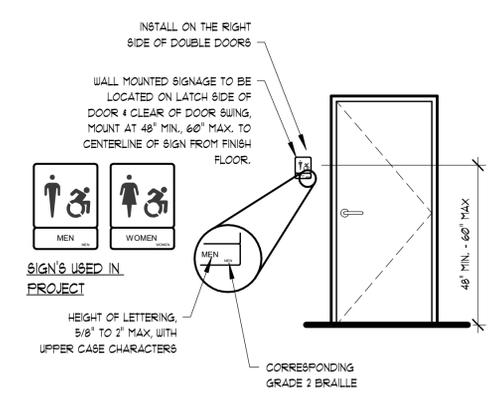


4 SIGN MOUNTING DETAIL
3/8" = 1'-0"

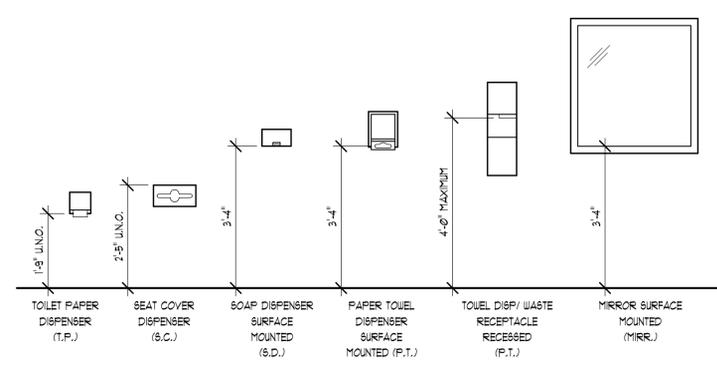


5 ACCESSORY MOUNTING HEIGHTS
1/2" = 1'-0"

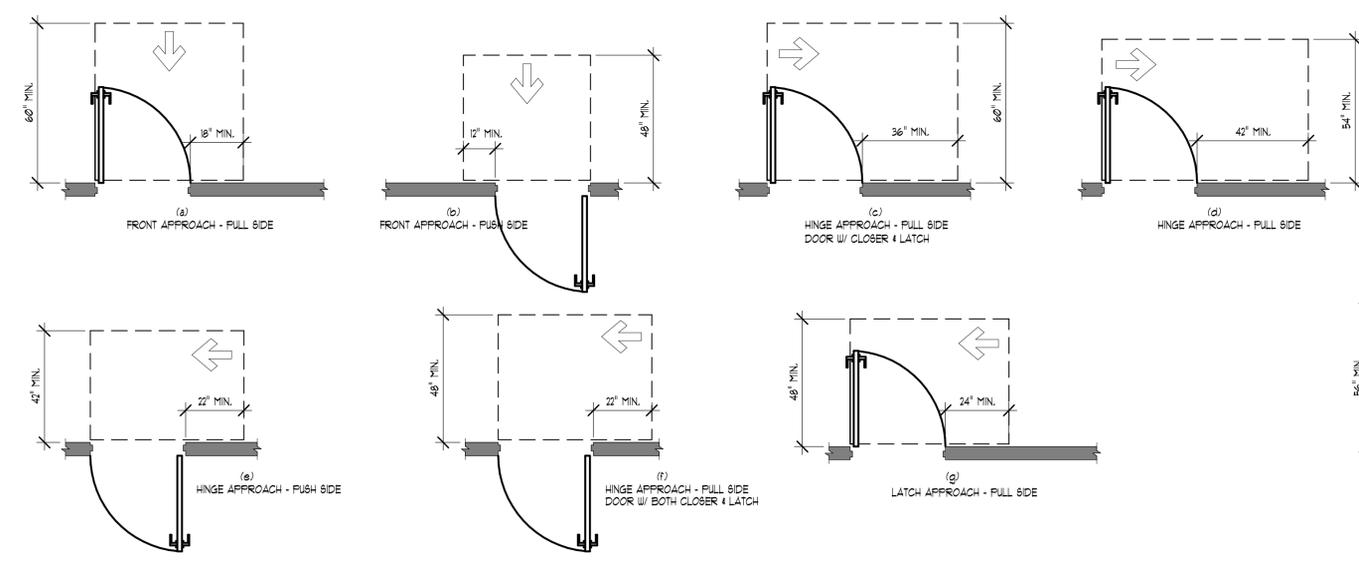

6 ACCESSIBLE DOOR CLEARANCES
3/8" = 1'-0"

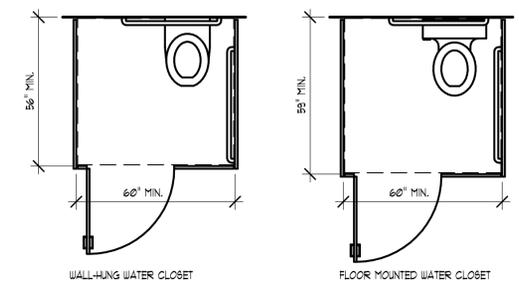

7 ACCESSIBLE TOILET COMPARTMENT
3/8" = 1'-0"

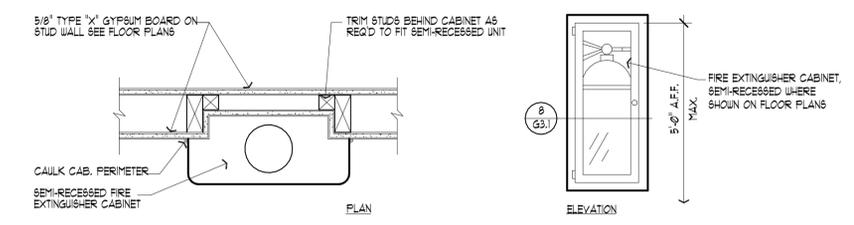

8 FIRE EXTINGUISHER DETAIL
1/2" = 1'-0"

These plans, drawings and design were prepared by WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 05.22.2023
Revision:

Alan R. Poulsen
Bruce T. Fallon

WPA Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

FACILITIES SHOP
SPANISH FORK CITY
SPANISH FORK, UTAH 84660


433 SOUTH MAIN STREET

G1.3
ACCESSIBILITY REQUIREMENTS

BID/PERMIT SET - 05.19.2023

SPANISH FORK CITY FACILITIES SHOP SITE SPANISH FORK, UTAH 2023

PROJECT NO. 2201-005	SHEET NO. C-001
SUBMITTAL: FOR BIDDING ONLY	

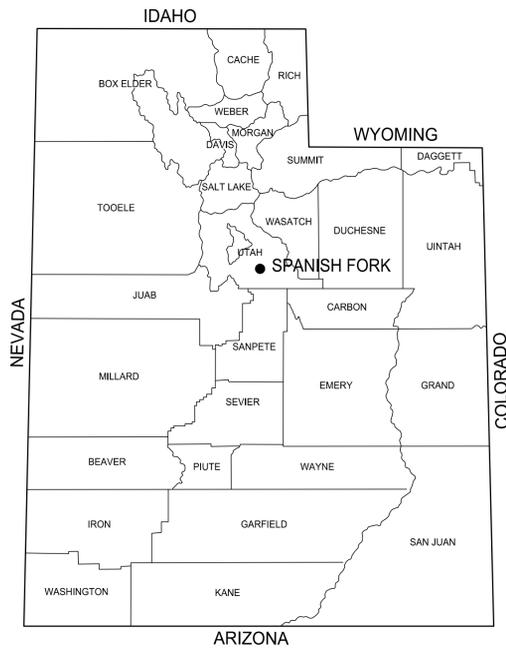

VICINITY MAP


INDEX TO SHEETS	
SHEET NO.	SHEET TITLE
C-001	TITLE
C-002	LEGEND & NOTES
V-101	SURVEY CONTROL
C-101	SITE PLAN
C-201	GRADING AND DRAINAGE
C-202	PEDESTRIAN PATH GRADING
C-301	UTILITY PLAN
C-401	EROSION CONTROL PLAN
C-501 TO C-504	DETAILS
	ELECTRICAL DESIGN

APPROVAL

RECOMMENDED FOR APPROVAL: _____	
	DATE
ENGINEER	DATE
APPROVED: _____	
SPANISH FORK CITY	DATE



Jones & DeMille Engineering, Inc.
 CIVIL & STRUCTURAL ENGINEERING - SURVEYING
 GIS - ENVIRONMENTAL - MATERIALS TESTING
- shaping the quality of life -
 1.800.748.5275 www.jonesanddemille.com

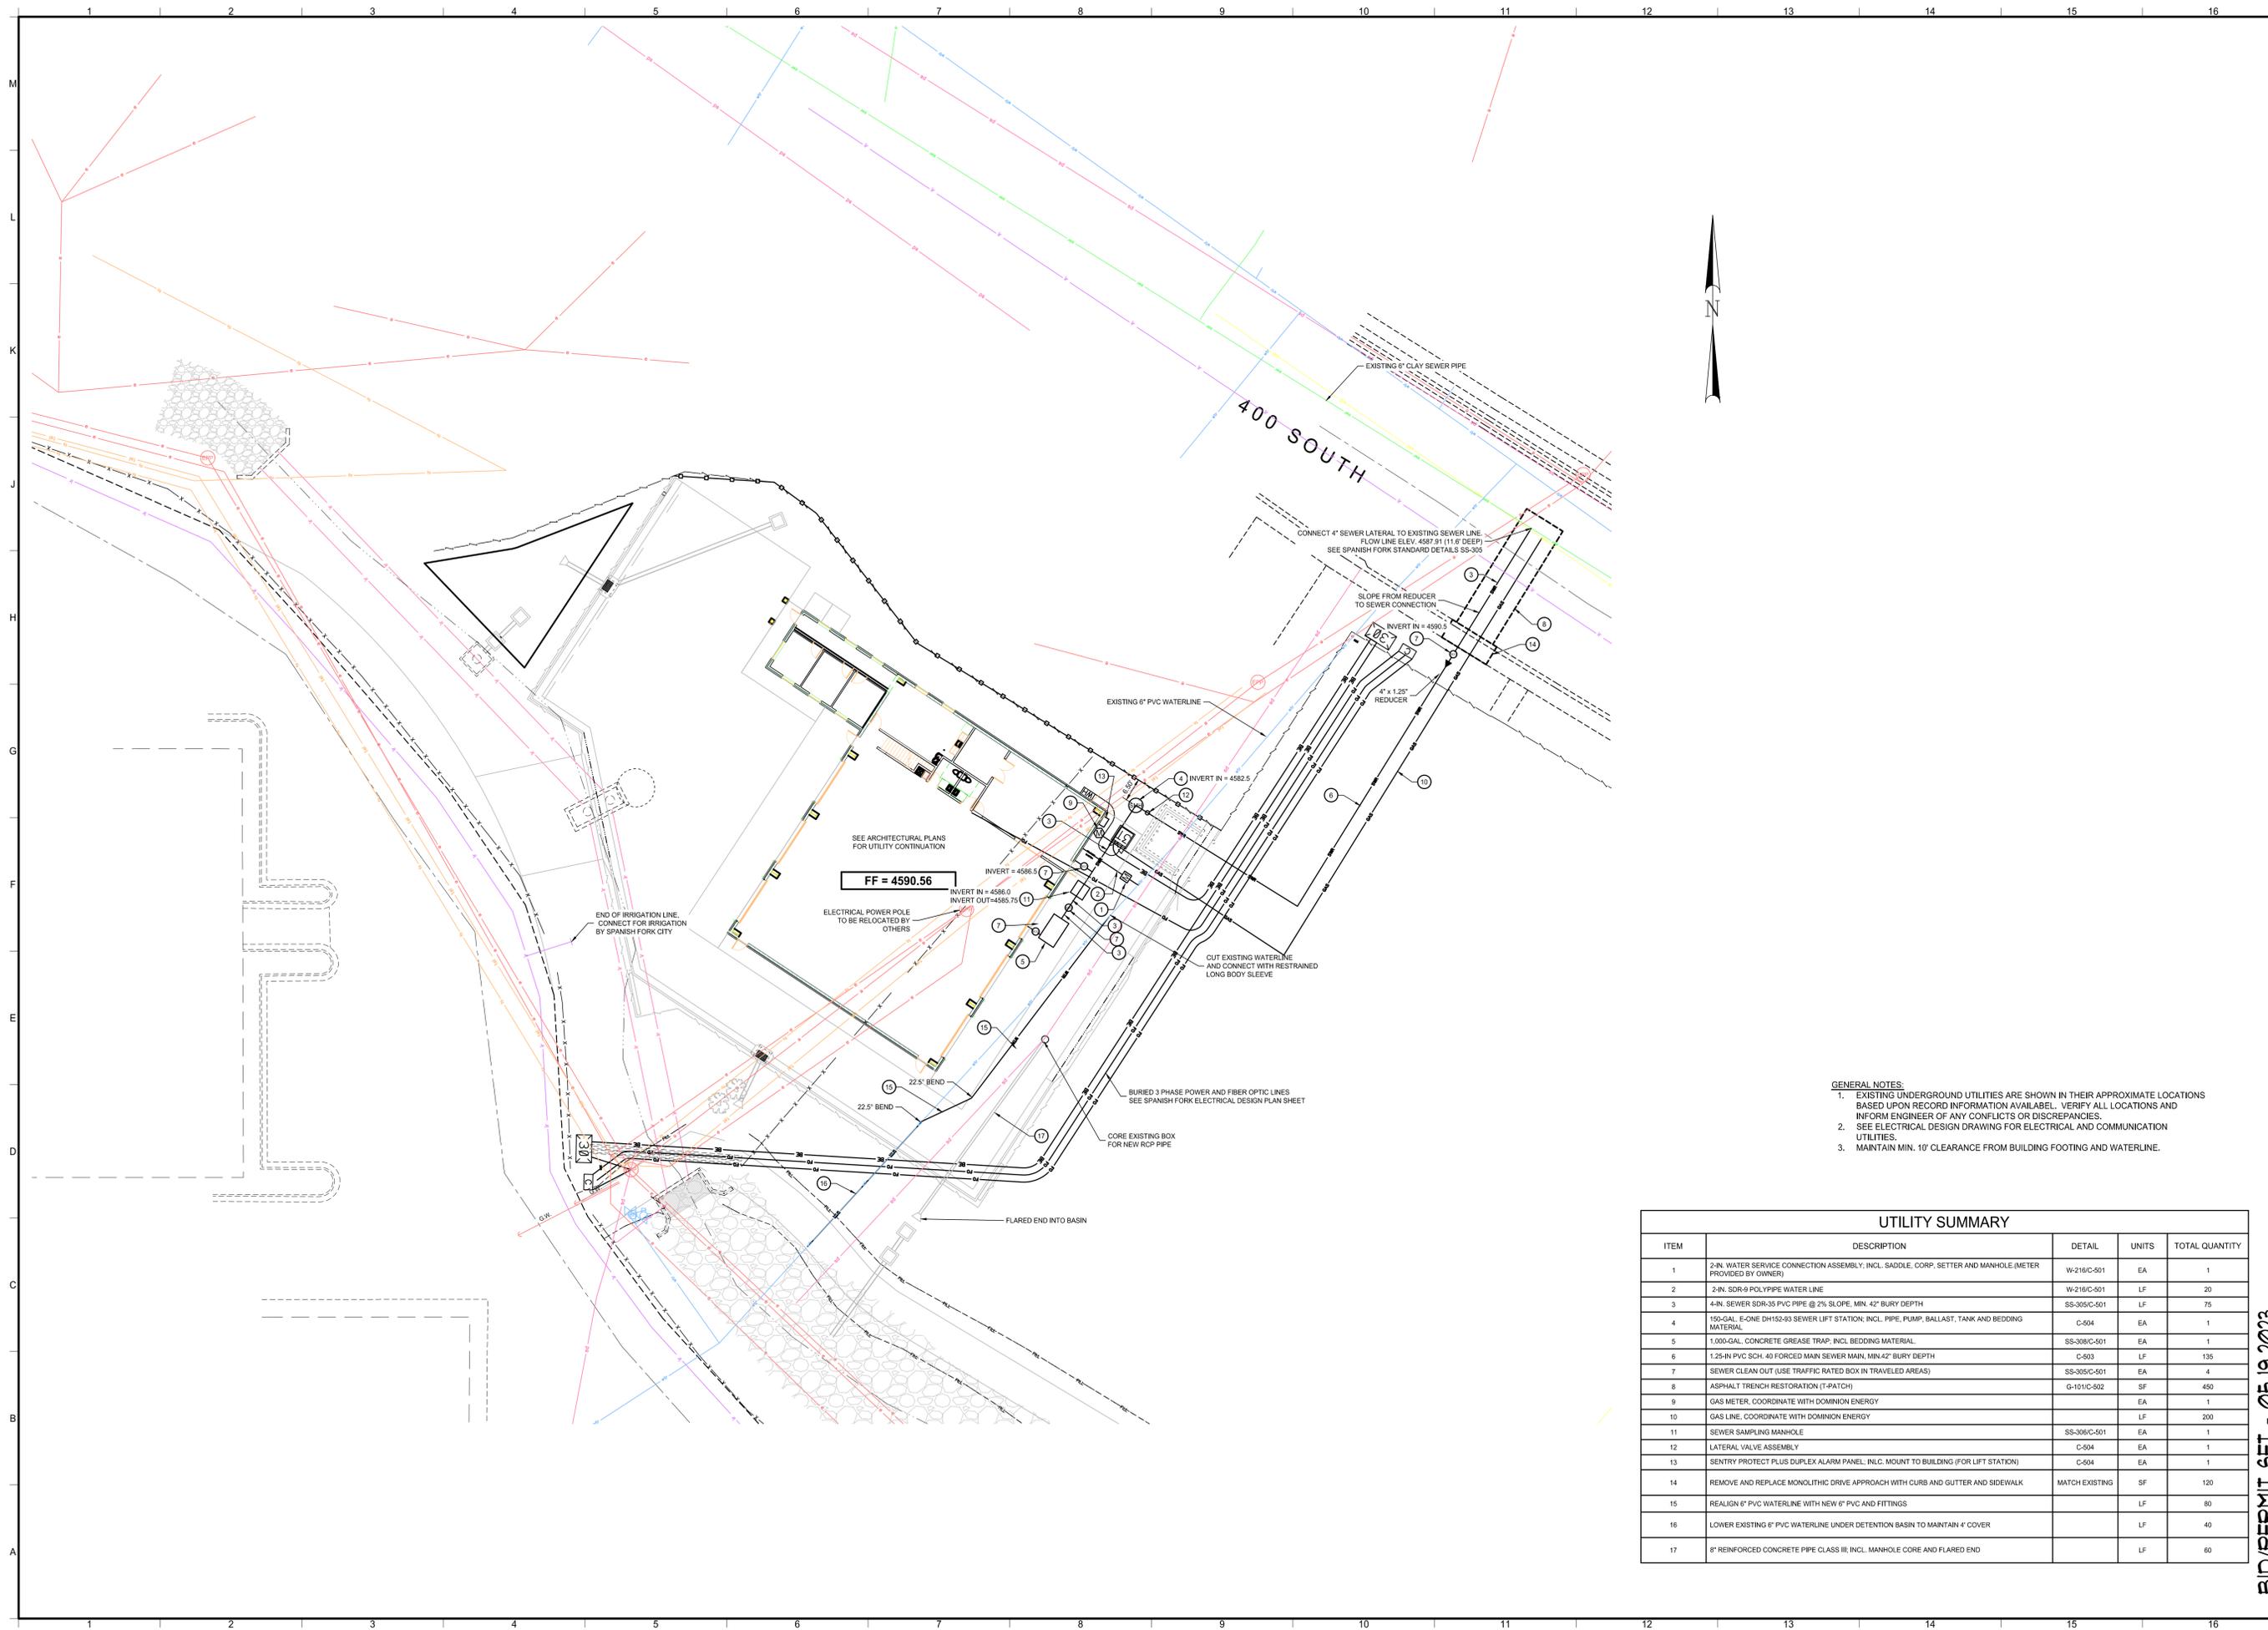

- GENERAL NOTES:**
- EXISTING UNDERGROUND UTILITIES ARE SHOWN IN THEIR APPROXIMATE LOCATIONS BASED UPON RECORD INFORMATION AVAILABLE. VERIFY ALL LOCATIONS AND INFORM ENGINEER OF ANY CONFLICTS OR DISCREPANCIES.
 - SEE ELECTRICAL DESIGN DRAWING FOR ELECTRICAL AND COMMUNICATION UTILITIES.
 - MAINTAIN MIN. 10' CLEARANCE FROM BUILDING FOOTING AND WATERLINE.

UTILITY SUMMARY				
ITEM	DESCRIPTION	DETAIL	UNITS	TOTAL QUANTITY
1	2-IN. WATER SERVICE CONNECTION ASSEMBLY, INCL. SADDLE, CORP. SETTER AND MANHOLE (METER PROVIDED BY OWNER)	W-210/C-501	EA	1
2	2-IN. SDR-9 POLYPIPE WATER LINE	W-210/C-501	LF	20
3	4-IN. SEWER SDR-35 PVC PIPE @ 2% SLOPE, MIN. 42" BURY DEPTH	SS-305/C-501	LF	75
4	150-GAL. E-ONE DH152-93 SEWER LIFT STATION, INCL. PIPE, PUMP, BALLAST, TANK AND BEDDING MATERIAL	C-504	EA	1
5	1,000-GAL. CONCRETE GREASE TRAP, INCL. BEDDING MATERIAL	SS-306/C-501	EA	1
6	1.25-IN PVC SCH. 40 FORCED MAIN SEWER MAIN, MIN. 42" BURY DEPTH	C-603	LF	135
7	SEWER CLEAN OUT (USE TRAFFIC RATED BOX IN TRAVELED AREAS)	SS-305/C-501	EA	4
8	ASPHALT TRENCH RESTORATION (T-PATCH)	G-101/C-502	SF	450
9	GAS METER, COORDINATE WITH DOMINION ENERGY		EA	1
10	GAS LINE, COORDINATE WITH DOMINION ENERGY		LF	200
11	SEWER SAMPLING MANHOLE	SS-306/C-501	EA	1
12	LATERAL VALVE ASSEMBLY	C-604	EA	1
13	SENTRY PROTECT PLUS DUPLEX ALARM PANEL, INCL. MOUNT TO BUILDING (FOR LIFT STATION)	C-604	EA	1
14	REMOVE AND REPLACE MONOLITHIC DRIVE APPROACH WITH CURB AND GUTTER AND SIDEWALK	MATCH EXISTING	SF	120
15	REALIGN 6" PVC WATERLINE WITH NEW 6" PVC AND FITTINGS		LF	80
16	LOWER EXISTING 6" PVC WATERLINE UNDER DETENTION BASIN TO MAINTAIN 4" COVER		LF	40
17	8" REINFORCED CONCRETE PIPE CLASS III, INCL. MANHOLE CORE AND FLARED END		LF	60

BID/PERMIT SET - 05.19.2023

SPANISH FORK CITY

FACILITIES SHOP SITE

UTILITY PLAN

UTAH COUNTY

SHEET NO. **C-301**

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE

APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

APPROVED

QUALITY MANAGEMENT REVIEW

DATE

DATE






APPROVAL RECORD

PROJECT DESIGN NUMBER

DATE

DATE

</

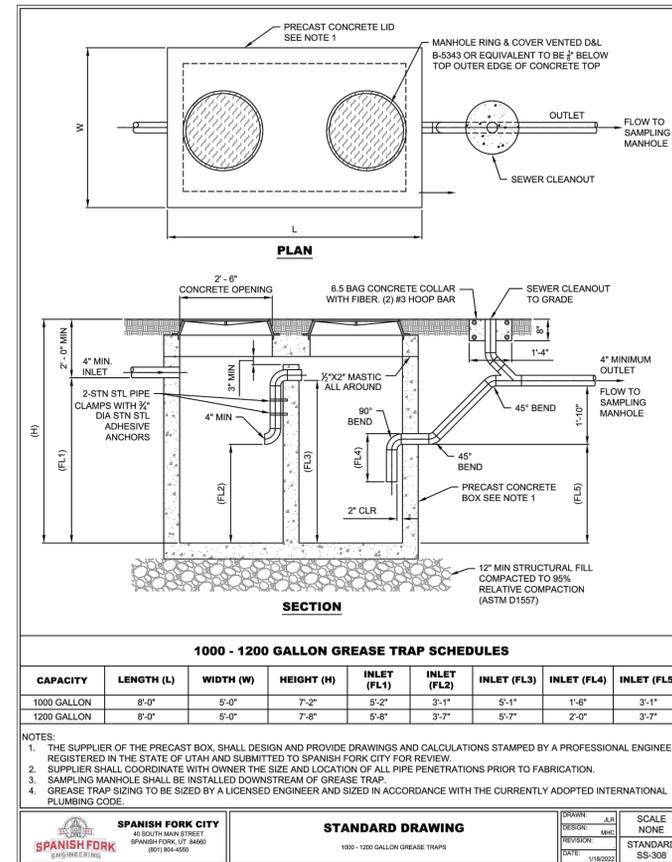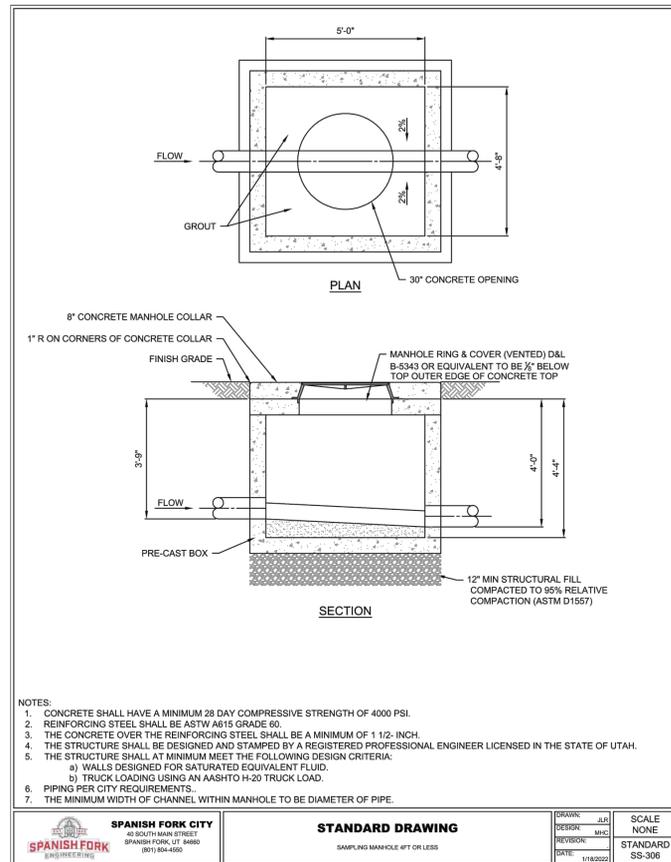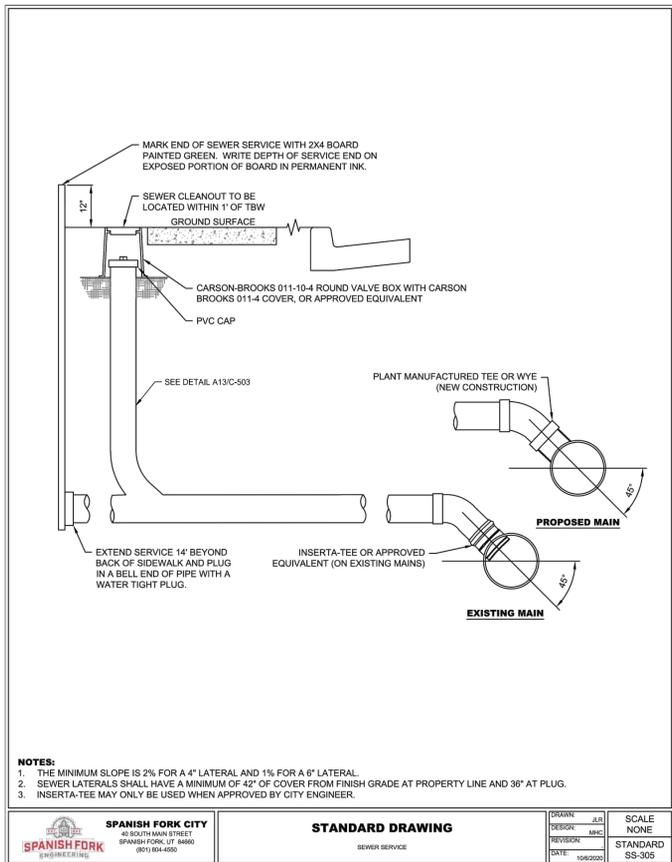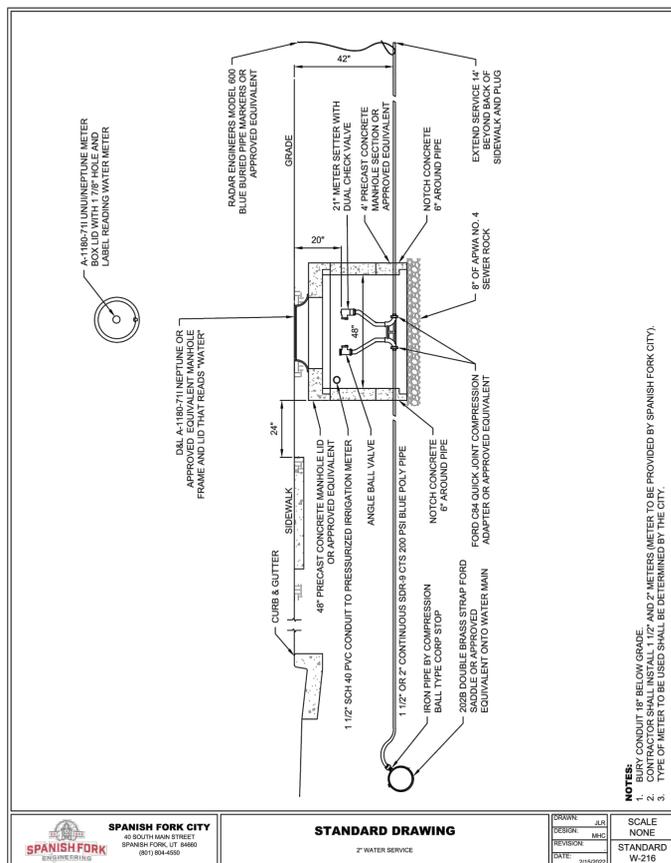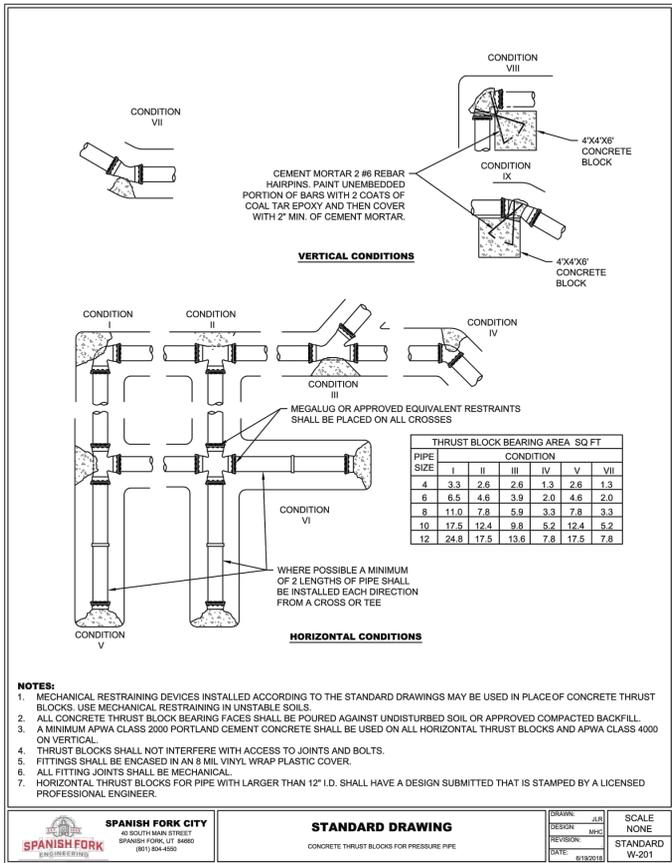

STAMP:

NO.	DATE	BY	FOR	REVISIONS

REVISIONS

NO.	DATE	BY	FOR	REVISIONS

REVISIONS

NO.	DATE	BY	FOR	REVISIONS

REVISIONS







DATE: 04/2022
SCALE: NTS
PROJECT NUMBER: 2201-005

Jones & DeMille Engineering, Inc.
 CIVIL & STRUCTURAL ENGINEERING - SURVEYING
 GIS - ENVIRONMENTAL - MATERIALS TESTING
 1.800.748.5275 www.jonesandmille.com

SPANISH FORK CITY
FACILITIES SHOP SITE
DETAILS

PROJECT NUMBER: 2201-005
 SUBMITTAL: FOR BIDDING ONLY

BID/PERMIT SET - 05.19.2023

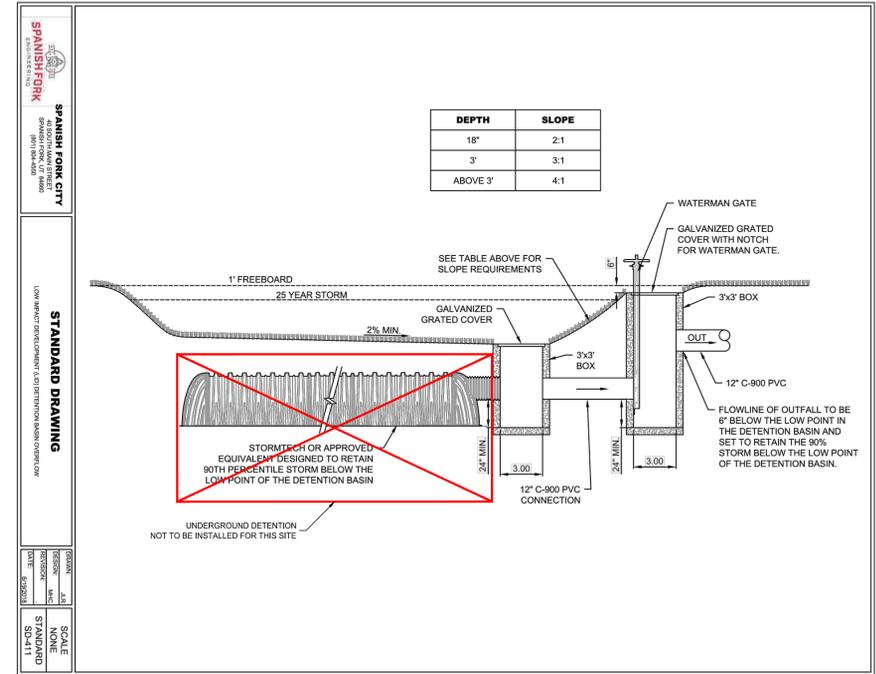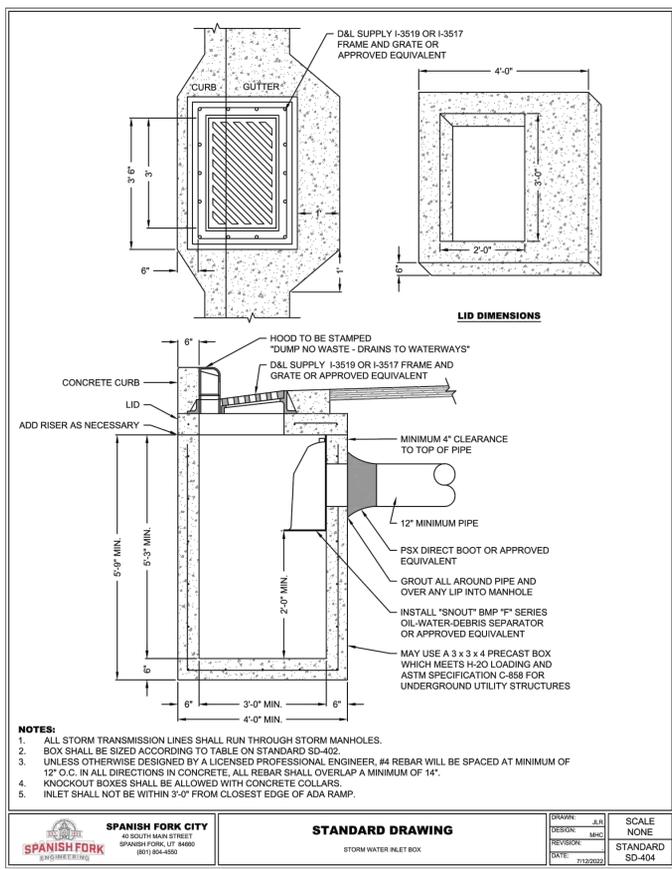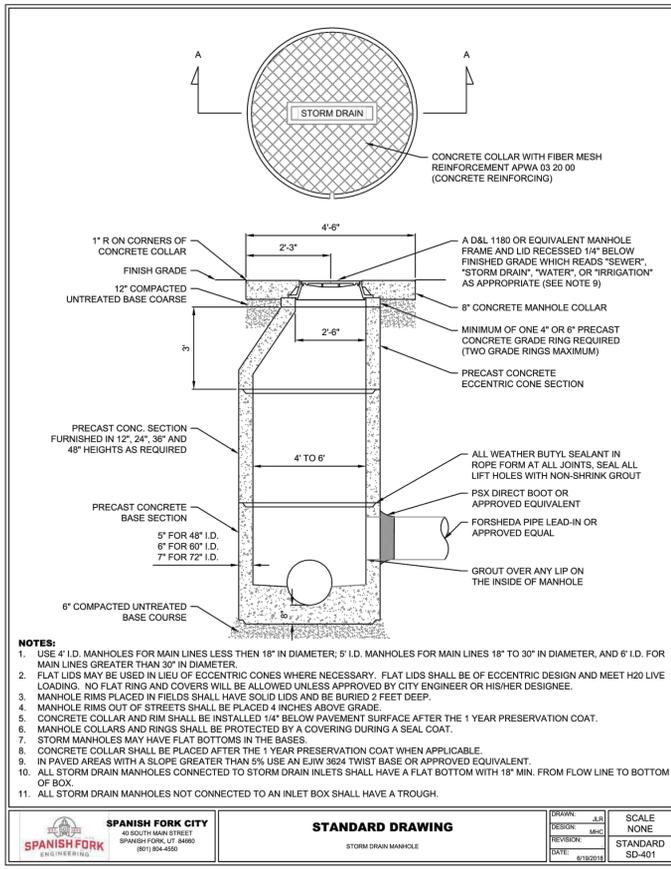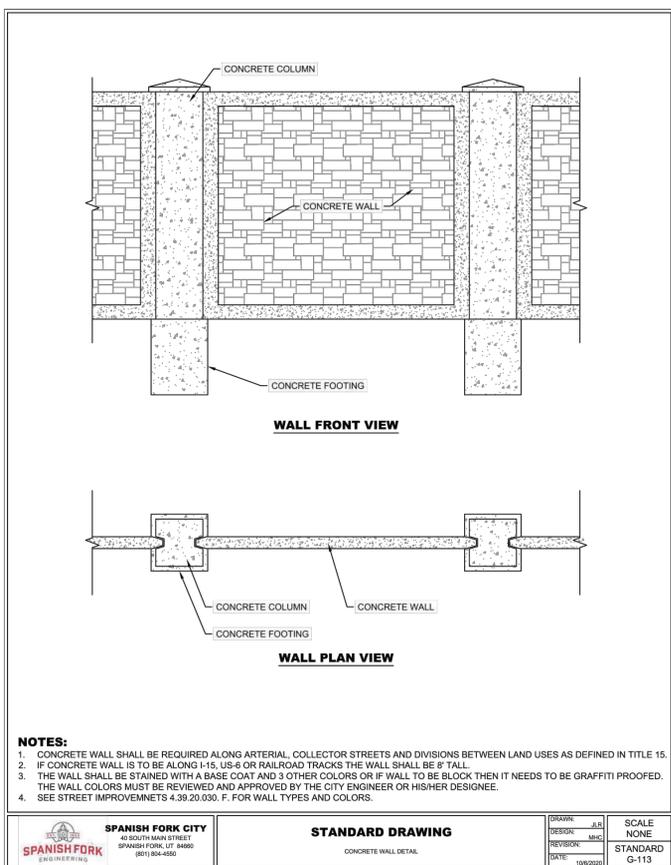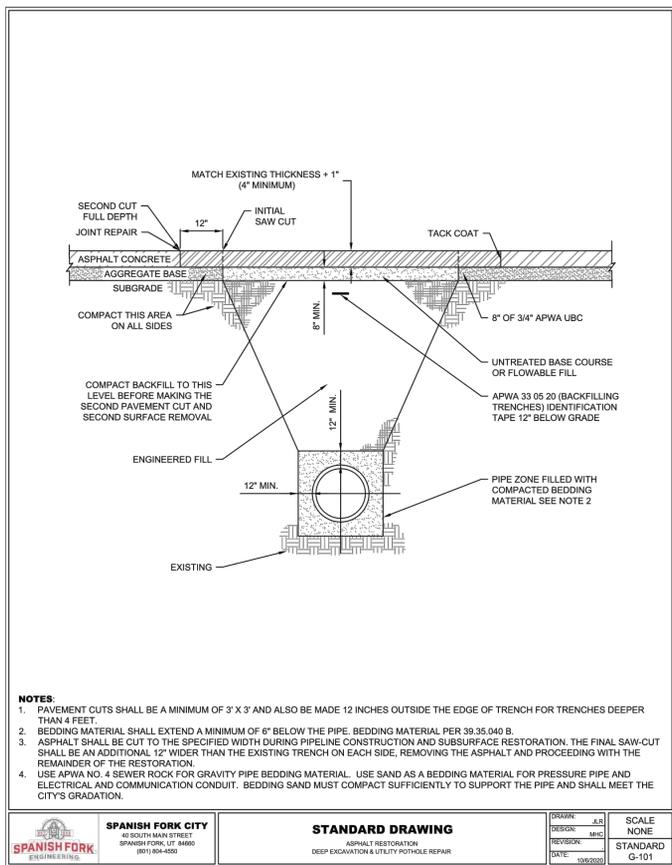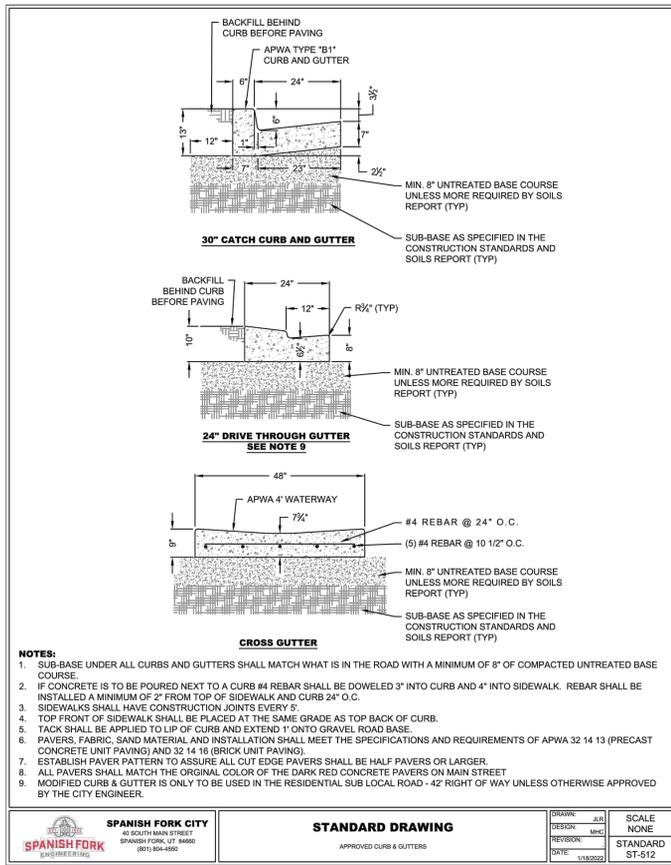

NO.	DATE	BY	CHKD.	APP'D.	REVISIONS

DRAWING NAME: C&G_DETAILS
 DATE CREATED: 04/2022
 PLOTTED: 3/7/2023
 PROJECT NUMBER: 2201-005
 PROJECT DESCRIPTION: SPANISH FORK CITY FACILITIES SHOP SITE

BID/PERMIT SET - 05.19.2023
SPANISH FORK CITY
FACILITIES SHOP SITE
DETAILS
 PROJECT NUMBER: 2201-005
 SUBMITTAL: FOR BIDDING ONLY
 UTAH COUNTY
 SHEET NO. C-502

ELECTRICAL LEGEND

PRIMARY ELECTRICAL CONDUIT
 SECONDARY ELECTRICAL CONDUIT
 SHADOW CONDUIT
 SERVICE DROP
 PRIMARY SECTIONALIZERS
 STREETLIGHT
 SECONDARY JUNCTION BOX (PEDESTAL TYPE)
 TRANSFORMERS (PAD) (POLE)

ELECTRIC NOTES:

- CONDUIT FOR STREET LIGHTS SHALL BE 1" SCHEDULE 40 RIGID NONMETALLIC CONDUIT (RNC).
- CONDUIT FOR SERVICE DROPS SHALL BE 2" (RNC).
- CONDUIT FOR 1 PHASE AND SECONDARY CABLE SHALL BE 3" SCHEDULE 40 RIGID NONMETALLIC CONDUIT (RNC).
- CONDUIT FOR 3 PHASE SHALL BE 6" SCHEDULE 40 RIGID NONMETALLIC CONDUIT (RNC).
- LONG-RADIUS ELBOWS CONSTRUCTED OF EITHER RIGID METAL OR FIBERGLASS ARE REQUIRED FOR ANY ANGLE 45 DEG OR GREATER.
- SECONDARY CABLE SHALL BE 4/0 NOME URD TYPE UNLESS OTHERWISE SPECIFIED.
- SECONDARY, 1 PHASE AND 3 PHASE TRANSFORMER CONDUITS SHALL BE AT A DEPTH OF 4" TO TOP OF CONDUIT.
- 3 PHASE CONDUITS SHALL BE AT A DEPTH OF 6" TO TOP OF CONDUIT, UNLESS OTHERWISE SPECIFIED.
- SERVICE DROP CONDUIT SHALL BE AT A DEPTH OF 4" TO TOP OF CONDUIT.
- STREET LIGHT CONDUITORS SHALL BE #10 STR CU TYPE THWN.
- STREET LIGHTS SHALL BE LED, DECORATIVE POLE UNLESS OTHERWISE SPECIFIED.
- (1) - SHADOW CONDUIT SHALL BE REQUIRED AT EACH POWER ROAD CROSSING. CONDUIT SHALL BE THE SAME SIZE AND TYPE AS LARGEST POWER CONDUIT BEING INSTALLED.

COMMUNICATIONS LEGEND

COMMUNICATIONS CONDUIT
 SHADOW CONDUIT
 COMM. SERVICE DROP
 COMMUNICATIONS BOXES (SM) (M) (LG)


SFCN NOTES:

- CONDUIT FOR SERVICE DROPS SHALL BE 1" SCHEDULE 40 RIGID NONMETALLIC CONDUIT (RNC).
- CONDUIT FOR SECONDARY RUNS SHALL BE 2" (RNC).
- CONDUIT FOR MAIN RUNS SHALL BE 2" (RNC).
- CONDUIT FOR FIBER OPTICS SHALL BE 3" (RNC) UNLESS OTHERWISE SPECIFIED.
- LONG-RADIUS ELBOWS CONSTRUCTED OF EITHER RIGID METAL OR FIBERGLASS ARE REQUIRED FOR ANY ANGLE 45 DEG OR GREATER.
- COMMUNICATIONS CONDUITS SHALL RUN BEHIND (FARTHEST FROM PROPERTY LINE) ELECTRICAL CONDUITS AND STUB UP BEHIND ELECTRICAL BOXES UNLESS OTHERWISE SPECIFIED.
- (1) - SHADOW CONDUIT SHALL BE REQUIRED AT EACH COMMUNICATION ROAD CROSSING. CONDUIT SHALL BE THE SAME SIZE AND TYPE AS LARGEST COMMUNICATIONS CONDUIT BEING INSTALLED.

GENERAL NOTES:
 DEVELOPER SHALL BE RESPONSIBLE FOR OBTAINING ALL PERMITS, EASEMENTS, AND RIGHTS-OF-WAY. DEVELOPER SHALL FOLLOW ALL OF SPANISH FORK CITY STANDARDS.

GENERAL NOTES:
 THIS MAP IS INTENDED FOR INFORMATIONAL PURPOSES ONLY. THIS MAP DOES NOT SHOW THE ACTUAL, AND EXACT LOCATION(S) OF ANY CONDUITS, BOXES, LIGHTS, OR OTHER APPARATUS. THESE ITEMS SHALL BE PLACED ACCORDING TO SPANISH FORK CITY STANDARDS, AND BY FIELD VERIFICATION.

CONSTRUCTION NOTES:

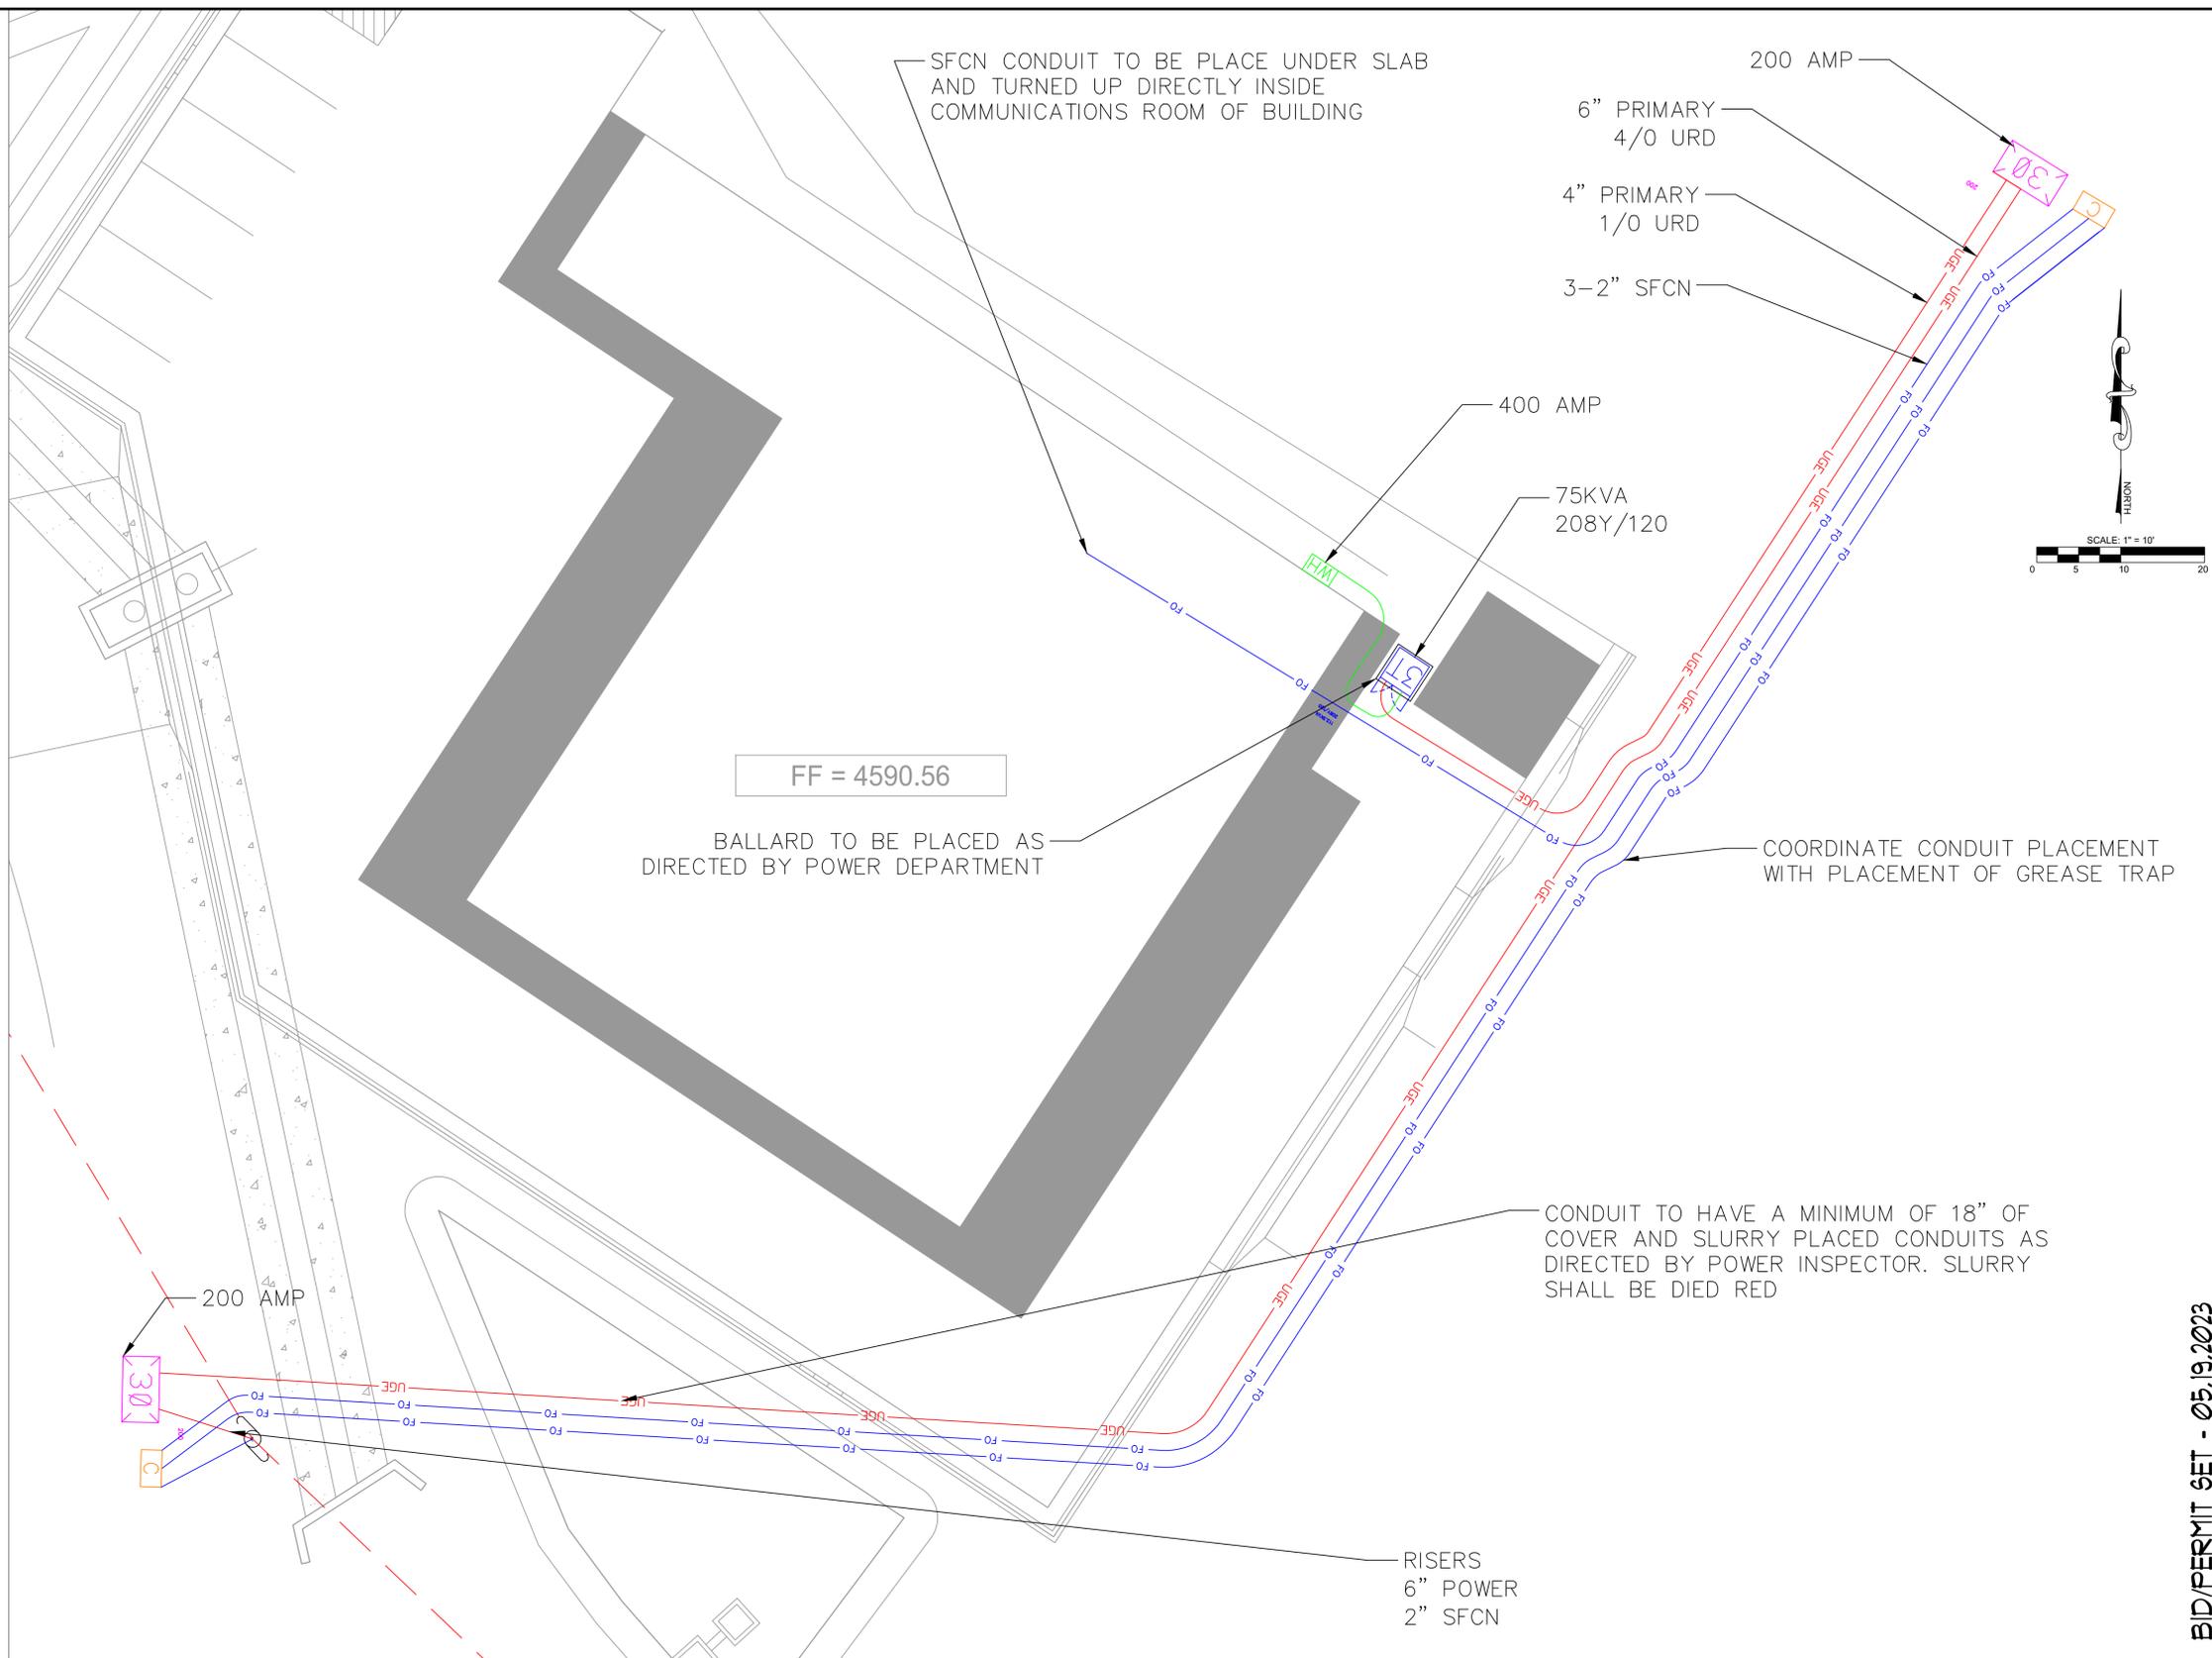

BUILDING & GROUNDS FACILITY

SPANISH FORK CITY ELECTRIC
 2650 NORTH 1715 EAST
 SPANISH FORK, UTAH 84660
 (801) 804-4450



SCALE:

1"=30'

APPROVED:

ELECTRICAL CHECKED BY:

DRAWN BY:

TOM COOPER

DRAWING APPROVAL:

SFCN CHECKED BY:

DATE DRAWN:

01/09/2023

SHEET SIZE:

ARCH D

ELECTRICAL APPROVED BY: DATE:


SFCN APPROVED BY: DATE:

BID/PERMIT SET - 05.19.2023

ELECTRICAL DESIGN


SFCN DESIGN

DISCLAIMER: SPANISH FORK CITY makes no warranty with respect to the accuracy, completeness, or usefulness of these maps. Spanish Fork City assumes no liability for direct, indirect, special, or consequential damages resulting from the use or reliance of these maps or any of the information contained herein. Portions may be copied for individual use, but they may not be resold.

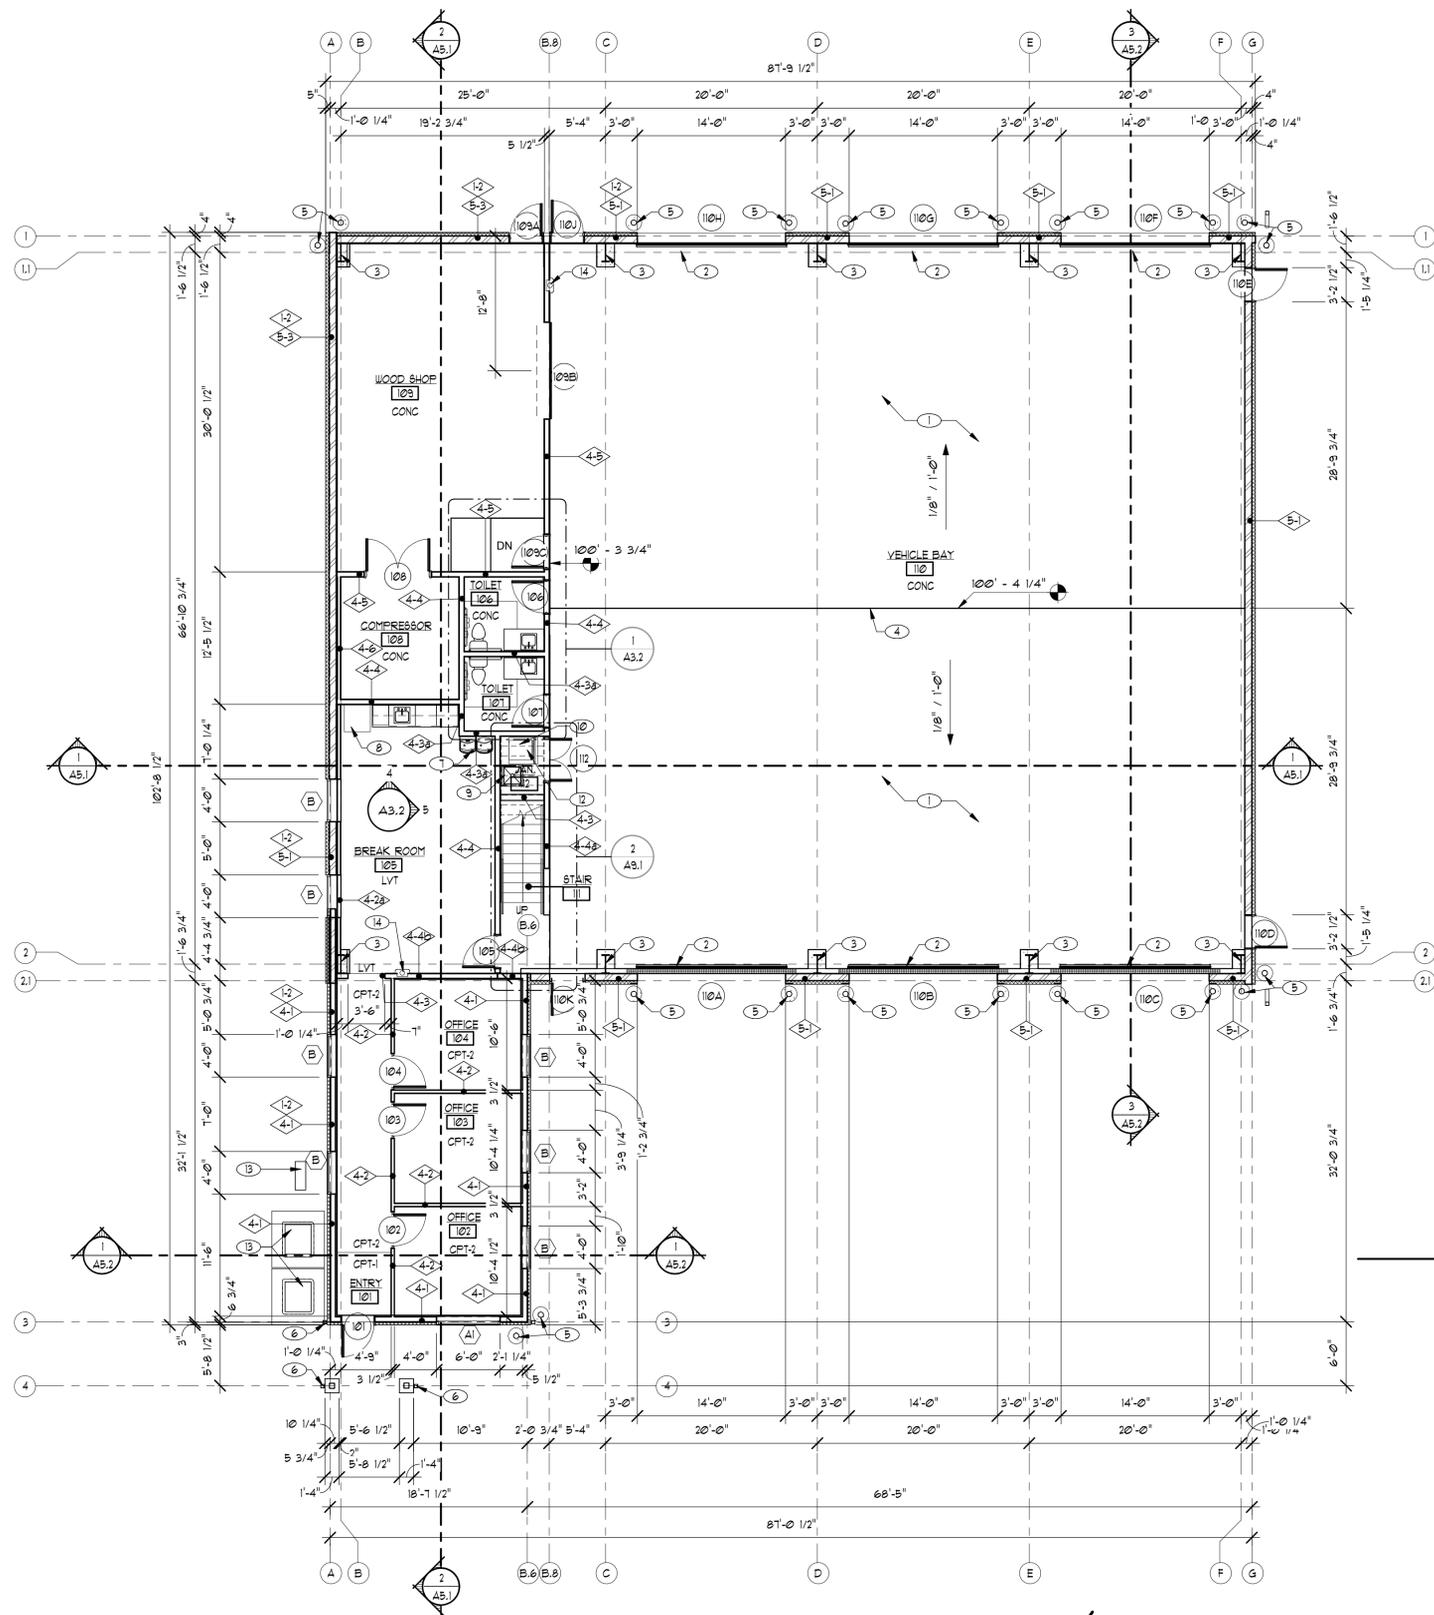

1 MAIN FLOOR PLAN
1/8" = 1'-0"

- SHEET NOTES:**
- ◇ TYPICAL REFERENCE FOR CONSTRUCTION TYPE - SEE SHEET A3.1
 - TYPICAL REFERENCE FOR DOOR TYPE - SEE SHEET A3.2
 - TYPICAL REFERENCE FOR WINDOW TYPE - SEE SHEET A3.3
 - 1 CONCRETE SLAB, SEE STRUCTURAL DUG'S - SLOPE TO TRENCH DRAINS
 - 2 TRENCH DRAINS - SEE PLUMBING DUG'S 4 DETAIL 2/A5.2
 - 3 STEEL STRUCTURE PROVIDED BY METAL BUILDING MANUFACTURER, TYP.
 - 4 FLOOR RIDGE LINE
 - 5 CONC. FILLED PIPE BOLLARD, SEE DETAIL 2/A2.1 - PAINT
 - 6 4" X 6" PRE-FINISHED METAL DOWNSPOUT
 - 7 DRINKING FOUNTAIN WITH BOTTLE FILLER - SEE PLUMBING DUG'S
 - 8 CUISINER PROVIDED REFRIGERATOR - N.I.C.
 - 9 MOP SINK - SEE PLUMBING DUG'S
 - 10 CUISINER PROVIDED ICE MAKER - N.I.C.
 - 11 STANDING SEAM METAL ROOF BELOW - SEE ROOF PLAN
 - 12 FLOOR DRAIN - SEE PLUMBING DRAWINGS
 - 13 MECHANICAL EQUIPMENT - SEE MECHANICAL DRAWINGS
 - 14 FIRE EXTINGUISHER AND SEMI-RECESSED CABINET - SEE DETAIL 8/G1.3

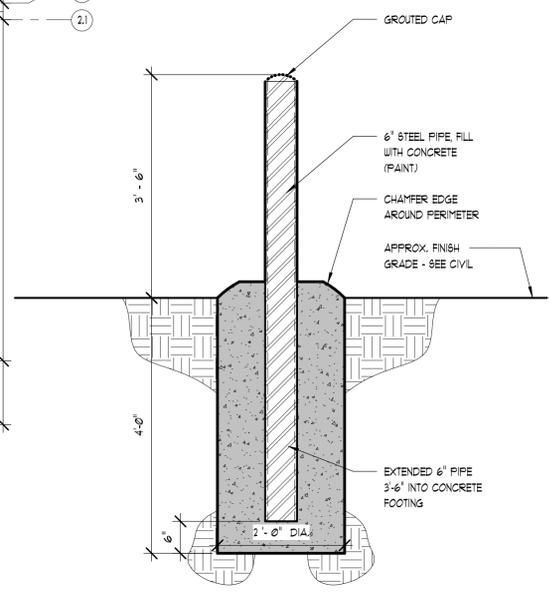

2 BOLLARD DETAIL
3/4" = 1'-0"

BID/PERMIT SET - 05.19.2023

These plans, drawings, and designs are the exclusive property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.


Date: 05.22.2023
 Revision:

Alan R. Pouison
 Bruce T. Fallon


WPA Architecture
 475 North Freedom Blvd.
 Provo, Utah 84601
 Tel: (801) 374-0800
 info@wpa-architecture.com

SPANISH FORK CITY
 433 SOUTH MAIN STREET
 SPANISH FORK, UTAH 84660

A2.1
 MAIN LEVEL FLOOR PLAN

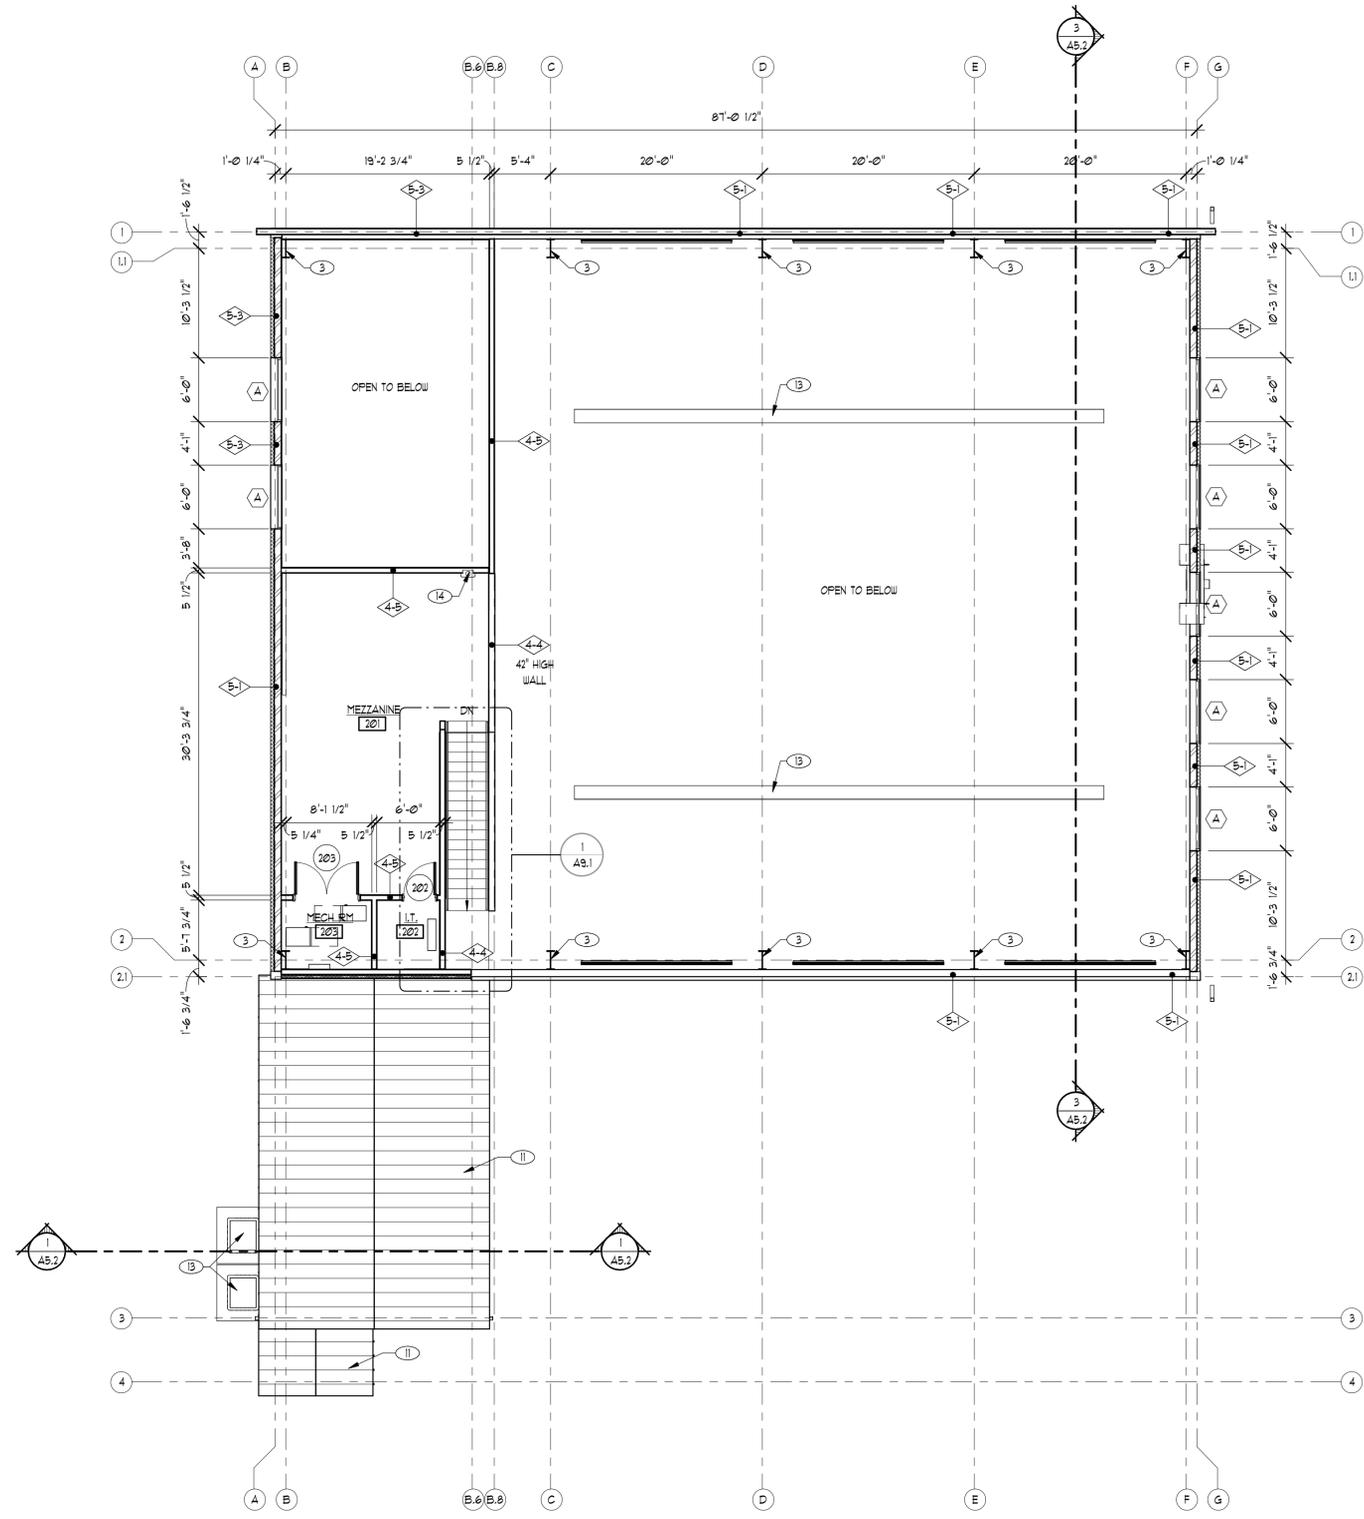

1 MEZZANINE LEVEL
1/8" = 1'-0"



SHEET NOTES:

- ◇ TYPICAL REFERENCE FOR CONSTRUCTION TYPE - SEE SHEET A3.1
- TYPICAL REFERENCE FOR DOOR TYPE - SEE SHEET A3.2
- TYPICAL REFERENCE FOR WINDOW TYPE - SEE SHEET A3.3
- ① CONCRETE SLAB, SEE STRUCTURAL DWG'S - SLOPE TO TRENCH DRAINS
- ② TRENCH DRAINS - SEE PLUMBING DWG'S & DETAIL 2/A5.2
- ③ STEEL STRUCTURE PROVIDED BY METAL BUILDING MANUFACTURER, TYP.
- ④ FLOOR RIDGE LINE
- ⑤ CONC. FILLED PIPE BOLLARD, SEE DETAIL 2/A2.1 - PAINT
- ⑥ 4' X 6' PRE-FINISHED METAL DOWNSPOUT
- ⑦ DRINKING FOUNTAIN WITH BOTTLE FILLER - SEE PLUMBING DWG'S
- ⑧ OWNER PROVIDED REFRIGERATOR - N.I.C.
- ⑨ MOP SINK - SEE PLUMBING DWG'S
- ⑩ OWNER PROVIDED ICE MAKER - N.I.C.
- ⑪ STANDING BEAM METAL ROOF BELOW - SEE ROOF PLAN
- ⑫ FLOOR DRAIN - SEE PLUMBING DRAWINGS
- ⑬ MECHANICAL EQUIPMENT - SEE MECHANICAL DRAWINGS
- ⑭ FIRE EXTINGUISHER AND 68"-RECESSED CABINET - SEE DETAIL 8/G1.3

BID/PERMIT SET - 05.19.2023

FACILITIES SHOP

SPANISH FORK CITY

433 SOUTH MAIN STREET

SPANISH FORK, UTAH 84660



WPA
Architecture

Tel: (801) 374-0800
info@wpa-architecture.com

Alan R. Pouison
Bruce T. Fallon




Date: 05.22.2023
Revision:


These plans, drawings and designs are the property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

A2.2


MEZZANINE FLOOR PLAN

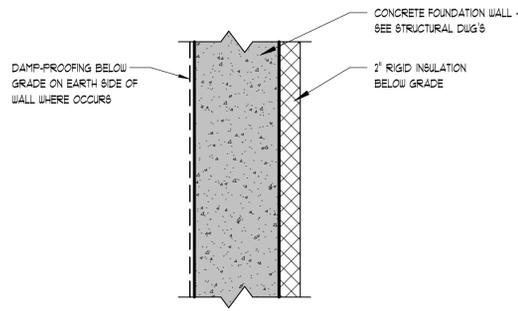


1-1 WALL CONSTRUCTION
1 1/2" x 1'-0"

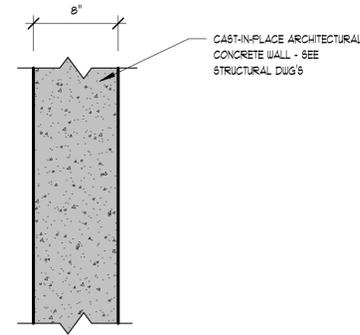


1-2 WALL CONSTRUCTION
1 1/2" x 1'-0"

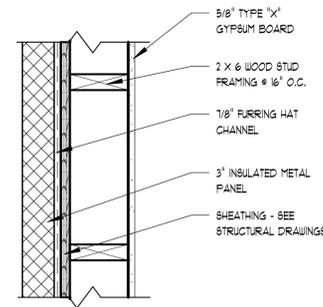


4-1 WALL CONSTRUCTION
1 1/2" x 1'-0"

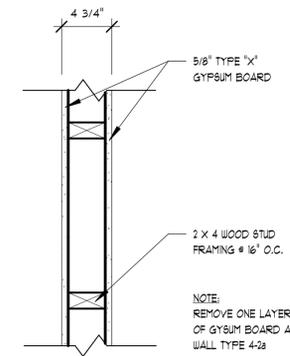


4-2 WALL CONSTRUCTION
1 1/2" x 1'-0"

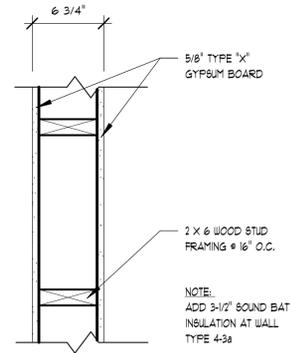


4-3 WALL CONSTRUCTION
1 1/2" x 1'-0"

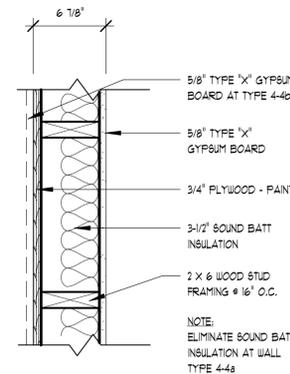


4-4 WALL CONSTRUCTION
1 1/2" x 1'-0"

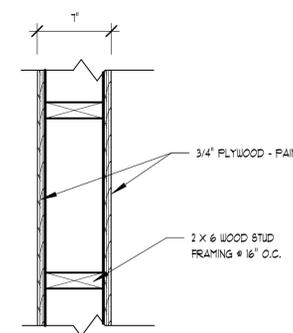


4-5 WALL CONSTRUCTION
1 1/2" x 1'-0"




4-6 WALL CONSTRUCTION
1 1/2" x 1'-0"

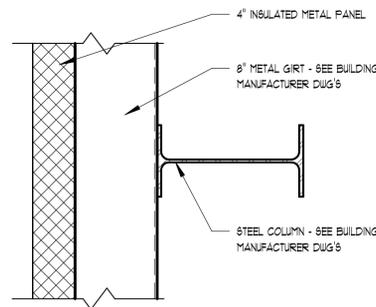


5-1 WALL CONSTRUCTION
1 1/2" x 1'-0"

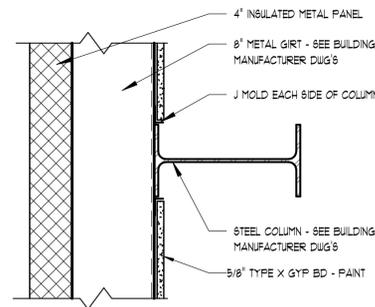


5-2 WALL CONSTRUCTION
1 1/2" x 1'-0"

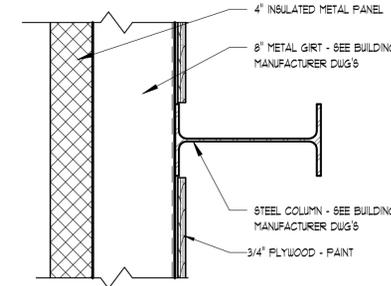


5-3 WALL CONSTRUCTION
1 1/2" x 1'-0"

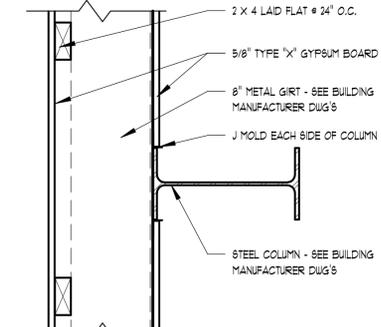


5-4 WALL CONSTRUCTION
1 1/2" x 1'-0"

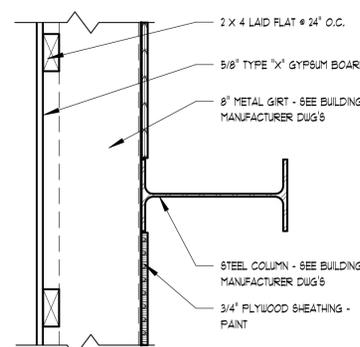


5-5 WALL CONSTRUCTION
1 1/2" x 1'-0"

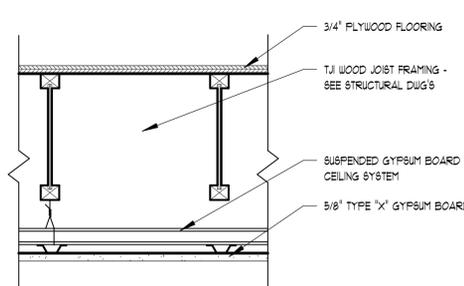

8-1 FLOOR/CEILING CONSTRUCTION
1 1/2" x 1'-0"

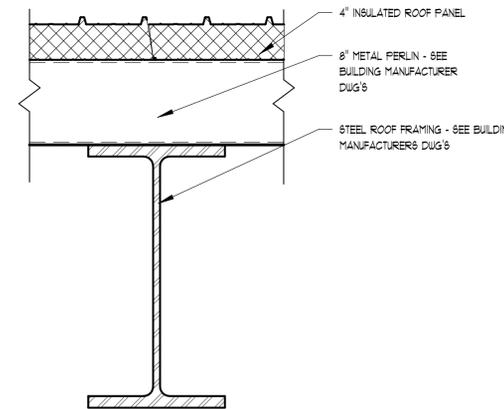

9-1 ROOF/CEILING CONSTRUCTION
1 1/2" x 1'-0"

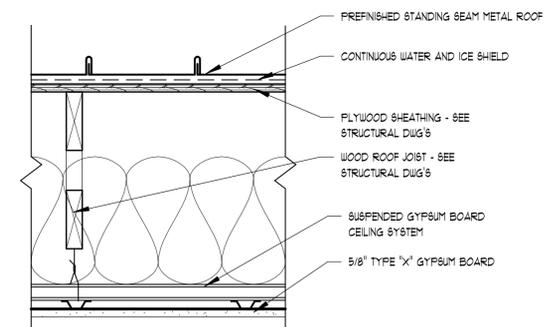

10-1 ROOF/CEILING CONSTRUCTION
1 1/2" x 1'-0"

Date: 05.22.2023
Revision:
These plans, drawings and designs are the property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Alan R. Poulsen
Bruce T. Fallon

WPA Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

SPANISH FORK, UTAH 84660

FACILITIES SHOP
SPANISH FORK CITY

433 SOUTH MAIN STREET

BID/PERMIT SET - 05.19.2023
A3.1
CONSTRUCTION TYPES


FINISH SCHEDULE											
RM. NUMBER	ROOM NAME	FLOOR FINISH	BASE FINISH	WALL FINISH				CEILING	MILLWORK	COUNTERTOP	COMMENTS
				NORTH	EAST	SOUTH	WEST				
101	ENTRY	LVT	RB	FTDU-1	FTDU-1	PTDU-1	PTDU-1	PTDC-1			
102	OFFICE	LVT	RB	FTDU-1	FTDU-1	PTDU-1	PTDU-1	PTDC-1			
103	OFFICE	LVT	RB	FTDU-1	FTDU-1	PTDU-1	PTDU-1	PTDC-1			
104	OFFICE	LVT	RB	FTDU-1	FTDU-1	PTDU-1	PTDU-1	PTDC-1			
105	BREAK ROOM	LVT	RB	FTDU-1	FTDU-1	PTDU-1	PTDU-1	PTDC-1	FLAM	SS	
106	TOILET	CONC-S	RB	FTDU-4	FTDU-4	PTDU-4	PTDU-4	PTDC-3		SS	
107	TOILET	CONC-S	RB	FTDU-4	FTDU-4	PTDU-4	PTDU-4	PTDC-3		SS	
108	COMPRESSOR	CONC-S	NONE	FTDU-2	FTDU-2	PTDU-2	PTDU-2	PTDC-2			
109	WOOD SHOP	CONC-S	NONE	FTDU-2	FTDU-2	PTDU-2	PTDU-2	EXP			
110	VEHICLE BAY	CONC-S	NONE	FTDU-3	FTDU-3	PTDU-3	PTDU-3	EXP			
111	STAR	RTR	RB	FTDU-1	FTDU-1	PTDU-1	PTDU-1	EXP			
112	JAN.	CONC-S	RB	FTDU-4	FTDU-4	PTDU-4	PTDU-4	PTDC-3			
201	MEZZANINE	PLY-P	NONE	FTDU-1	FTDU-1	PTDU-1	PTDU-1	EXP			
202	LT.	PLY-P	NONE	FTDU-2	FTDU-2	PTDU-2	PTDU-2	EXP			
203	MECH RM	PLY-P	NONE	FTDU-1	FTDU-1	PTDU-1	PTDU-1	EXP			

FINISH LEGEND


FLOORS					
MARK	MATERIAL TYPE	MANUFACTURER	# / COLOR	SIZE	NOTES
LVT	LUXURY VINYL TILE	SHAW CONTRACT	COLLECTION: UNCOMMON GROUND COLOR: TBD	6' X 36" X 3MM	--
RTR	RUBBER TREAD 4 RIBS	ROFFE	#30 1/2" DIAMOND DESIGN COLOR: TBD	--	--
PLY-P	PLYWOOD - PAINTED	SHERWIN WILLIAMS	COLOR: TBD	--	--
CONC	SEALED CONCRETE	SEE SPEC	STYLE: CLEAR SEAL COLOR: NONE	--	--
BASE					
MARK	MATERIAL TYPE	MANUFACTURER	# / COLOR	SIZE	NOTES
CFP-1-B	CARPET BASE	MATCH CFP-2	COLOR TBD	4"	--
RB	RUBBER BASE	ROFFE	COLOR TBD	4"	--
NONE	NONE	N/A	N/A	--	--
WALLS					
MARK	MATERIAL TYPE	MANUFACTURER	# / COLOR	SIZE	NOTES
FTDU-1	PAINTED GYPSUM BOARD	SHERWIN WILLIAMS	COLOR: TBD	N/A	--
FTDU-2	PAINTED PLYWOOD	SHERWIN WILLIAMS	COLOR: TBD	N/A	--
FTDU-3	PAINTED EXPOSED STRUCTURE	SHERWIN WILLIAMS	COLOR: TBD	N/A	PAINT STRUCTURAL STEEL & CONCRETE
FTDU-4	PAINTED GYPSUM BOARD	SHERWIN WILLIAMS	COLOR: TBD	N/A	EPOXY PAINT
CEILING					
MARK	MATERIAL TYPE	MANUFACTURER	# / COLOR	SIZE	NOTES
PTDC-1	PAINTED GYPSUM BOARD	SHERWIN WILLIAMS	COLOR: TBD	N/A	--
PTDC-2	PAINTED PLYWOOD	SHERWIN WILLIAMS	COLOR: TBD	N/A	--
PTDC-3	PAINTED GYPSUM BOARD	SHERWIN WILLIAMS	COLOR: TBD	N/A	EPOXY PAINT
EXP	PAINTED EXPOSED STRUCTURE	SHERWIN WILLIAMS	COLOR: TBD	N/A	--
MILLWORK					
MARK	MATERIAL TYPE	MANUFACTURER	# / COLOR	SIZE	NOTES
FLAM	PLASTIC LAMINATE	WILSONART	COLOR: TBD	N/A	VERTICAL MILLWORK SURFACES
SS	SOLID SURFACE	WILSONART	COLOR: TBD	N/A	COUNTERTOPS
DOORS, WINDOWS and DOOR TRIM					
MARK	MATERIAL TYPE	MANUFACTURER	# / COLOR	SIZE	NOTES
FR-1	PAINTED HM FRAME	SHERWIN WILLIAMS	COLOR: TBD	N/A	--
DR-1	PAINTED HM DOOR	SHERWIN WILLIAMS	COLOR: TBD	N/A	--
DR-2	WOOD VENEER	VT INDUSTRIES	COLOR: TBD	N/A	--

NOTE: FINISHES SHOWN IN THIS SCHEDULE SHALL BE THE BASIS OF DESIGN. REFER TO THE PROJECT MANUAL FOR OTHER ACCEPTABLE MANUFACTURERS


NOTE: PROVIDE RUBBER TRANSITION STRIPS BETWEEN DISSIMILAR FLOORING MATERIALS SPECIFIC TO THE THICKNESSES OF EACH FLOORING MATERIAL CALLED OUT.

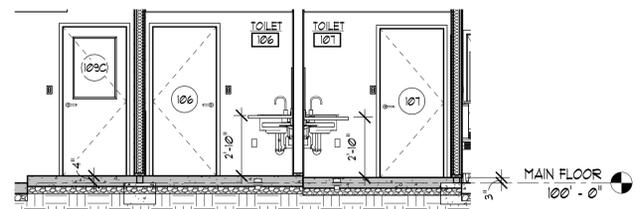


6 SECTION AT BATHROOM - STEPPED SLAB
1/4" = 1'-0"

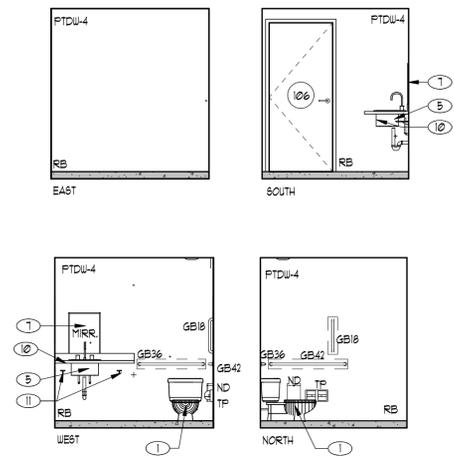

3 TOILET 106 & 107 (MIRR.)
1/4" = 1'-0"

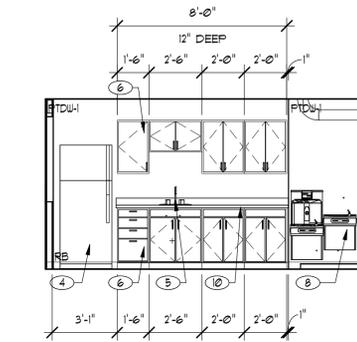

4 BREAK ROOM 105
1/4" = 1'-0"

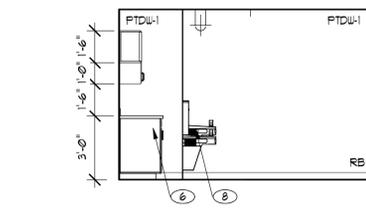


5 BREAK ROOM 105
1/4" = 1'-0"

ACCESSORY ABBREVIATIONS:


MIRR: 24 X 36 MIRROR, SEE INT. ELEV.
S.D.: SOAP DISPENSER 48" AFF. (BY OWNER)
T.P.: TOILET PAPER DISPENSER 48" AFF. (BY OWNER)
G.B.36: 36" GRAB BAR 18" LONG (PROVIDE BACKING)
G.B.42: 42" GRAB BAR 18" LONG (PROVIDE BACKING)
P.T.: PAPER TOWEL DISPENSER (BY OWNER)
D.C.: DIAPER CHANGING STATION
N.D.: FEMINE NAPKIN DISPENSER
M.B.: MOP AND BROOM HANGER

SHEET NOTES:

- ◇ TYPICAL REFERENCE FOR CONSTRUCTION TYPE - SEE SHEET A3.1
- TYPICAL REFERENCE FOR DOOR TYPE - SEE SHEET A3.2
- TYPICAL REFERENCE FOR WINDOW TYPE - SEE SHEET A3.3
- ① WATER CLOSET - SEE PLUMBING DUG'S
- ② LAVATORY - SEE PLUMBING DUG'S
- ③ MOP SINK - SEE PLUMBING DUG'S
- ④ OWNER PROVIDED REFRIGERATOR - N.L.C.
- ⑤ SINK - SEE PLUMBING DUG'S
- ⑥ PLASTIC LAMINATE MILLWORK - SEE INTERIOR ELEVATIONS
- ⑦ WALL MOUNTED MIRROR
- ⑧ DRINKING FOUNTAIN W/ BOTTLE FILLING STATION - SEE PLUMBING DUG'S & DETAIL 3/G1.3
- ⑨ OWNER PROVIDED ICE MAKER - N.L.C.
- ⑩ SOLID SURFACE COUNTERTOP
- ⑪ PARTIALLY CONCEALED FRONT MOUNTED COUNTERTOP BRACKET @ 32" o.c. MAXIMUM
- ⑫ RESTROOM SIGN - SEE DETAIL 4/G1.3

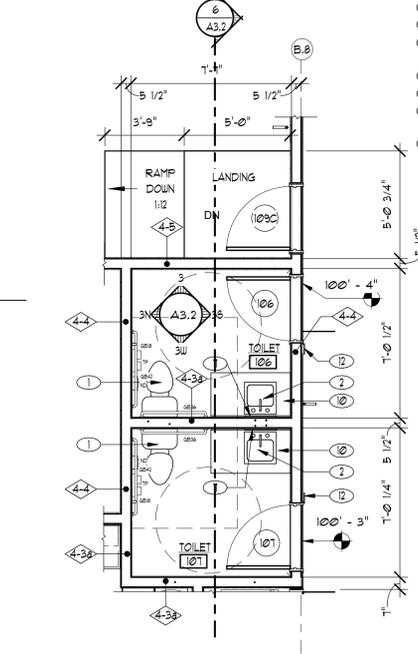


1 MAIN LEVEL - TOILETS 106 & 107
1/4" = 1'-0"

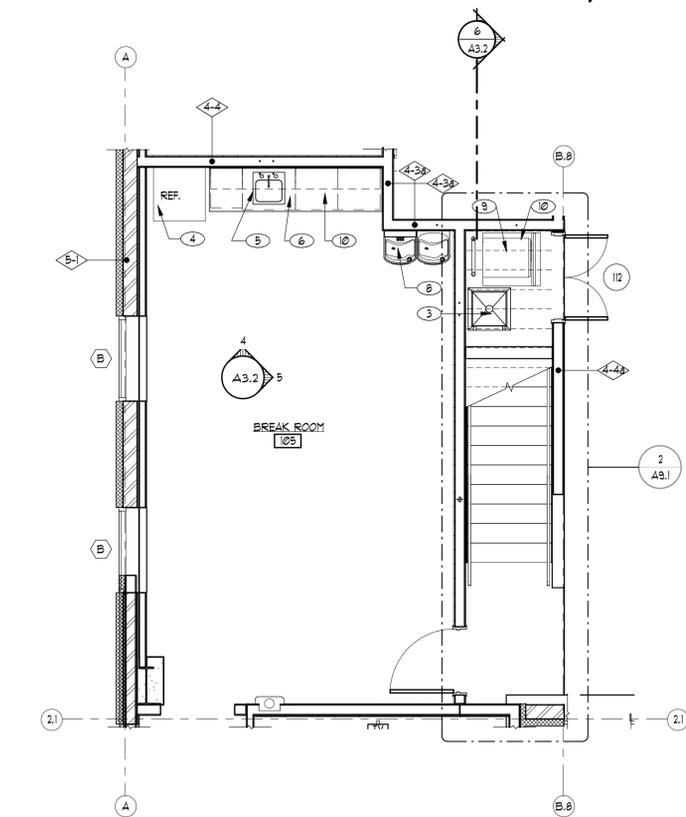


2 MAIN LEVEL - BREAK ROOM
1/4" = 1'-0"


Date: 05.22.2023
 Revision:
 Alan R. Poulson
 Bruce T. Fallon
 WPA Architecture
 475 North Freedom Blvd.
 Provo, Utah 84601
 Tel: (801) 374-0800
 info@wpa-architecture.com
 FACILITIES SHOP
 SPANISH FORK CITY
 433 SOUTH MAIN STREET
 SPANISH FORK, UTAH 84660
 A3.2
 ROOM FINISH SCHEDULE
 LARGE SCALE FLOOR
 PLANS & INT. ELEVATIONS
 BID/PERMIT SET - 05.19.2023

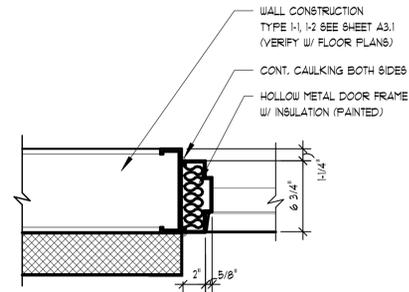


1 JAMB DETAIL
1 1/2" = 1'-0"

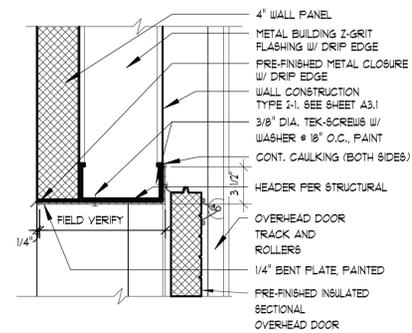


2 HEAD DETAIL
1 1/2" = 1'-0"

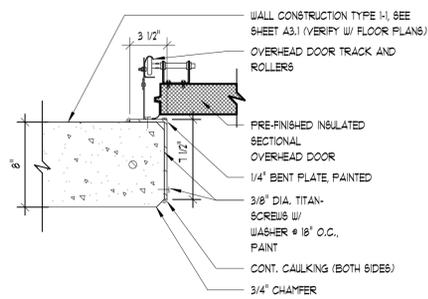


3 JAMB DETAIL
1 1/2" = 1'-0"

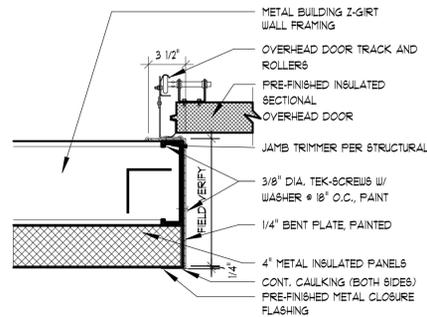


4 JAMB DETAIL
1 1/2" = 1'-0"

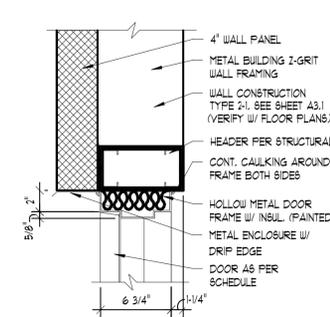


5 HEAD DETAIL
1 1/2" = 1'-0"

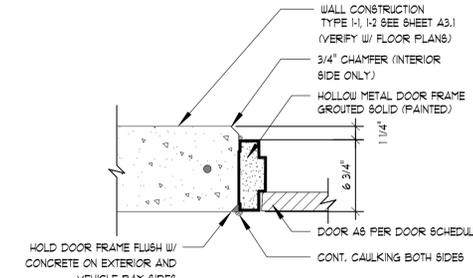


6 JAMB DETAIL
1 1/2" = 1'-0"

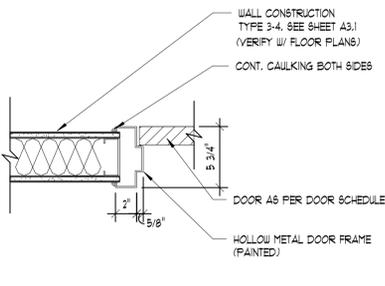

7 JAMB DETAIL
1 1/2" = 1'-0"

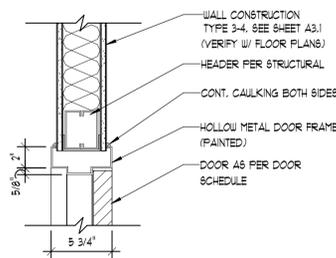


8 HEAD DETAIL
1 1/2" = 1'-0"

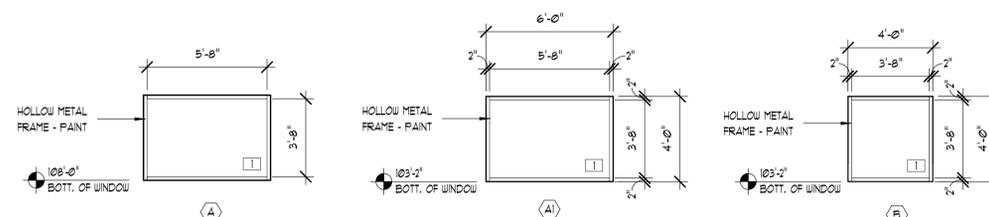

9 WINDOW TYPES
1/4" = 1'-0"

GLAZING SCHEDULE	
Type Mark	Glazing Description
1	1" INSULATED CLEAR GLAZING WITH LOW-E COATING

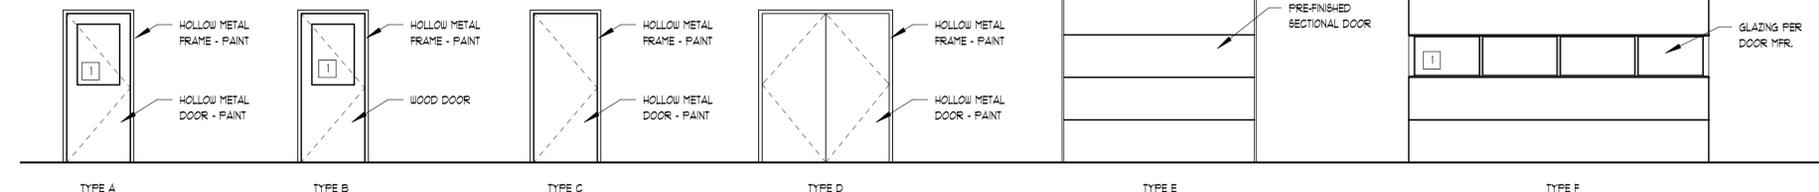

10 DOOR TYPES
1/4" = 1'-0"

DOOR SCHEDULE

DOOR NUMBER	ROOM NUMBER	DOOR TYPE	DOOR SIZE		THICKNESS	DETAILS		HW SET	FIRE RATING	COMMENTS
			WIDTH	HEIGHT		HEAD	JAMB			
101	101	A	3'-0"	7'-0"	1 3/4"	5/A3.3 SIM	1 4 6/A3.3 SIM	01		
102	102	B	3'-0"	7'-0"	1 3/4"	8/A3.3	7/A3.3	02		
103	103	B	3'-0"	7'-0"	1 3/4"	8/A3.3	7/A3.3	02		
104	104	B	3'-0"	7'-0"	1 3/4"	8/A3.3	7/A3.3	02		
105	105	A	3'-0"	7'-0"	1 3/4"	8/A3.3	7/A3.3	03		
106	106	C	3'-0"	7'-0"	1 3/4"	8/A3.3	7/A3.3	04		
107	107	C	3'-0"	7'-0"	1 3/4"	8/A3.3	7/A3.3	04		
108	108	D	6'-0"	7'-0"	1 3/4"	8/A3.3	7/A3.3	05		
109A	110	A	3'-0"	7'-0"	1 3/4"	8/A3.3	1 4 6/A3.3	01		
109B	109	E	9'-0"	10'-0"	2"			06		
109C	109	A	3'-0"	7'-0"	1 3/4"	8/A3.3	7/A3.3	03		
110A	110	F	14'-0"	14'-0"	2"	2/A3.3	3 4 4/A3.3	06		
110B	110	F	14'-0"	14'-0"	2"	2/A3.3	3 4 4/A3.3	06		
110C	110	F	14'-0"	14'-0"	2"	2/A3.3	3 4 4/A3.3	06		
110D	110	A	3'-0"	7'-0"	1 3/4"	8/A3.3	1 4 6/A3.3	01		
110E	110	A	3'-0"	7'-0"	1 3/4"	8/A3.3	1 4 6/A3.3	01		
110F	110	F	14'-0"	14'-0"	2"	2/A3.3	3 4 4/A3.3	06		
110G	110	F	14'-0"	14'-0"	2"	2/A3.3	3 4 4/A3.3	06		
110H	110	F	14'-0"	14'-0"	2"	2/A3.3	3 4 4/A3.3	06		
110J	110	A	3'-0"	7'-0"	1 3/4"	8/A3.3	1 4 6/A3.3	01		
110K	110	A	3'-0"	7'-0"	1 3/4"	8/A3.3	1 4 6/A3.3	01		
112	110	D	4'-0"	7'-0"	1 3/4"	8/A3.3	7/A3.3	05		
202	202	A	3'-0"	7'-0"	1 3/4"	8/A3.3	7/A3.3	05		
203	203	D	6'-0"	7'-0"	1 3/4"	8/A3.3	7/A3.3	01		

DOOR HARDWARE SCHEDULE

HARDWARE GROUP: ONE DOOR(S): 101, 109C, 110D, 110E, 110J

#	ITEM	PRODUCT*	FIN.	MANU.
3	EA HINGE	3BB81 4.5 X 4.5 NRP	626	IVE
1	EA ENTRY / OFFICE	L1B3R C	626	GEN
1	EA SURFACE CLOSER	4040XP RUPA AL X 5NB	689	LCN
1	EA KICK PLATE	186 10 X 34	630	HAG
1	SET SEALS	160V 1"	GRY	NGP
1	EA DOOR SWEEP	200NA 36"	AL	NGP
1	EA THRESHOLD	43E 36"	628	NGP

HARDWARE GROUP: TWO DOOR(S): 102, 103, 104

#	ITEM	PRODUCT*	FIN.	MANU.
3	EA HINGE	3BB81 4.5 X 4.5	626	IVE
1	EA ENTRY / OFFICE	L1B3R C	626	GEN
1	EA WALL STOP	1210	626	TR
3	EA SILENCERS	8R64	GRY	IVE

HARDWARE GROUP: THREE DOOR(S): 105, 109A

#	ITEM	PRODUCT*	FIN.	MANU.
3	EA HINGE	3BB81 4.5 X 4.5 NRP	626	IVE
1	EA PASSAGE SET	L110R	626	GEN
1	EA SURFACE CLOSER	4040XP 8CUBH	689	LCN
1	EA WALL STOP	1210	626	TR
3	EA SILENCER	8R64	GRY	IVE

HARDWARE GROUP: FOUR DOOR(S): 106, 107

#	ITEM	PRODUCT*	FIN.	MANU.
3	EA HINGE	3BB81 4.5 X 4.5 NRP	626	IVE
1	EA PRIVACY SET	L140R	626	GEN
1	EA SURFACE CLOSER	4040XP 8CUBH	689	LCN
1	EA WALL STOP	1210	626	TR
3	EA SILENCER	8R64	GRY	IVE

HARDWARE GROUP: FIVE DOOR(S): 108, 112

#	ITEM	PRODUCT*	FIN.	MANU.
6	EA HINGES	3BB81 4.5 X 4.5 NRP	626	IVE
2	EA FLUSH BOLT	331T-12	626	TR
1	EA PASSAGE SET	L110R	626	GEN
1	EA SURFACE CLOSER	4040XP 8CUBH	626	LCN
2	EA DOOR STOP	1214	626	TR
1	EA DUSTPROOF STRIKE	3310	626	TR
2	EA BRUSH SWEEP	600 A		NGP
1	EA ASTRAGAL	180 NA (MOUNT INSIDE IN-ACTIVE LEAF)		NGP
1	EA GASKETING	5040 B (HEAD 4 JAMBS)	GRY	NGP

HARDWARE GROUP: SIX DOOR(S): 109B, 110A, 110B, 110C, 110F, 110G, 110K

#	ITEM	PRODUCT*	FIN.	MANU.
1	EA RIM CYLINDER	12E-12 STD R808	626	BE

HARDWARE GROUP: SEVEN DOOR(S): 203

#	ITEM	PRODUCT*	FIN.	MANU.
3	EA HINGE	3BB81 4.5 X 4.5 NRP	626	IVE
1	EA ENTRY / OFFICE	L1B3R C	626	GEN

- MANUFACTURER ABBREVIATIONS:
- IVE - IVES BY ALLEGION
 - GEN - GENERAL LOCK
 - LCN - LCN BY ALLEGION
 - HAGER - HAGER COMPANIES
 - NGP - NATIONAL GUARD PRODUCTS
 - TR - TRIMCO
 - BE - BEST

WPA Architecture
 475 North Freedom Blvd.
 Provo, Utah 84601
 Tel: (801) 374-0800
 info@wpa-architecture.com

SPANISH FORK CITY
 433 SOUTH MAIN STREET


FACILITIES SHOP

BID/PERMIT SET - 05.19.2023

A3.3
 DOOR & WINDOW SCHEDULES & DETAILS

Date: 05.22.2023
 Revision:

Alan R. Poulsen
 Bruce T. Fallon

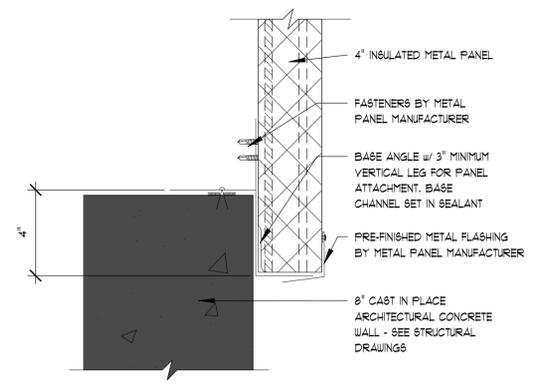


5 PANEL TRANSITION DETAIL
3" x 1'-0"

EXTERIOR FINISH LEGEND


MARK	ITEM DESCRIPTION	MANUFACTURER	STYLE/COLOR	SIZE	NOTES
MTL-1	PRE-FINISHED INSULATED ROOFING PANELS	NICOR BUILDING SYSTEMS OR EQUAL	R-PANEL (INSULATED) GALVALUME	-	-
MTL-2	PRE-FINISHED INSULATED WALL PANELS	NICOR BUILDING SYSTEMS OR EQUAL	R-PANEL (INSULATED) SANDSTONE	-	-
DOORS	TRIM METAL AND DOORS	BENJAMIN MOORE	HC-66 KINGSPOUR GRAY	N/A	-

SHEET NOTES:


- ◇ TYPICAL REFERENCE FOR CONSTRUCTION TYPE - SEE SHEET A3.1
- TYPICAL REFERENCE FOR DOOR TYPE - SEE SHEET A3.2
- TYPICAL REFERENCE FOR WINDOW TYPE - SEE SHEET A3.3
- ① CONCRETE FOOTING & FOUNDATION - SEE STRUCTURAL DWGS
- ② CAST-IN-PLACE ARCHITECTURAL CONCRETE WALL w/ EXPOSED V-GROOVES & FORM TIE HOLES
- ③ CONC. FILLED PIPE BOLLARD, SEE DETAIL 2/A2.1 - PAINT
- ④ PRE-FINISHED INSULATED METAL PANELS
- ⑤ PRE-FINISHED METAL DOWNSPOUT
- ⑥ PRE-FINISHED METAL CORNER TRIM
- ⑦ PRE-FINISHED METAL GUTTER
- ⑧ PRE-FINISHED INSULATED METAL ROOF PANELS
- ⑨ PRE-FINISHED METAL FASCIA
- ⑩ STEEL COLUMN, PAINT - SEE STRUCTURAL DWGS
- ⑪ CONCRETE PIER - SEE STRUCTURAL DWGS
- ⑫ APPROXIMATE FINISH GRADE - SEE CIVIL DWGS
- ⑬ CONCRETE V-GROOVE ACCENT @ 8'-0" O.C. AND AS SHOWN

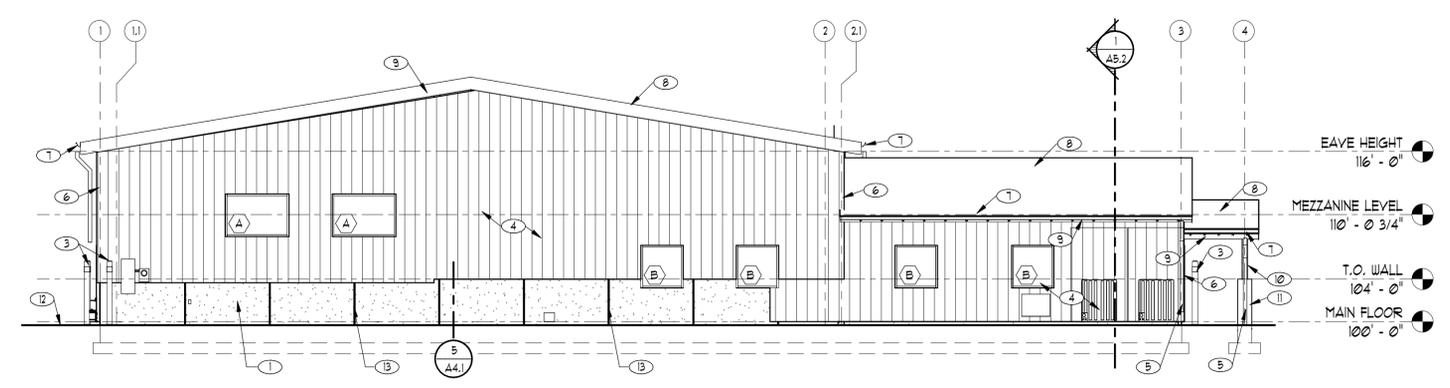


1 NORTH ELEVATION
1/8" x 1'-0"

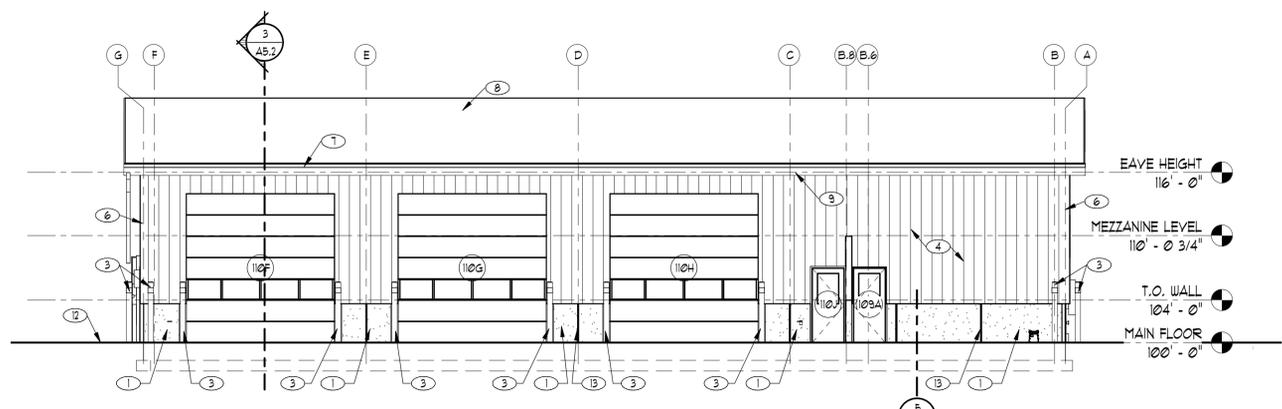

2 EAST ELEVATION
1/8" x 1'-0"

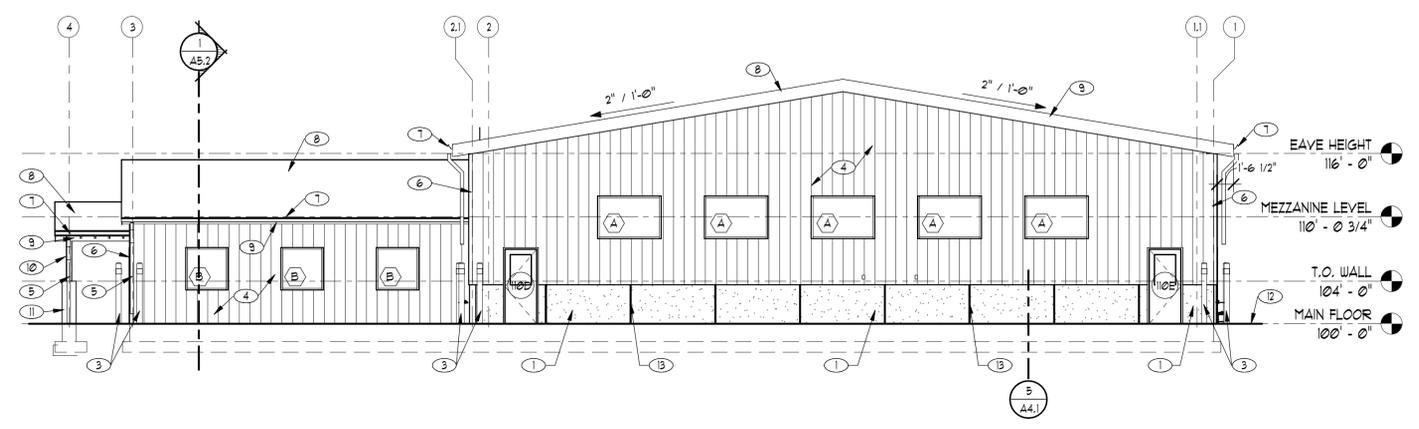

3 SOUTH ELEVATION
1/8" x 1'-0"

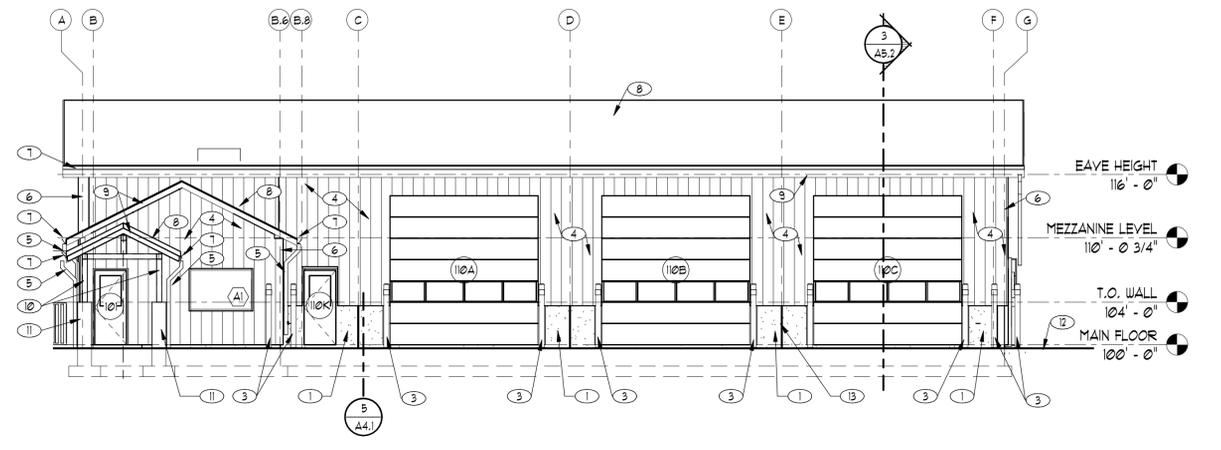

4 WEST ELEVATION
1/8" x 1'-0"

These plans, drawings and designs are the exclusive property of WPA-Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 05.22.2023
Revision:

Alan R. Pouison
Bruce T. Fallon

WPA
Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com


FACILITIES SHOP
SPANISH FORK CITY
433 SOUTH MAIN STREET
SPANISH FORK, UTAH 84660

BID/PERMIT SET - 05.19.2023


A4.1
EXTERIOR ELEVATIONS

SHEET NOTES:

- ◇ TYPICAL REFERENCE FOR CONSTRUCTION TYPE - SEE SHEET A3.1
- TYPICAL REFERENCE FOR DOOR TYPE - SEE SHEET A3.2
- TYPICAL REFERENCE FOR WINDOW TYPE - SEE SHEET A3.3
- ① UNDISTURBED EARTH OR ENGINEERED FILL
- ② CONCRETE FOOTING & FOUNDATION - SEE STRUCTURAL DUG'S
- ③ CONCRETE SLAB OVER GRAVEL BASE - SEE STRUCTURAL DUG'S
- ④ INSULATED METAL PANELS
- ⑤ PRE-FINISHED METAL GUTTER
- ⑥ INSULATED METAL ROOF PANELS
- ⑦ PRE-FINISHED METAL RIDGE CAP
- ⑧ WOOD ROOF JOIST - SEE STRUCTURAL DUG'S
- ⑨ PRE-FINISHED METAL FASCIA
- ⑩ STEEL BEAM - SEE STRUCTURAL DRAWINGS (PAINT)
- ⑪ PRE-FINISHED METAL SOFFIT
- ⑫ GYPSUM BOARD CEILING - SEE REFLECTED CEILING PLAN
- ⑬ 4' X 6' PRE-FINISHED METAL DOWNSPOUT - SEE CIVIL DRAWINGS FOR CONTINUATION
- ⑭ CONC. FILLED PIPE BOLLARD, SEE DETAIL 21A2.1 - PAINT
- ⑮ 1/2" DIA. WOOD HANDRAL - PAINT
- ⑯ 2x STAIR STRINGER - SEE STRUCTURAL DRAWINGS
- ⑰ 3/4" STAIR TREAD & RISER
- ⑱ ONE LAYER 5/8" TYPE 'X' GYPSUM BOARD
- ⑲ OWNER PROVIDED ICE MAKER - N.I.C.
- ⑳ MECHANICAL EQUIPMENT - SEE MECHANICAL DRAWINGS
- ㉑ 2 X 4 @ 16" O.C. CEILING JOISTS w/ 5/8" TYPE 'X' GYPSUM BOARD - PAINT
- ㉒ WOOD FLOOR JOIST - SEE STRUCTURAL DRAWINGS
- ㉓ SINK - SEE PLUMBING DUG'S
- ㉔ STEEL STRUCTURE PROVIDED BY METAL BUILDING MANUFACTURER, TYP.
- ㉕ 2x BLOCKING @ 8'-0" o.c.
- ㉖ ELECTRICAL EQUIPMENT - SEE ELECTRICAL DRAWINGS
- ㉗ STEEL COLUMN PAINT - SEE STRUCTURAL DUG'S
- ㉘ CONCRETE PIER - SEE STRUCTURAL DUG'S
- ㉙ 2x HEADER - SEE STRUCTURAL DRAWINGS
- ㉚ PLASTIC LAMINATE MILLWORK - SEE INTERIOR ELEVATIONS
- ㉛ OWNER PROVIDED REFRIGERATOR - N.I.C.

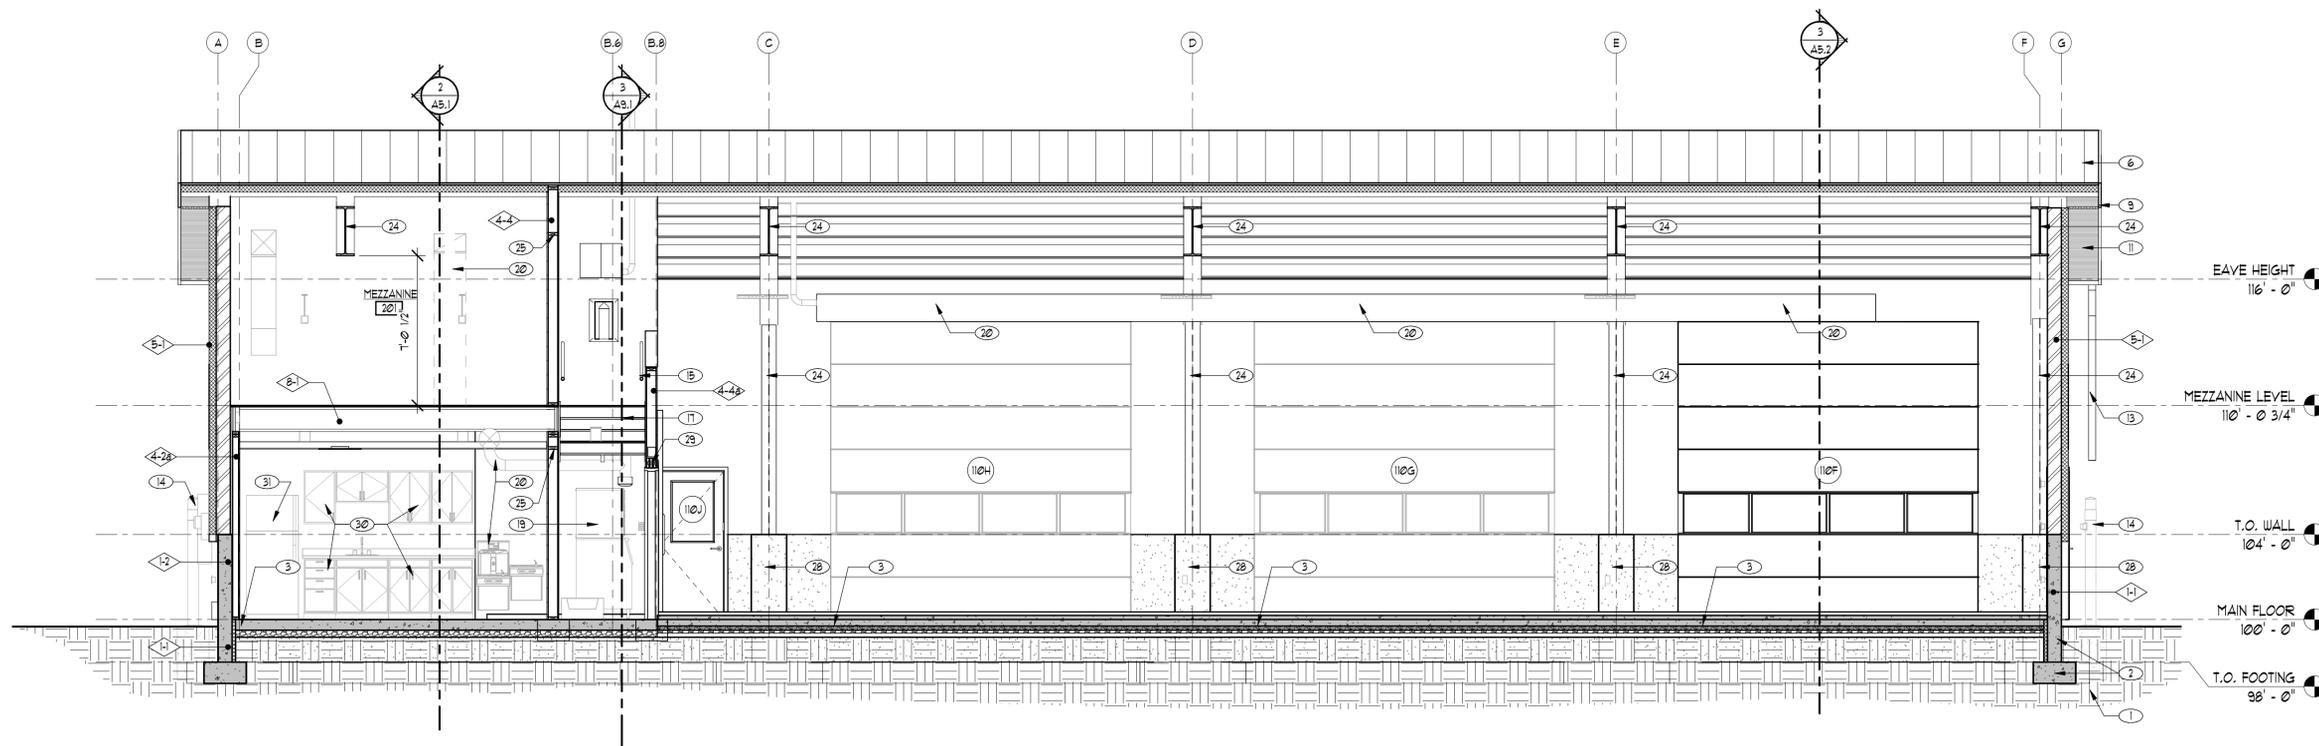

1 BUILDING SECTION 1
1/4" = 1'-0"

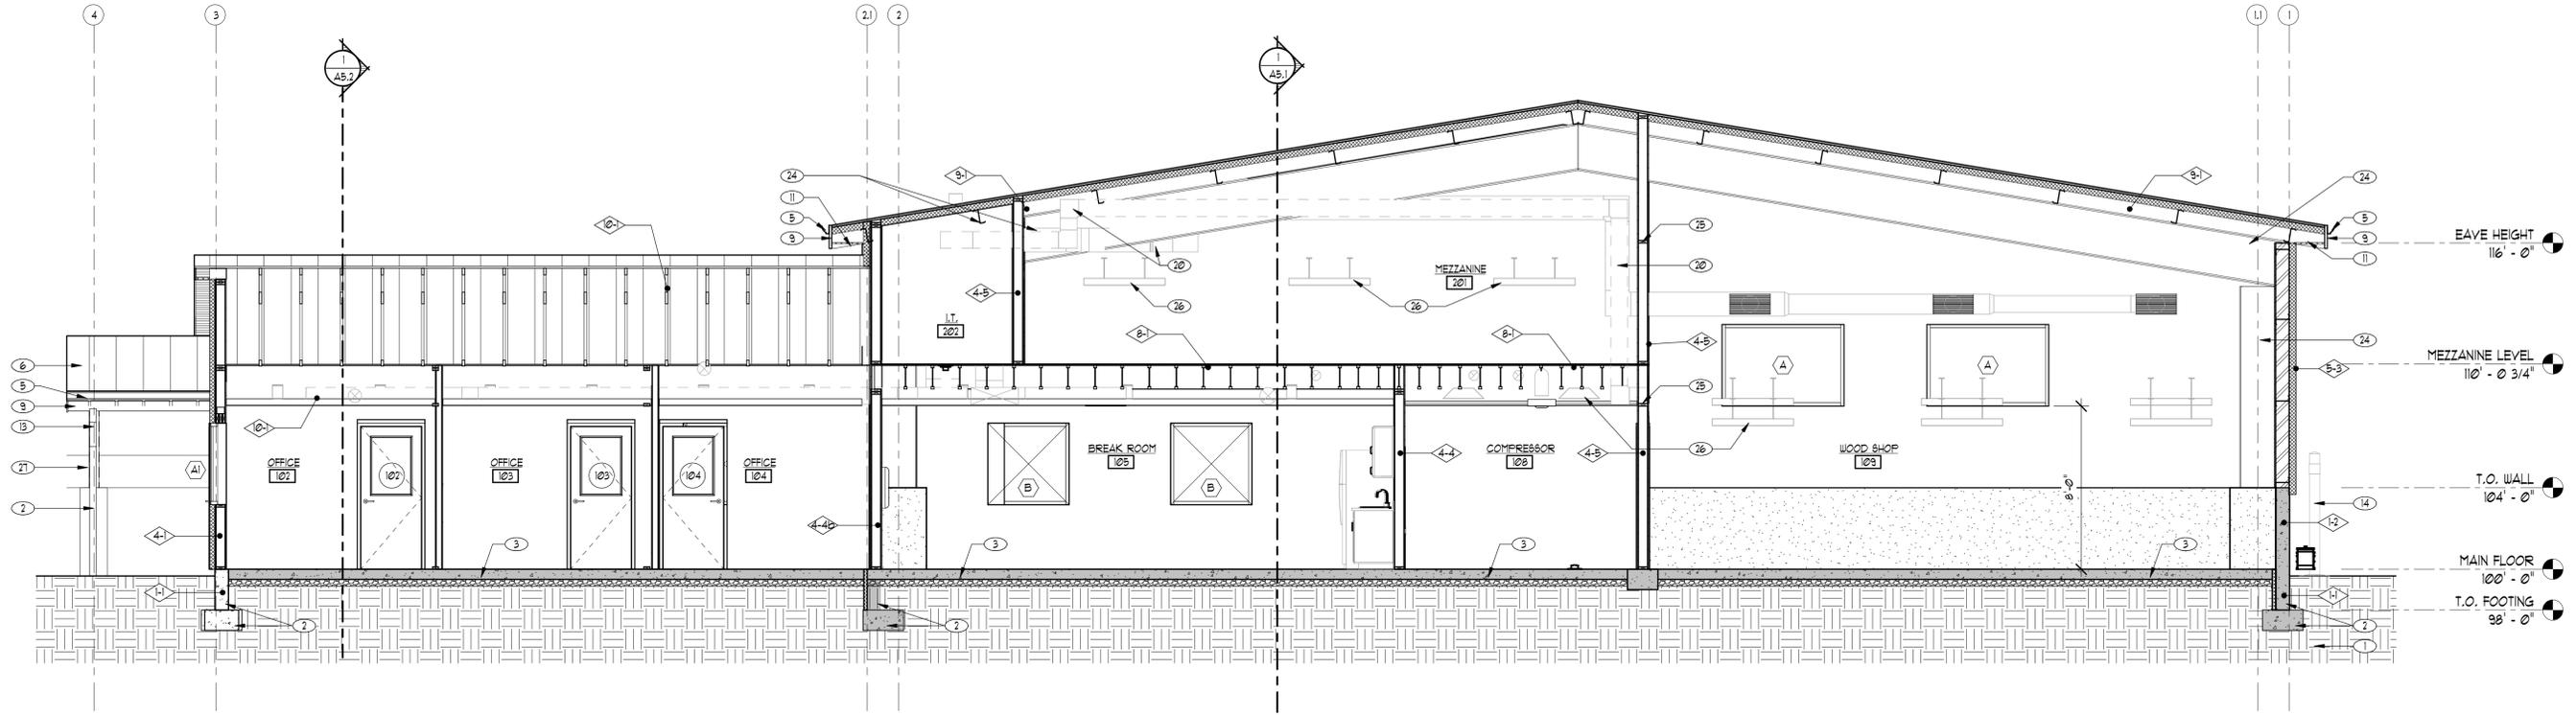

2 BUILDING SECTION 2
1/4" = 1'-0"

These plans, drawings, and designs are the exclusive property of WPA-Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 05.22.2023
Revision:



Alan R. Pouison
Bruce T. Fallon

WPA
Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com



FACILITIES SHOP
SPANISH FORK CITY
433 SOUTH MAIN STREET
SPANISH FORK, UTAH 84660

BID/PERMIT SET - 05.19.2023

A5.1
BUILDING SECTIONS

SHEET NOTES:

- ◇ TYPICAL REFERENCE FOR CONSTRUCTION TYPE - SEE SHEET A3.1
- TYPICAL REFERENCE FOR DOOR TYPE - SEE SHEET A3.2
- TYPICAL REFERENCE FOR WINDOW TYPE - SEE SHEET A3.3
- ① UNDISTURBED EARTH OR ENGINEERED FILL
- ② CONCRETE FOOTING & FOUNDATION - SEE STRUCTURAL DUG'S
- ③ CONCRETE SLAB OVER GRAVEL BASE - SEE STRUCTURAL DUG'S
- ④ INSULATED METAL PANELS
- ⑤ PRE-FINISHED METAL GUTTER
- ⑥ INSULATED METAL ROOF PANELS
- ⑦ PRE-FINISHED METAL RIDGE CAP
- ⑧ WOOD ROOF JOIST - SEE STRUCTURAL DUG'S
- ⑨ PRE-FINISHED METAL FASCIA
- ⑩ STEEL BEAM - SEE STRUCTURAL DRAWINGS (PAINT)
- ⑪ PRE-FINISHED METAL SOFFIT
- ⑫ GYPSUM BOARD CEILING - SEE REFLECTED CEILING PLAN
- ⑬ 4' X 6' PRE-FINISHED METAL DOWNSPOUT - SEE CIVIL DRAWINGS FOR CONTINUATION
- ⑭ CONC. FILLED PIPE BOLLARD, SEE DETAIL 21A.1 - PAINT
- ⑮ 1/2" DIA. WOOD HANDRAIL - PAINT
- ⑯ 2X STAIR STRINGER - SEE STRUCTURAL DRAWINGS
- ⑰ 3/4" STAIR TREAD & RIBBER
- ⑱ ONE LAYER 5/8" TYPE 'X' GYPSUM BOARD
- ⑲ OWNER PROVIDED ICE MAKER - N.I.C.
- ⑳ MECHANICAL EQUIPMENT - SEE MECHANICAL DRAWINGS
- ㉑ 2 X 4 @ 16" O.C. CEILING JOISTS w/ 5/8" TYPE 'X' GYPSUM BOARD - PAINT
- ㉒ WOOD FLOOR JOIST - SEE STRUCTURAL DRAWINGS
- ㉓ SINK - SEE PLUMBING DUG'S
- ㉔ STEEL STRUCTURE PROVIDED BY METAL BUILDING MANUFACTURER, TYP.
- ㉕ 2X BLOCKING @ 8'-0" o.c.
- ㉖ ELECTRICAL EQUIPMENT - SEE ELECTRICAL DRAWINGS
- ㉗ STEEL COLUMN PAINT - SEE STRUCTURAL DUG'S
- ㉘ CONCRETE PIER - SEE STRUCTURAL DUG'S
- ㉙ 2X HEADER - SEE STRUCTURAL DRAWINGS
- ㉚ PLASTIC LAMINATE MILLWORK - SEE INTERIOR ELEVATIONS
- ㉛ OWNER PROVIDED REFRIGERATOR - N.I.C.

These plans, drawings and designs are the exclusive property of WPA-Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 05.22.2023
Revision:



Alan R. Poulsen
Bruce T. Fallon

WPA Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com




FACILITIES SHOP
SPANISH FORK CITY
433 SOUTH MAIN STREET
SPANISH FORK, UTAH 84660


FACILITIES SHOP
SPANISH FORK CITY
433 SOUTH MAIN STREET
SPANISH FORK, UTAH 84660

FACILITIES SHOP
SPANISH FORK CITY
433 SOUTH MAIN STREET
SPANISH FORK, UTAH 84660



A5.2
BUILDING SECTIONS

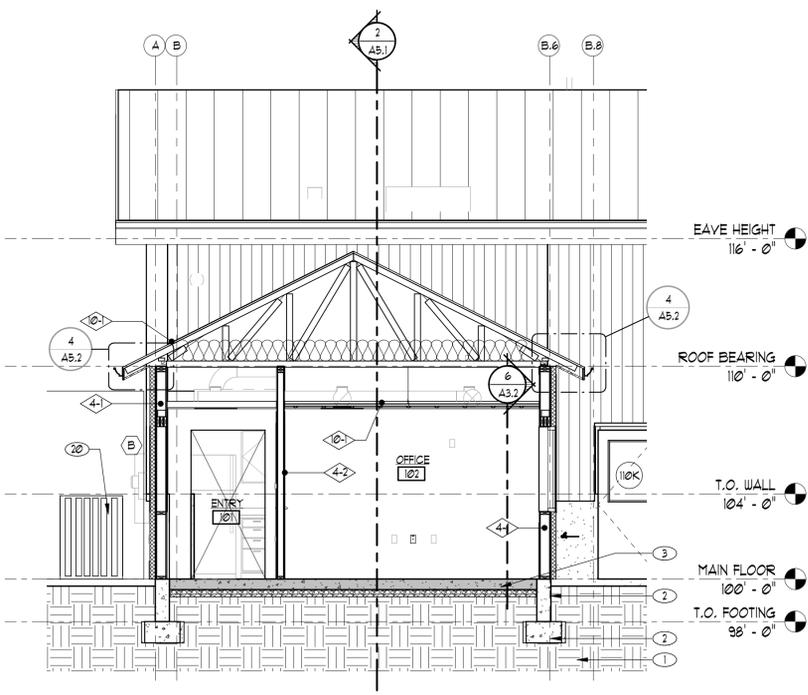


① BUILDING SECTION 3
1/4" = 1'-0"

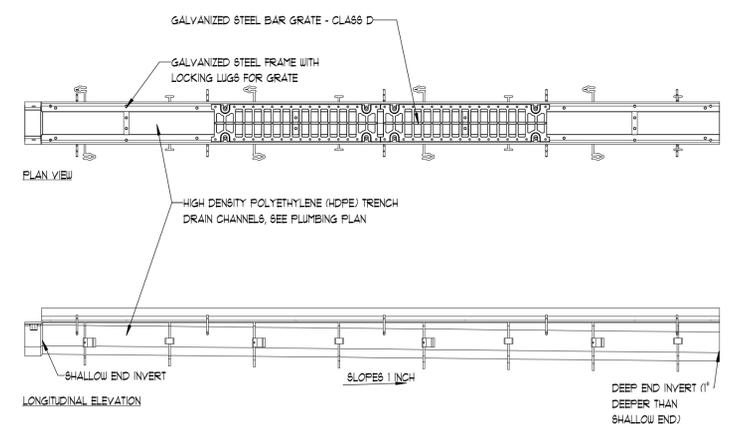

② TRENCH DRAIN
1" = 1'-0"

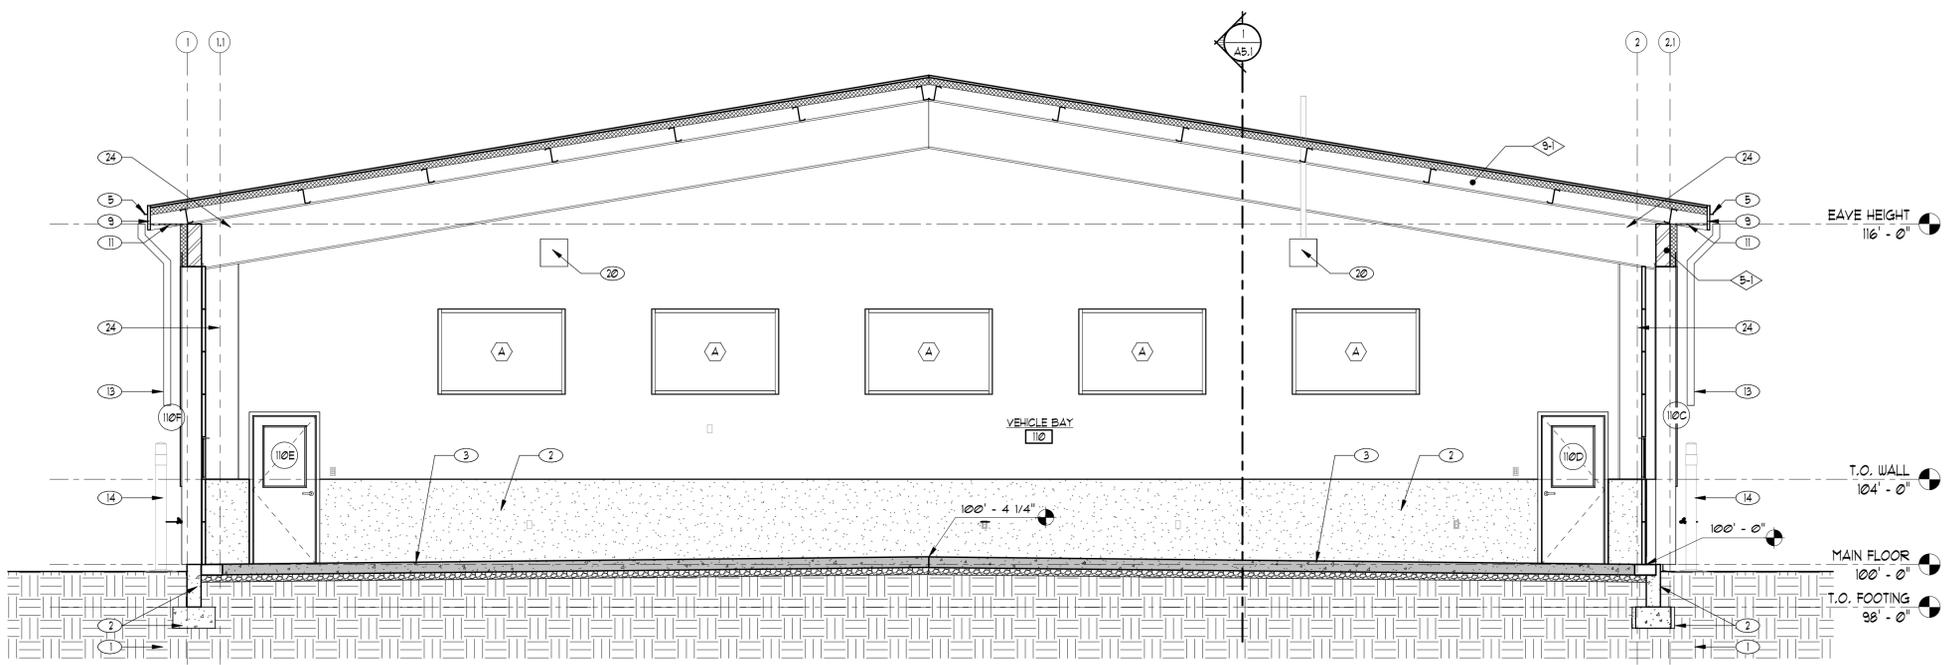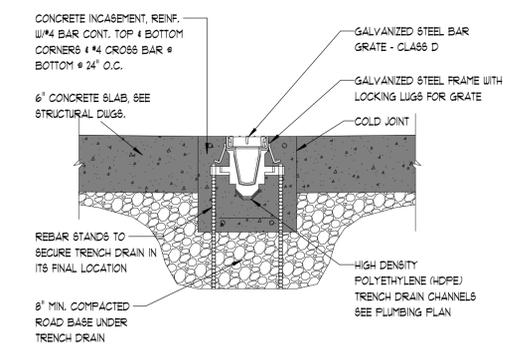

③ BUILDING SECTION 4
1/4" = 1'-0"

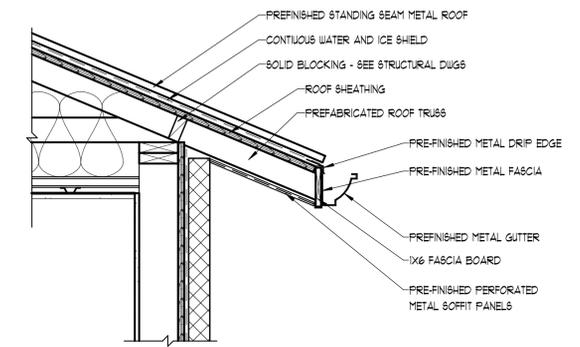


④ EAVE AT STANDING SEAM ROOF
1" = 1'-0"


BID/PERMIT SET - 05.19.2023

SHEET NOTES:

- ◇ TYPICAL REFERENCE FOR CONSTRUCTION TYPE - SEE SHEET A3.1
- TYPICAL REFERENCE FOR DOOR TYPE - SEE SHEET A3.2
- TYPICAL REFERENCE FOR WINDOW TYPE - SEE SHEET A3.3
- ① STANDING BEAM METAL ROOF
- ② PREFINISHED METAL RIDGE CAP
- ③ TWO RAIL SNOW GUARD
- ④ SINGLE RAIL SNOW GUARD
- ⑤ PREFINISHED METAL GUTTER
- ⑥ 4' X 6' PREFINISHED METAL DOWNSPOUT
- ⑦ INSULATED METAL PANEL ROOF SYSTEM
- ⑧ CONTINUOUS RIDGE VENT

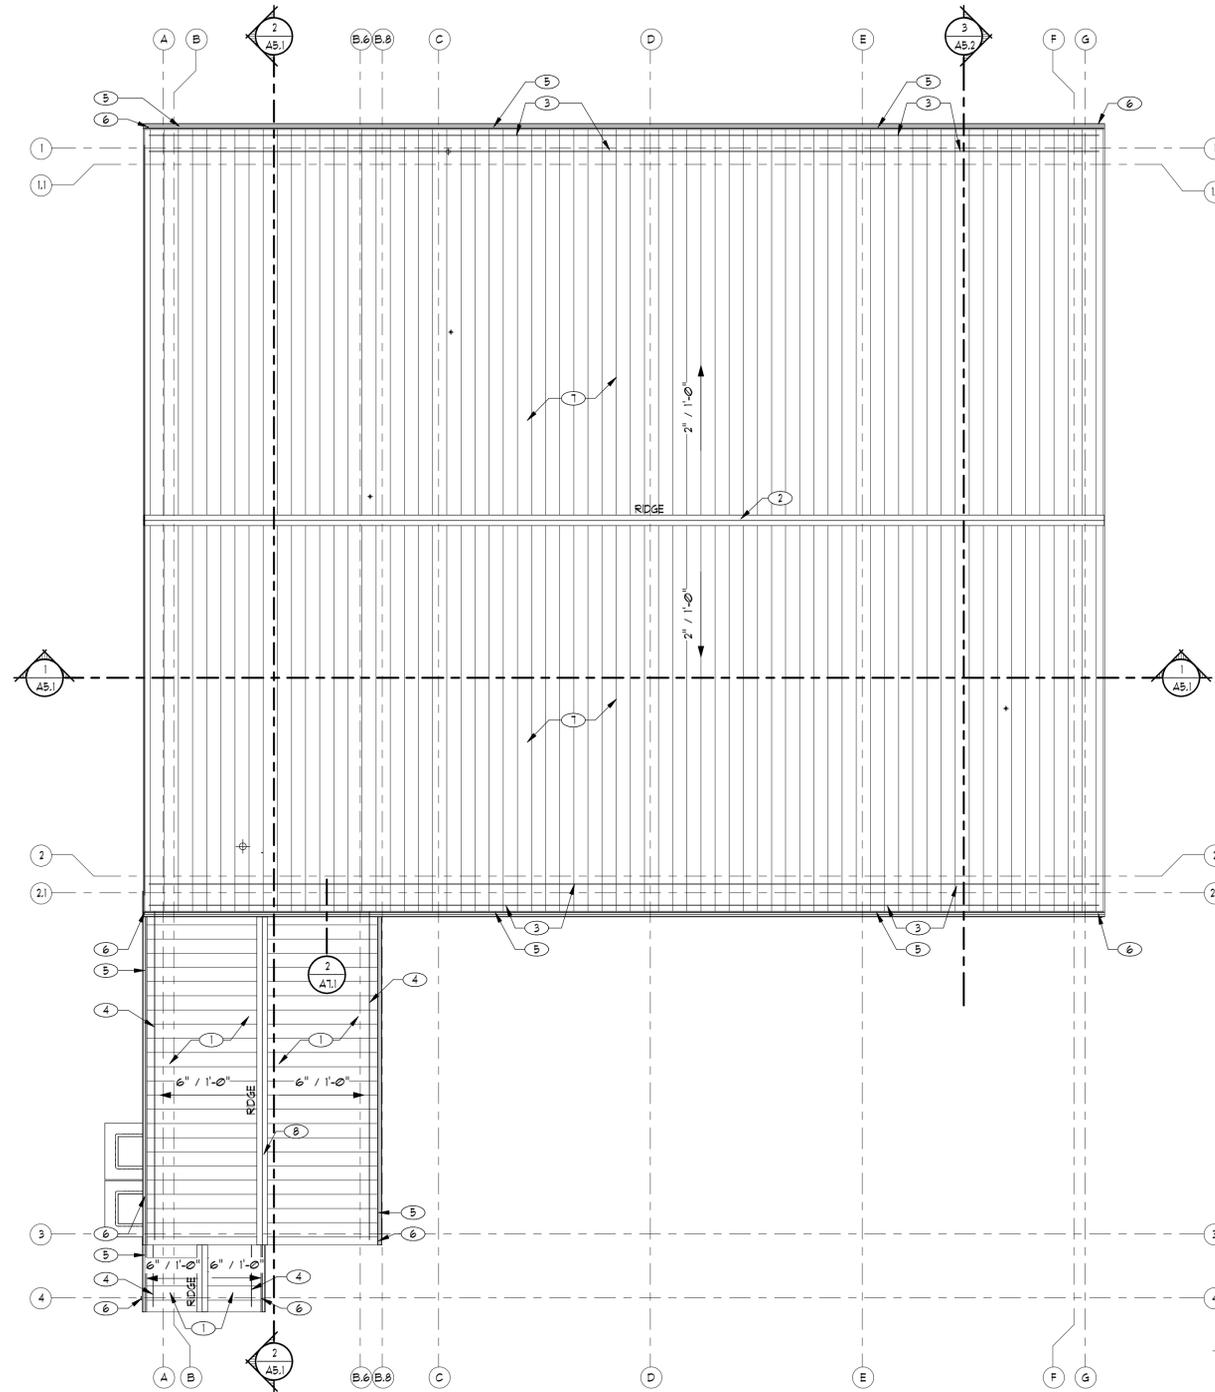

① **ROOF PLAN**
1/8" = 1'-0"

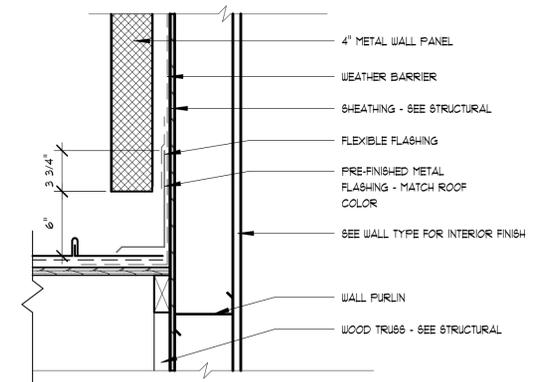

② **ROOF TO WALL DETAIL**
1 1/2" = 1'-0"

These plans, drawings, and designs are the exclusive property of WPA-Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 05.22.2023
Revision:



Alan R. Poulsen
Bruce T. Fallon

WPA
Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

SPANISH FORK, UTAH 84660

FACILITIES SHOP
SPANISH FORK CITY


433 SOUTH MAIN STREET

A7.1
ROOF PLAN


BID/PERMIT SET - 05.19.2023

CEILING LEGEND

-  GYPSUM BOARD CEILING - PAINT
-  OPEN TO STRUCTURE
-  PRE-FINISHED METAL SOFFIT - SEE EXTERIOR FINISH SCHEDULE
-  SUSPENDED LIGHT
-  RECESSED CAN LIGHT
-  RETURN VENT
-  SUPPLY VENT

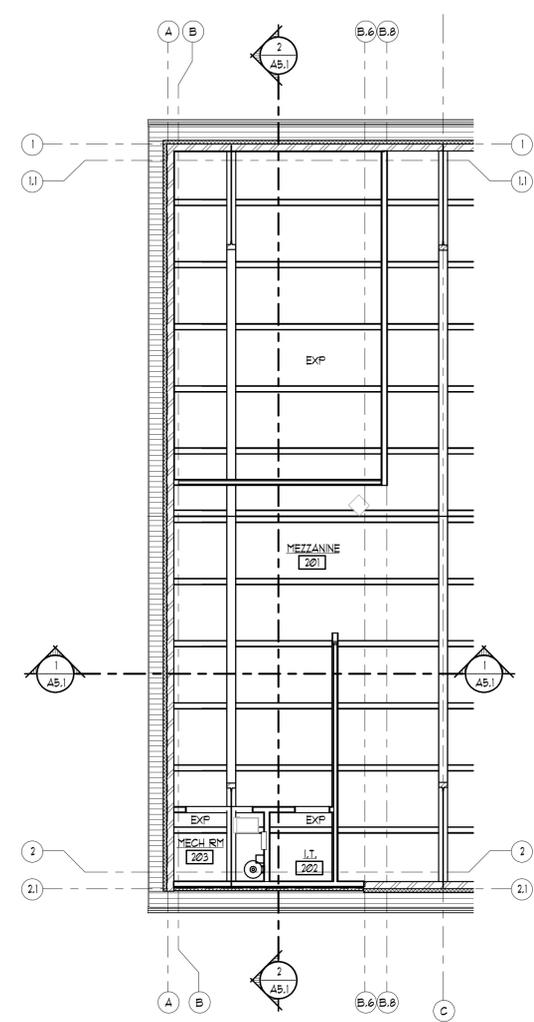

2 MEZZANINE - REFLECTED CEILING PLAN
1/8" = 1'-0"

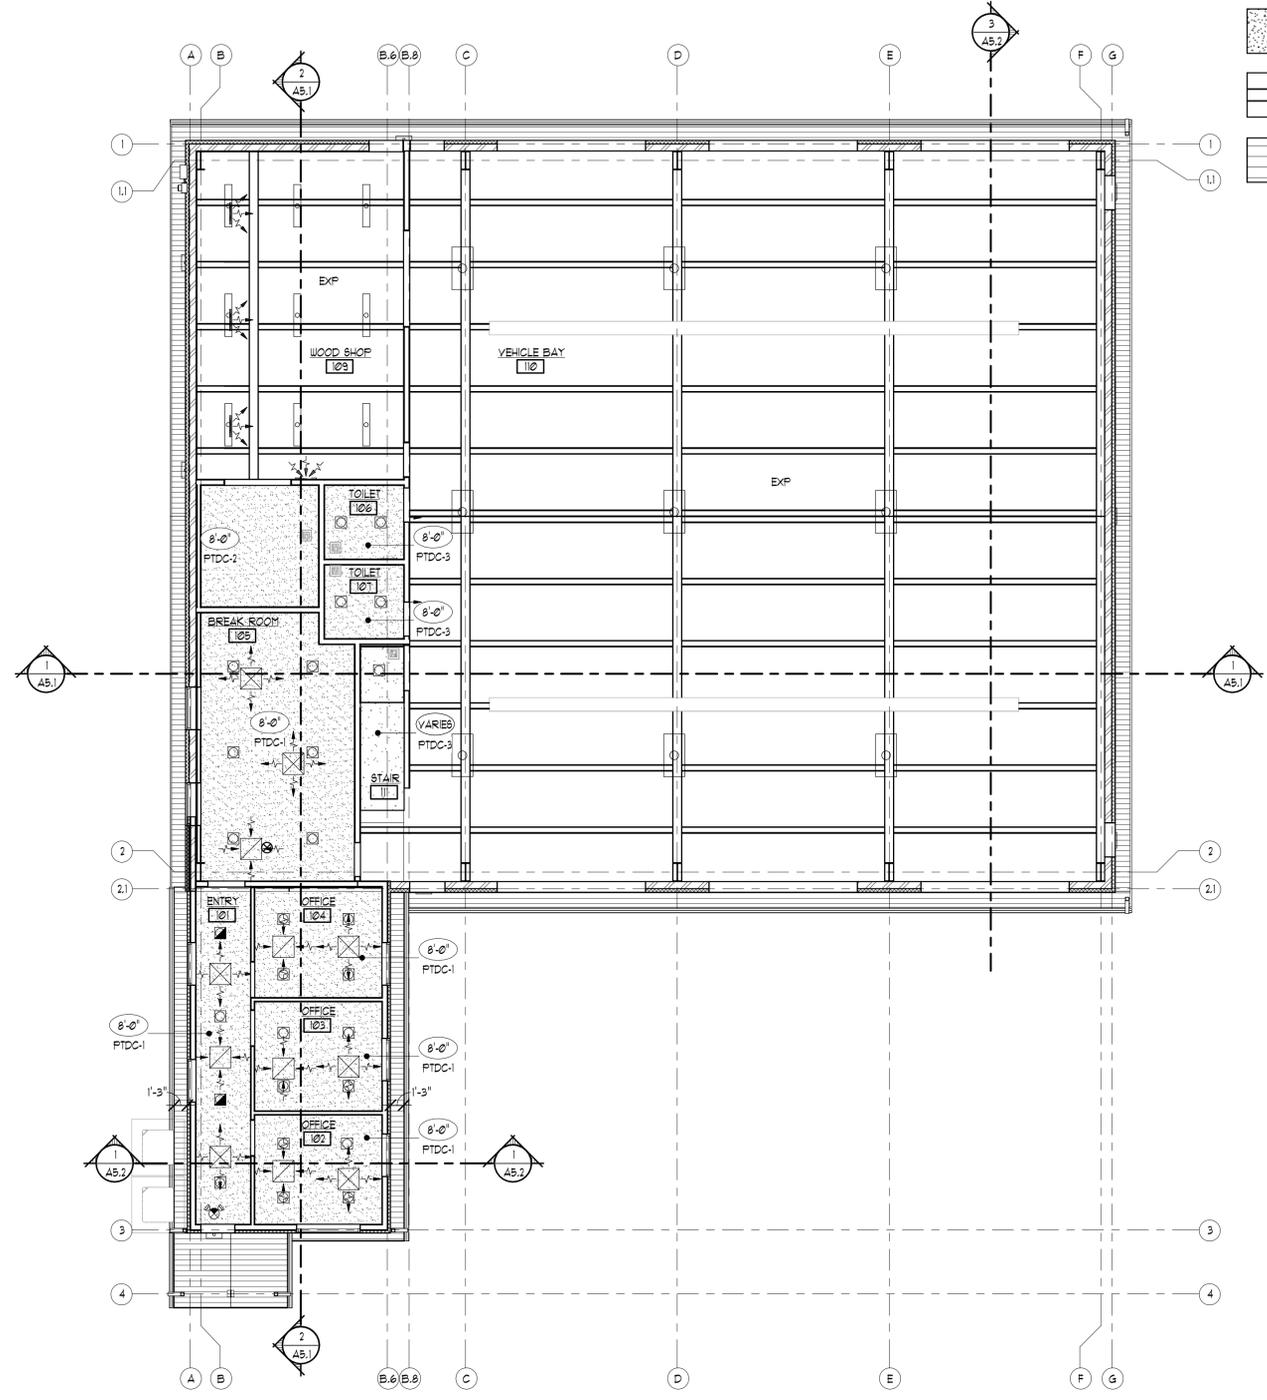

1 MAIN FLOOR REFLECTED CEILING PLAN
1/8" = 1'-0"

These plans, drawings and designs are the exclusive property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 05.22.2023
Revision:



Alan R. Pouison
Bruce T. Fallon



WPA
Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

FACILITIES SHOP


SPANISH FORK CITY

433 SOUTH MAIN STREET
SPANISH FORK, UTAH 84660


A8.1

MAIN FLOOR - REFLECTED CEILING PLAN


BIDDING SET 05/22/2023

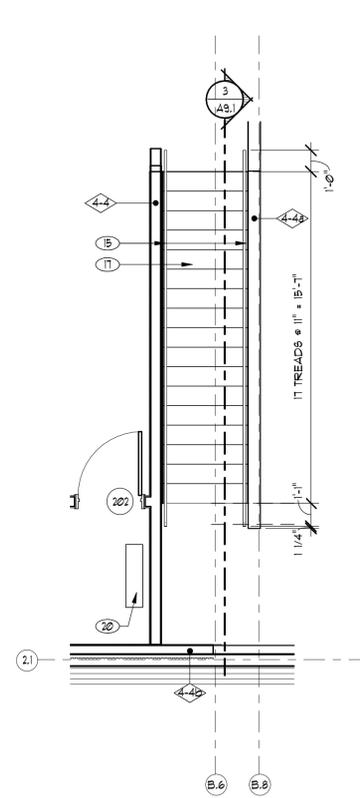

1 STAIR #III MEZZANINE LEVEL
1/4" = 1'-0"

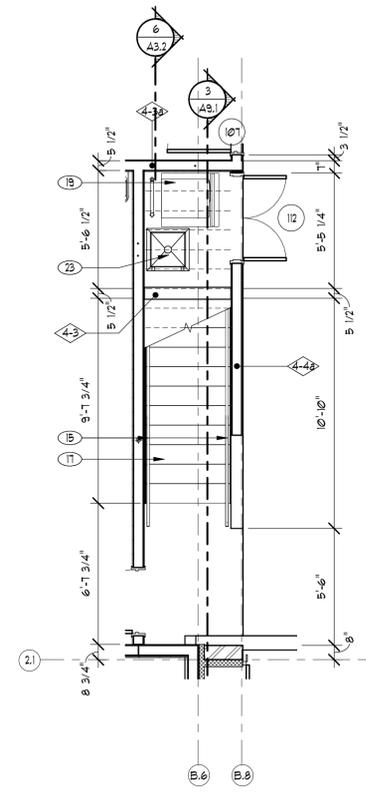

2 STAIR #III MAIN LEVEL
1/4" = 1'-0"

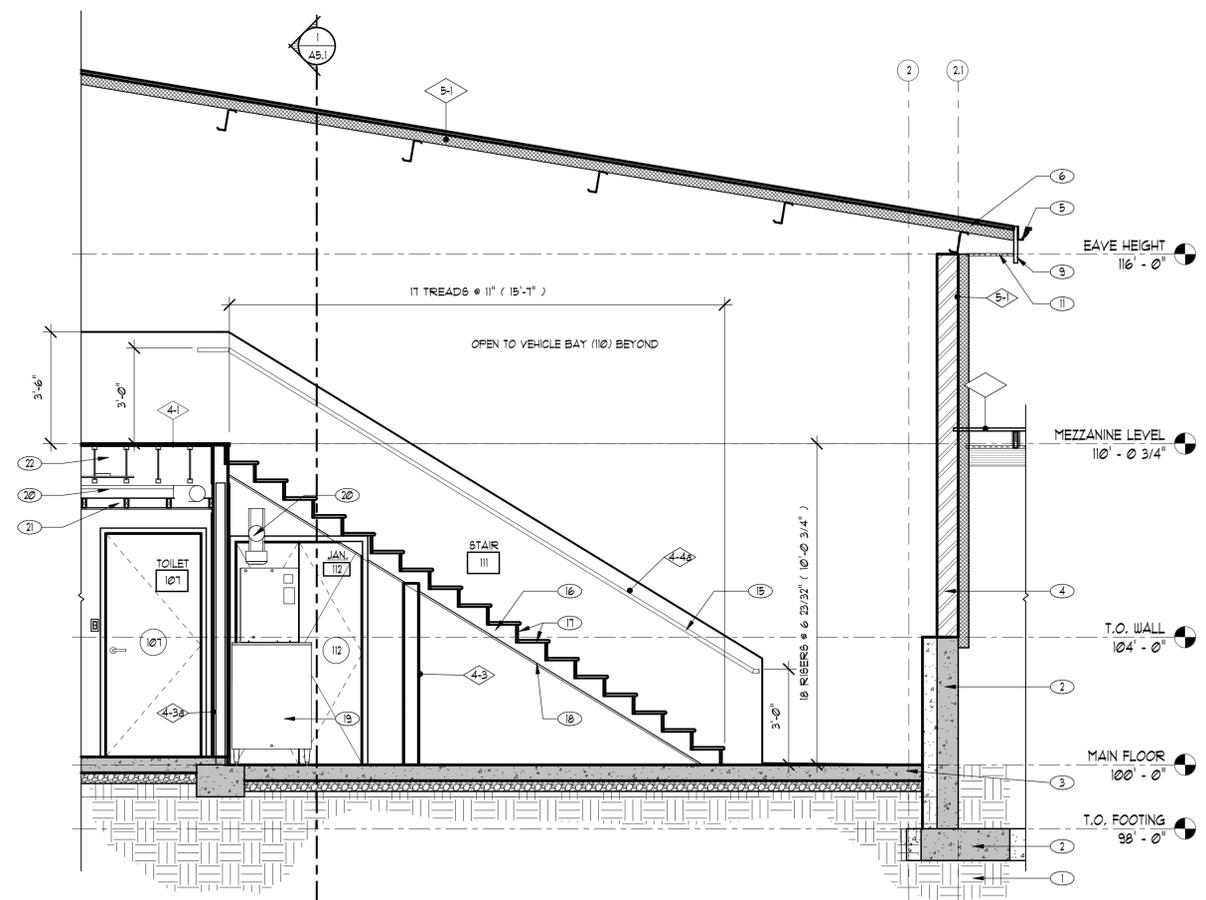

3 STAIR III SECTION
3/8" = 1'-0"

SHEET NOTES:

- ◇ TYPICAL REFERENCE FOR CONSTRUCTION TYPE - SEE SHEET A3.1
- TYPICAL REFERENCE FOR DOOR TYPE - SEE SHEET A3.2
- TYPICAL REFERENCE FOR WINDOW TYPE - SEE SHEET A3.3
- 1 UNDISTURBED EARTH OR ENGINEERED FILL
- 2 CONCRETE FOOTING & FOUNDATION - SEE STRUCTURAL DUG'S
- 3 CONCRETE SLAB OVER GRAVEL BASE - SEE STRUCTURAL DUG'S
- 4 INSULATED METAL PANELS
- 5 PRE-FINISHED METAL GUTTER
- 6 INSULATED METAL ROOF PANELS
- 7 PRE-FINISHED METAL RIDGE CAP
- 8 WOOD ROOF JOIST - SEE STRUCTURAL DUG'S
- 9 PRE-FINISHED METAL FASCIA
- 10 STEEL BEAM - SEE STRUCTURAL DRAWINGS (PAINT)
- 11 PRE-FINISHED METAL SOFFIT
- 12 GYPSUM BOARD CEILING - SEE REFLECTED CEILING PLAN
- 13 4' x 6' PRE-FINISHED METAL DOWNSPOUT - SEE CIVIL DRAWINGS FOR CONTINUATION
- 14 CONC. FILLED PIPE BOLLARD, SEE DETAIL 21A2.1 - PAINT
- 15 1/2" DIA. WOOD HANDRAIL - PAINT
- 16 2x STAIR STRINGER - SEE STRUCTURAL DRAWINGS
- 17 3/4" STAIR TREAD & RISER
- 18 ONE LAYER 5/8" TYPE "X" GYPSUM BOARD
- 19 OWNER PROVIDED ICE MAKER - N.I.C.
- 20 MECHANICAL EQUIPMENT - SEE MECHANICAL DRAWINGS
- 21 2 X 4 @ 16' O.C. CEILING JOISTS w/ 5/8" TYPE "X" GYPSUM BOARD - PAINT
- 22 WOOD FLOOR JOIST - SEE STRUCTURAL DRAWINGS
- 23 SINK - SEE PLUMBING DUG'S
- 24 STEEL STRUCTURE PROVIDED BY METAL BUILDING MANUFACTURER, TYP.
- 25 2x BLOCKING @ 8'-0" o.c.
- 26 ELECTRICAL EQUIPMENT - SEE ELECTRICAL DRAWINGS
- 27 STEEL COLUMN, PAINT - SEE STRUCTURAL DUG'S
- 28 CONCRETE PIER - SEE STRUCTURAL DUG'S
- 29 2x HEADER - SEE STRUCTURAL DRAWINGS
- 30 PLASTIC LAMINATE MILLWORK - SEE INTERIOR ELEVATIONS
- 31 OWNER PROVIDED REFRIGERATOR - N.I.C.

These plans, drawings and designs are the exclusive property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 05.22.2023
 Revision:

Alan R. Pouison
 Bruce T. Fallon

WPA
Architecture
 475 North Freedom Blvd.
 Provo, Utah 84601
 Tel: (801) 374-0800
 info@wpa-architecture.com

SPANISH FORK, UTAH 84660

FACILITIES SHOP
 SPANISH FORK CITY

433 SOUTH MAIN STREET

A9.1
 LARGE SCALE STAIR PLANS AND SECTIONS

BID/PERMIT SET - 05.19.2023

STRUCTURAL GENERAL NOTES

BASIS OF DESIGN

Table with 2 columns: Item description and value. Includes governing building code (2018 IBC), occupancy category (II), load combinations (ASD - GRAVITY AND LATERAL 1605.3.1), gravity design, dead load (20 PSF), live load (125 PSF), roof live load (1500 LBS), wind design (102 MPH), seismic design (ASCE7-16), and lateral design details.

Table with 2 columns: Item description and value. Includes seismic design (ASCE7-16), Ss chart value (1.501 g), SI chart value (0.55 g), site coefficients (1.2), SDS (1.201 g), SD1 (0.55 g), soil site class (E), seismic design category (D), importance factor (1.0), and portion of snow load (0%).

GENERAL

- 1. THE GENERAL CONTRACTOR SHALL:
A. BECOME FAMILIAR WITH ALL PORTIONS OF THE CONTRACT DOCUMENTS AND INSURE THAT ALL SUBCONTRACTORS ARE FAMILIAR WITH THOSE PORTIONS PERTAINING TO THEIR AREA OF WORK.
B. VERIFY ALL DIMENSIONS AND ELEVATIONS. COORDINATE ALL DOORS, WINDOWS, NON-BEARING INTERIOR AND EXTERIOR WALLS, ELEVATIONS, SLOPES, STAIRS, CURBS, DRAINS, RECESSES, DEPRESSIONS, RAILINGS, WATERPROOFING, FINISHES, CHAMFERS, KERFS, ETC.
C. FIELD VERIFY ALL SITE CONDITIONS AND IMMEDIATELY NOTIFY THE ARCHITECT AND STRUCTURAL ENGINEER REGARDING ACTUAL CONDITIONS AT THE SITE WHICH ARE NOT PER THE DRAWINGS.
D. COORDINATE ALL WORK BETWEEN THE VARIOUS TRADES AND SUBCONTRACTORS. REPORT ANY MODIFICATIONS TO THE STRUCTURAL PORTION OF THE BUILDING BY OTHER TRADES TO ARCHITECT AND STRUCTURAL ENGINEER PRIOR TO CONSTRUCTION.
E. BE RESPONSIBLE FOR SAFETY AND PROTECTION IN AND AROUND THE JOB SITE AND/OR ADJACENT PROPERTIES.
F. REPORT PROGRESS OF WORK TO ARCHITECT AND STRUCTURAL ENGINEER.
G. COORDINATE AND VERIFY LOCATIONS AND WEIGHTS OF MECHANICAL UNITS AND/OR OTHER EQUIPMENT OR DEVICES PRIOR TO FABRICATION AND/OR INSTALLATION OF ANY SUPPORTING STRUCTURE.
H. COORDINATE ANY CONSTRUCTION SITUATION NOT COVERED BY THESE PLANS, GENERAL NOTES, OR SPECIFICATIONS WITH THE ARCHITECT AND STRUCTURAL ENGINEER.

- 2. CONTRACT DOCUMENTS:
A. REFER TO THE SPECIFICATIONS FOR INFORMATION NOT COVERED BY THESE GENERAL NOTES OR THE DRAWINGS.
B. DETAILS, SECTIONS AND NOTES SHOWN ON THE STRUCTURAL DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL APPLY TO ALL SIMILAR SITUATIONS ELSEWHERE, UNLESS NOTED OR SHOWN OTHERWISE.
C. THE CONTRACT DOCUMENTS SHALL TAKE PRECEDENCE OVER SHOP DRAWINGS UNLESS SPECIFICALLY NOTED OTHERWISE.
D. INFORMATION ON DRAWINGS INDICATING EXISTING CONDITIONS IS BASED ON BEST PRESENT KNOWLEDGE, BUT MAY NOT BE ENTIRELY ACCURATE AND MUST BE FIELD VERIFIED.

- 3. BUILDING CODE COMPLIANCE:
A. INSPECTION, TESTING, CONSTRUCTION, WORKMANSHIP AND MATERIALS SHALL CONFORM TO THE REQUIREMENTS OF THE GOVERNING BUILDING CODE AND STANDARDS.
B. THE CONTRACTOR SHALL PROVIDE TEMPORARY SHORING AND BRACING TO PROVIDE ADEQUATE VERTICAL AND LATERAL SUPPORT DURING ERECTION.
C. BUILDING WALLS WHICH RETAIN EARTH MUST BE BRACED AT THE TOP. DO NOT BACKFILL UNLESS BRACING IS PROVIDED OR UNTIL THE COMPLETE FLOOR OR ROOF SYSTEM IS IN PLACE.
D. INFORMATION ON DRAWINGS INDICATING EXISTING CONDITIONS IS BASED ON BEST PRESENT KNOWLEDGE, BUT MAY NOT BE ENTIRELY ACCURATE AND MUST BE FIELD VERIFIED.

- 4. CONSTRUCTION SEQUENCE, SHORING, AND BRACING REQUIREMENTS:
A. THE GENERAL CONTRACTOR IS RESPONSIBLE FOR THE METHOD, MEANS, AND SEQUENCE OF ALL STRUCTURAL ERECTION EXCEPT WHEN SPECIFICALLY NOTED OTHERWISE ON THE DRAWINGS.
B. NON-BEARING INTERIOR WALLS SHALL BE ADEQUATELY BRACED TO THE STRUCTURE ABOVE WITH ALLOWANCE FOR DEFLECTION OF THE STRUCTURE ABOVE AND/OR BELOW.
C. UNLESS WALLS WHICH RETAIN EARTH MUST BE BRACED AT THE TOP. DO NOT BACKFILL UNLESS BRACING IS PROVIDED OR UNTIL THE COMPLETE FLOOR OR ROOF SYSTEM IS IN PLACE.
D. INFORMATION ON DRAWINGS INDICATING EXISTING CONDITIONS IS BASED ON BEST PRESENT KNOWLEDGE, BUT MAY NOT BE ENTIRELY ACCURATE AND MUST BE FIELD VERIFIED.

- B. A MINIMUM OF TWO WEEKS SHALL BE ALLOWED FOR THE REVIEW OF ALL SUBMITTALS BY THE ARCHITECT AND STRUCTURAL ENGINEER.
C. REQUESTS FOR SUBSTITUTIONS SHALL BE SUBMITTED TO THE ARCHITECT AND STRUCTURAL ENGINEER IN WRITING. REASONS FOR THE REQUEST AND COST DIFFERENTIALS SHALL BE INCLUDED IN THE REQUESTS.
D. DEFERRED SUBMITTALS:
A. THE FOLLOWING ITEMS REQUIRE DEFERRED SUBMITTALS ARE LISTED BELOW. THESE ITEMS SHALL BE DESIGNED AND FABRICATED BY THE MANUFACTURER ACCORDING TO THE SPECIFICATIONS GIVEN IN THE CONTRACT DOCUMENTS.
B. THESE DEFERRED SUBMITTALS SHALL FIRST BE SUBMITTED TO THE PROJECT ARCHITECT AND/OR ENGINEER FOR REVIEW AND COORDINATION.
C. THE FINAL SUBMITTAL SHALL BE SIGNED AND SEALED BY A PROFESSIONAL ENGINEER LICENSED IN THE STATE IN WHICH CONSTRUCTION WILL OCCUR AND SHALL BE AVAILABLE AT THE JOBSITE THROUGHOUT CONSTRUCTION.

QUALITY ASSURANCE PLAN FOR STRUCTURE

- 1. INSPECTION:
A. THE OWNER SHALL PROVIDE SPECIAL INSPECTION BY QUALIFIED INSPECTORS FOR THE FOLLOWING TYPES OF CONSTRUCTION IN ACCORDANCE WITH IBC, SECTION 1704 AND 1707, THE SPECIFICATIONS, AND THE ATTACHED TABLES INCLUDED IN THESE GENERAL NOTES.
B. ATTACHED TABLE LABELLED REQUIRED VERIFICATION AND INSPECTION OF SOILS. REINFORCED CONCRETE: DURING THE CASTING OF ALL CONCRETE AND TAKING OF ALL TEST SPECIMENS, AND SHALL VERIFY THE PLACEMENT OF ALL REINFORCING.
C. VERIFICATION AND INSPECTION OF CONCRETE/STEEL CONSTRUCTION.
D. POST-INSTALLED ANCHORS: THE FIRST 25 POST-INSTALLED ANCHORS SHALL BE INSPECTED AND 10 PERCENT OF THE REMAINING ANCHORS SHALL BE INSPECTED.

Table with 2 columns: Item description and value. Includes soil report by (CMT ENGINEERING LABORATORIES), soil bearing pressure (1500 PSF), minimum frost cover (30"), lateral soil pressure fluid equivalent density (56 PCF), coefficient of friction (0.45), and soil engineer review details.

SITE PREPARATION

- 1. CLEARING: THE ENTIRE BUILDING SITE SHALL BE SCRAPPED TO REMOVE THE TOPSOIL INCLUDING ALL VEGETATION, DEBRIS, AND DELTERIOUS MATERIAL.
2. PRE-LOADING OF BUILDING FOOTPRINT: SEE SOILS REPORT
3. PROOF ROLLING: THE NATURAL UNDISTURBED SOIL BELOW ALL FOOTINGS SHALL BE PROOF ROLLED PRIOR TO PLACING CONCRETE.
4. COMPACTED STRUCTURAL FILL: SEE SOILS REPORT

CONCRETE

- 1. CODES AND STANDARDS:
A. CONCRETE CONSTRUCTION, WORKMANSHIP, AND MATERIALS SHALL COMPLY WITH THE AMERICAN CONCRETE INSTITUTE (ACI) EDITIONS OF:
I. ACI 301, "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS".
II. ACI 318, "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE", EXCEPT AS MODIFIED BY THE IBC.
III. ACI 347, "RECOMMENDED PRACTICE FOR CONCRETE FORM WORK".
2. MATERIALS:
A. CEMENT SHALL CONFORM TO ASTM C150, TYPE I, II PORTLAND CEMENT.
B. HARD ROCK AGGREGATES SHALL CONFORM TO ASTM C33. LIGHTWEIGHT AGGREGATES SHALL CONFORM TO ASTM C330.
C. WATER SHALL BE POTABLE.
D. AIR ENTRAINMENT SHALL CONFORM TO ASTM C260.
E. FLY ASH, CLASS F POZZOLAN SHALL CONFORM TO ASTM C618.
F. CALCIUM CHLORIDE SHALL NOT BE USED.
G. DEFORMED BAR ANCHORS (DBA) SHALL CONFORM TO ASTM A496.
H. HEADED ANCHOR STUDS (HAS) SHALL CONFORM TO ASTM A108.
I. SILICA FUME (2% TO SUSPENDED PARKING SLABS) SHALL CONFORM TO ASTM C1240

- 3. MIX DESIGNS:
A. ONLY ONE TYPE OF CONCRETE SHALL BE PLACED AT THE SITE AT ANY GIVEN TIME.
B. A MIX DESIGN THAT PRODUCES THE LOWEST SLUMP COMPATIBLE WITH PROPER PLACEMENT SHALL BE USED.
C. CONCRETE MIXES SHALL CONFORM TO THE FOLLOWING:

Table: CONCRETE MIX DESIGN TABLE. Columns: TYPE OF MEMBER, MIN STRENGTH @ 28 DAYS (PSI), MAX W/C (RATIO), DRY WEIGHT (PCF), MAX AGGREGATE SIZE (INCHES), AIR ENTRAINMENT (%), MIN CEMENT PER YARD (LBS), EXPOSURE CLASS. Rows: EXTERIOR MEMBERS (FOOTINGS, WALLS, PIERS, BEAMS, OTHER SITE CONCRETE), INTERIOR SLABS ON GRADE.

- 4. CONSTRUCTION:
A. CONCRETE SHALL BE PROPERLY VIBRATED DURING PLACEMENT.
B. PRIOR TO PLACING CONCRETE, CHECK WITH ALL TRADES TO INSURE PROPER PLACEMENT OF OPENINGS, BLOCK OUTS, SLEEVES, CURBS, CONDUITS, BOLTS, INSERTS, EMBEDS, DOWELS, ETC.
C. CONSTRUCTION JOINTS AND BULKHEADS SHALL BE FORMED WITH A KEY WAY.
D. LIMIT FLY ASH TO 25% OF THE TOTAL CEMENTITIOUS MATERIAL.
E. PEAK AVEL AGGREGATE AND/OR PLASTICIZER MAY BE USED IN CONGESTED AREAS WHEN REQUIRED TO PROPERLY FILL ALL VOIDS AND/OR FOR WORKABILITY.

- 5. SLABS ON GRADE:
A. INTERIOR SLABS ON GRADE SHALL BE A MINIMUM OF 4 INCHES THICK, SHALL BEAR ON A 4 INCH MINIMUM LAYER OF COMPACTED GRAVEL, AND SHALL BE REINFORCED WITH #4 BARS AT 24" O.C. BOTH WAYS.
B. SLABS ON GRADE SHALL BE SUBDIVIDED BY CONSTRUCTION AND/OR CONTRACTION (CONTROL) JOINTS INTO ROUGHLY SQUARES WHOSE SIDES SHALL NOT EXCEED 15 FEET IN EITHER DIRECTION.
C. SEE ARCHITECTURAL FOR EXTERIOR SLABS ON GRADE, TYPICAL, UNLESS NOTED OTHERWISE.

- 6. WALLS:
A. CONCRETE WALLS SHALL BE REINFORCED AS FOLLOWS, UNLESS NOTED OTHERWISE:
WALL THICKNESS (SHEAR WALLS):
VERTICAL REINFORCING (GF 0.0012)
HORIZONTAL REINFORCING (GF 0.002)
B. PLACE VERTICAL REINFORCING IN THE CENTER OF THE WALL (EXCEPT FOR BASEMENT WALLS, RETAINING WALLS, OR WHEN EACH FACE IS SPECIFIED).
C. VERTICAL REINFORCING SHALL BE DOWELED TO CONCRETE FOOTING OR STRUCTURE BELOW AND TO STRUCTURE ABOVE WITH THE SAME SIZE BAR AND SPACING.
D. PROVIDE CORNER BARS AT ALL INTERSECTIONS AND CORNERS. USE SAME SIZE BAR AND SPACING AS THE HORIZONTAL REINFORCING.
E. HORIZONTAL REINFORCING SHALL TERMINATE AT THE ENDS OF WALLS AND AT OPENINGS WITH A STANDARD HOOK.
F. WHEN TWO CURTAINS OF STEEL ARE REQUIRED, THE SPLICES IN THE HORIZONTAL REINFORCING OF EACH CURTAIN SHALL NOT OCCUR AT THE SAME LOCATION.
G. PENETRATIONS THROUGH ANY CONCRETE WALL SHALL BE BUILT INTO THE WALL AS THE WALL IS BEING CONSTRUCTED AND SHALL BE REVIEWED BY THE ARCHITECT AND STRUCTURAL ENGINEER PRIOR TO INSTALLATION.
H. PROVIDE DRAINAGE AT THE BASE OF RETAINING WALLS AND AT THE BASE OF ALL BASEMENT WALLS.

- 7. THE SOILS ENGINEER SHALL REVIEW ALL EXCAVATIONS AND FILL PLACEMENT PRIOR TO PLACING CONCRETE.
8. FABRICATION AND ERECTION:
A. ALL BASE PLATES SHALL BEAR ON NON-SHRINK GROUT. ALL ANCHOR RODS SHALL BE 3/4" DIAMETER MINIMUM WITH HEADED STUDS, AND SHALL HAVE EMBEDMENT AS REQUIRED, 12" MINIMUM.

REINFORCING STEEL

- 1. CODES AND STANDARDS:
A. REINFORCING STEEL SHALL COMPLY WITH:
I. CONCRETE REINFORCING STEEL INSTITUTE "MANUAL OF STANDARD PRACTICE".
II. AMERICAN CONCRETE INSTITUTE "DETAILING MANUAL", ACI 315 (OR SP-66).
2. MATERIALS:
A. REINFORCING STEEL SHALL BE NEW STOCK DEFORMED BARS AND SHALL CONFORM TO ASTM A615, GRADE 60, WITH A DESIGN YIELD STRENGTH OF 60,000 PSI, EXCEPT AS NOTED BELOW.
B. MASONRY JOINT REINFORCING SHALL CONFORM TO ASTM 951 AND SHALL BE MANUFACTURED FROM WIRE WHICH CONFORMS TO ASTM A82.
C. MECHANICAL SPLICE COUPLERS SHALL BE CAPABLE OF DEVELOPING 125% OF THE SPECIFIED STRENGTH OF THE BAR.
3. CONSTRUCTION:
A. REINFORCING SHALL BE DETAILED, BOLSTERED, AND SUPPORTED PER ACI 315.
B. REINFORCING STEEL SHALL BE FREE OF LOOSE FLAY RUST, SCALE, GREASE, OIL, DIRT, AND OTHER MATERIALS WHICH MIGHT AFFECT OR IMPAIR BOND.
C. SPLICES IN CONTINUOUS REINFORCING SHALL BE MADE IN AREAS OF COMPRESSION AND/OR AT POINTS OF MINIMUM STRESS, TYPICAL UNLESS NOTED OTHERWISE.
D. DEFORMED BAR ANCHORS (DBA) SHALL HAVE A MINIMUM OF 30 BAR DIAMETERS EMBEDMENT. TENSION SPICES SHALL BE USED IN CONCRETE WHEN SPECIFICALLY NOTED. USE A CLASS B SPLICE. SPLICES IN TOP BARS IN SUSPENDED SLABS AND BEAMS SHALL BE MADE AT MID SPAN. SPLICES IN BOTTOM BARS IN SUSPENDED SLABS AND BEAMS SHALL BE MADE AT SUPPORTS.

- 4. POST-INSTALLED ANCHORS:
1. EPOXY ANCHORS:
A. THE FOLLOWING EPOXY ADHESIVES SYSTEMS SHALL BE ALLOWED:
FORSYTH CONCRETE
HILTI HIT-HY 200
SIMPSON SET-3G
B. ANCHOR RODS SHALL BE ASTM A-307, THREADED AND GALVANIZED, AND THE DIAMETER AS INDICATED ON PLAN.
C. DOWELS SHALL HAVE A MINIMUM OF 30 BAR DIAMETERS EMBEDMENT. TENSION SPICES SHALL BE USED IN CONCRETE WHEN SPECIFICALLY NOTED. USE A CLASS B SPLICE. SPLICES IN TOP BARS IN SUSPENDED SLABS AND BEAMS SHALL BE MADE AT MID SPAN. SPLICES IN BOTTOM BARS IN SUSPENDED SLABS AND BEAMS SHALL BE MADE AT SUPPORTS.

- E. BENDS SHALL BE MADE COLD. DO NOT USE HEAT. BENDS SHALL BE DONE IN THE FABRICATOR'S SHOP UNLESS SPECIFICALLY NOTED FOR THE FIELD.
F. REINFORCING STEEL IN CONCRETE SHALL BE SECURELY ANCHORED AND TIED IN PLACE PRIOR TO PLACING CONCRETE AND SHALL BE POSITIONED WITH THE FOLLOWING MINIMUM CONCRETE COVER:
CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH: 3" CONCRETE EXPOSED TO EARTH OR WEATHER: #6 AND LARGER: 2" #5 AND SMALLER: 1-1/2"
CONCRETE NOT EXPOSED TO EARTH OR WEATHER: SLABS AND WALLS, #11 AND SMALLER: 3/4" BEAMS AND COLUMNS, MAIN REINFORCING OR TIES: 1-1/2"
SLABS ON GRADE: CENTER OF SLAB
G. REINFORCING STEEL IN MASONRY SHALL BE PLACED PRIOR TO GROUTING AND SHALL BE PLACED, POSITIONED, AND LOCATED ACCORDING TO THE STRUCTURAL DRAWINGS. IT SHALL BE SECURED AGAINST DISPLACEMENT AT INTERVALS NOT TO EXCEED 200 BAR DIAMETERS OR TEN FEET.
H. NO REINFORCING SHALL BE WELDED UNLESS SPECIFICALLY NOTED AS SUCH. USE E90XX ELECTRODES AND ASTM A706 REINFORCING. COMPLY WITH AWS D1.4 REQUIREMENTS.
I. EPOXY COATED REINFORCING BARS SHALL BE USED WHEN SPECIFICALLY NOTED. INCREASE LAP SPLICE LENGTHS AS REQUIRED BY THE IBC AND ACI.

STRUCTURAL STEEL

- 1. CODES AND STANDARDS:
A. STRUCTURAL STEEL DESIGN, FABRICATION, AND ERECTION SHALL COMPLY WITH:
I. THE AMERICAN INSTITUTE OF STEEL CONSTRUCTION (AISC) "SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS (AISC 360-10)", WITH "COMMENTARY".
II. AISC "CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES (AISC 303-10)" EXCLUDING FLOORS AND/OR WALLS SHALL HAVE ADDITIONAL REINFORCING AROUND ALL SIDES OF THE OPENING EQUIVALENT TO THE BARS CUT BY THE OPENING WITH HALF ON EACH SIDE OF THE OPENING OR 2-#5 BARS, WHICHEVER IS GREATER, UNLESS NOTED OTHERWISE. BARS PARALLEL TO THE PRINCIPAL REINFORCING SHALL RUN FULL LENGTH OF THE SPAN. BARS IN THE OTHER DIRECTION SHALL RUN 24 INCHES BEYOND THE EDGE OF THE OPENING OR END WITH A STANDARD HOOK. ALSO PROVIDE 2-#5 X 4-0" DIAGONAL BARS AT EACH CORNER OF EACH OPENING.
B. NO PENETRATION SHALL BE ALLOWED THROUGH ANY CONCRETE BEAM, JOIST, COLUMN, PIER, OR JAMB WITHOUT THE ARCHITECT'S AND STRUCTURAL ENGINEER'S PRIOR WRITTEN APPROVAL. PENETRATIONS SHALL BE RE-ROUTED AS REQUIRED AT THESE LOCATIONS.
C. STRUCTURAL PIPE SHALL CONFORM TO ASTM A53, WITH A MINIMUM YIELD STRENGTH Fy = 35 KSI.
D. HIGH STRENGTH BOLTS SHALL CONFORM TO ASTM A325 (A490), ANCHOR RODS SHALL HAVE HEADED STUDS AND SHALL CONFORM TO ASTM F1554. ALL OTHER BOLTS SHALL CONFORM TO ASTM A307 OR BETTER.
E. HEADED ANCHOR STUDS AND DEFORMED BAR ANCHORS SHALL CONFORM TO THE MANUFACTURER'S SPECIFICATIONS.
F. ALL MEMBERS AND WELDS WHICH HAVE COMPLETE PENETRATION GROOVE WELDS SHALL MEET THE CHARRY V-NOTCH TOUGHNESS IMPACT TEST OF 20 FOOT POUNDS AT 70 DEGREES FAHRENHEIT.

- 2. MATERIALS:
A. STRUCTURAL STEEL WIDE FLANGE SHAPES SHALL CONFORM TO ASTM A992. OTHER STRUCTURAL STEEL SHAPES, PLATES, ANGLES, ETC. SHALL CONFORM TO ASTM A36. RUSSELL STEEL IS NOT PERMITTED.
B. HOLLOW STRUCTURAL SECTIONS SHALL CONFORM TO ASTM A500, GRADE B, WITH A MINIMUM YIELD STRENGTH Fy = 46 KSI.
C. STRUCTURAL PIPE SHALL CONFORM TO ASTM A53, WITH A MINIMUM YIELD STRENGTH Fy = 35 KSI.
D. HIGH STRENGTH BOLTS SHALL CONFORM TO ASTM A325 (A490), ANCHOR RODS SHALL HAVE HEADED STUDS AND SHALL CONFORM TO ASTM F1554. ALL OTHER BOLTS SHALL CONFORM TO ASTM A307 OR BETTER.
E. HEADED ANCHOR STUDS AND DEFORMED BAR ANCHORS SHALL CONFORM TO THE MANUFACTURER'S SPECIFICATIONS.
F. ALL MEMBERS AND WELDS WHICH HAVE COMPLETE PENETRATION GROOVE WELDS SHALL MEET THE CHARRY V-NOTCH TOUGHNESS IMPACT TEST OF 20 FOOT POUNDS AT 70 DEGREES FAHRENHEIT.
3. CONSTRUCTION:
A. FABRICATION SHALL BE DONE IN AN APPROVED FABRICATOR'S SHOP.
B. CAMBER IN BEAMS SHALL BE AS INDICATED ON PLANS.
C. PROVIDE A SHOP COAT OF PAINT ON ALL STEEL ITEMS, EXCEPT AT AREAS OF WELDING AND/OR BOLTING.
D. USE HIGH STRENGTH (8000 PSI) MINIMUM AT 28 DAY), NON-SHRINK, LIQUID EPOXY GROUT WITH ALL STEEL BASE PLATES AND BEARING PLATES. MIX GROUT WITH SAND OR PEAT GRAVEL AS RECOMMENDED BY THE MANUFACTURER. PLACE GROUT AS SOON AS THE MEMBER HAS BEEN PROPERLY POSITIONED AND ALIGNED.
E. WHERE STRUCTURAL STEEL WIDE FLANGE, PIPE, OR HOLLOW STRUCTURAL SECTIONS ARE EMBEDDED IN CONCRETE OR MASONRY AND REINFORCING BARS BUTT TO IT, DEFORMED BAR ANCHORS OR REINFORCING BARS WITH THE SAME SIZE AND SPACING AS THE ADJACENT REINFORCING IN BAR DIAMETERS LONG, SHALL BE WELDED TO THE STRUCTURAL STEEL. THE MANUFACTURER'S WELDING PROCEDURES SHALL BE ADHERED TO.
4. BOLTED CONNECTIONS:
A. STEEL TO STEEL BOLTED CONNECTIONS SHALL BE MADE WITH ASTM A325 HIGH STRENGTH BOLTS AND NUTS UNLESS SPECIFICALLY NOTED OTHERWISE. BOLTS SHALL CARRY THE IDENTIFYING MARK OF THREE (3) RADII LINES.
B. ALL OTHER BOLTED CONNECTIONS SHALL BE MADE WITH BOLTS AND NUTS CONFORMING TO ASTM A307 UNLESS NOTED OTHERWISE.
C. BOLTS SHALL BE 3/4" DIAMETER, TYPICAL, UNLESS NOTED OTHERWISE. STANDARD SPACING SHALL BE 3" O.C. AND STANDARD EDGE DISTANCE SHALL BE 1 1/2", TYPICAL, UNLESS NOTED OTHERWISE.
D. BOLT SHALL BE BEARING TYPE CONNECTIONS WITH THREADS EXCLUDED UNLESS NOTED OTHERWISE.
E. BOLTED CONNECTIONS SHALL BE TIGHTENED AND SHALL HAVE WASHERS AS REQUIRED BY AISC UNLESS NOTED OTHERWISE.
F. ENLARGING OF HOLES SHALL BE ACCOMPLISHED BY MEANS OF REAMING. DO NOT USE A TORCH ON ANY BOLT HOLES.

WELDED CONNECTIONS:

- A. WELDING AND GAS CUTTING SHALL BE DONE PER AWS.
B. WELDERS SHALL BE CURRENTLY CERTIFIED ACCORDING TO AWS. ALL WELDING PROCEDURES SHALL BE PRE-QUALIFIED. WELDERS SHALL FOLLOW WELDING QUALIFICATION TESTS.
C. WELDED CONNECTIONS SHALL BE MADE USING LOW HYDROGEN MATCHING FILLER MATERIAL ELECTRODES, UNLESS NOTED OTHERWISE.
D. WELDS SHALL HAVE THE SLAG REMOVED.
E. FULL PENETRATION WELDS, SHOP OR FIELD, SHALL HAVE BACKER BARS REMOVED, BE BACK GOUGED, AND REWELDED PER AWS TO HAVE FULL PENETRATION WELD.

PRE-ENGINEERED METAL BUILDING

- 1. PRODUCT:
A. THE PRE-ENGINEERED METAL BUILDING SHALL COMPLY WITH THE RECOMMENDATIONS OF THE METAL BUILDING MANUFACTURER'S ASSOCIATION (MBMA).
2. DESIGN:
A. THE METAL BUILDING MANUFACTURER SHALL BE RESPONSIBLE FOR THE DESIGN AND FABRICATION OF THE PRE-ENGINEERED METAL BUILDING.
B. THE PRE-ENGINEERED METAL BUILDING SHALL BE DESIGNED AND STAMPED BY A PROFESSIONAL ENGINEER CURRENTLY LICENSED IN THE STATE OF UTAH.
C. THE PRE-ENGINEERED METAL BUILDING SHALL BE DESIGNED TO MEET OR EXCEED THE DESIGN LOADS IN THE BASIS OF DESIGN SECTION OF THESE GENERAL NOTES.
D. ALL COLUMNS, BASE PLATES, AND ANCHOR BOLTS SHALL BE DESIGNED AND PROVIDED BY THE METAL BUILDING MANUFACTURER. ANCHOR BOLT CAPACITY SHALL BE BASED ON BOLT TO CONCRETE CONNECTION, NOT ON STEEL STRENGTH ALONE.
E. SHOP DRAWINGS AND CALCULATIONS SHALL INDICATE THE DESIGN LOADS, THE LOAD COMBINATIONS, AND THE MAXIMUM REACTIONS TO THE FOUNDATIONS.
F. FOOTINGS AND FOUNDATIONS SHOWN ON THE DRAWINGS MAY VARY DEPENDING ON THE FINAL DESIGN REACTIONS PROVIDED IN THE CALCULATIONS. THEREFORE, THE SHOP DRAWINGS AND CALCULATIONS MUST BE SUBMITTED, REVIEWED, AND RETURNED PRIOR TO CASTING ANY FOOTINGS AND/OR FOUNDATIONS AND BEFORE REINFORCING STEEL IS FABRICATED.

- 3. FABRICATION AND ERECTION:
A. ALL BASE PLATES SHALL BEAR ON NON-SHRINK GROUT. ALL ANCHOR RODS SHALL BE 3/4" DIAMETER MINIMUM WITH HEADED STUDS, AND SHALL HAVE EMBEDMENT AS REQUIRED, 12" MINIMUM.

- 4. POST-INSTALLED ANCHORS:
1. EPOXY ANCHORS:
A. THE FOLLOWING EPOXY ADHESIVES SYSTEMS SHALL BE ALLOWED:
FORSYTH CONCRETE
HILTI HIT-HY 200
SIMPSON SET-3G
B. ANCHOR RODS SHALL BE ASTM A-307, THREADED AND GALVANIZED, AND THE DIAMETER AS INDICATED ON PLAN.
C. DOWELS SHALL HAVE A MINIMUM OF 30 BAR DIAMETERS EMBEDMENT. TENSION SPICES SHALL BE USED IN CONCRETE WHEN SPECIFICALLY NOTED. USE A CLASS B SPLICE. SPLICES IN TOP BARS IN SUSPENDED SLABS AND BEAMS SHALL BE MADE AT MID SPAN. SPLICES IN BOTTOM BARS IN SUSPENDED SLABS AND BEAMS SHALL BE MADE AT SUPPORTS.

WOOD

- 1. CODES AND STANDARDS:
A. WOOD CONSTRUCTION SHALL COMPLY WITH:
I. THE AMERICAN FOREST & PAPER ASSOCIATION "NATIONAL DESIGN SPECIFICATION", APPENDS.
II. THE GRADING REQUIREMENTS OF THE WESTERN WOODS PRODUCTS ASSOCIATION, WWPA.
2. MATERIALS:
A. STRUCTURAL LUMBER SHALL BE AS FOLLOWS AND SHALL BE CLEARLY MARKED AS TO SPECIES AND GRADE:
I. JOISTS, BEAMS OR HEADERS - DOUGLAS FIR-LARCH #2 OR BETTER.
II. POSTS AND COLUMNS - DOUGLAS FIR-LARCH #1 OR BETTER.
III. STUDS - DOUGLAS FIR-LARCH #2 OR BETTER. STUD GRADE AND STANDARD GRADE ARE NOT ALLOWED.
B. MANUFACTURED JOISTS SHALL BE AS PER THE DRAWINGS UNLESS OTHERWISE APPROVED BY THE ARCHITECT AND STRUCTURAL ENGINEER PRIOR TO BIDDING. ALTERNATE JOIST MANUFACTURERS PRODUCTS ARE ACCEPTABLE PROVIDED THE SECTION PROPERTIES, DESIGN PARAMETERS, AND LOADING CAPACITIES OF THE SPECIFIED PRODUCT ARE MET OR EXCEEDED.
C. STRUCTURAL GLUED-LAMINATED TIMBER SHALL BE MANUFACTURED AND IDENTIFIED PER AITC A190-1 AND ASTM D 3737. IT SHALL BE 24F-V4 FOR SIMPLE SPANS AND 24F-V8 FOR CONTINUOUS SPANS OR CANTILEVERED BEAMS AND CLEARLY MARKED, MEETING THE GRADE REQUIREMENTS AS DEFINED BY THE IBC.
D. STRUCTURAL LAMINATED VENEER-LUMBER (LVL) SHALL CONFORM TO THE FOLLOWING MINIMUM DESIGN PARAMETERS:
Fb = 2,600 PSI
Fv = 285 PSI
E = 2,000,000 PSI
G. WOOD STRUCTURAL PANELS SHALL BE EXPOSURE 1 (GRADE OR BETTER) P.A. RATED SHEATHING WITH EXTERIOR GLUE AND SHALL CONFORM TO STANDARD PS 1-07, OR PS 2-04.
H. WOOD CONNECTORS SHALL BE SIMPSON STRONG-TIE UNLESS OTHERWISE APPROVED BY THE ARCHITECT AND STRUCTURAL ENGINEER PRIOR TO BIDDING.
I. WOOD JOISTS AND BEAMS SHALL BE DESIGNED AND STAMPED BY A PROFESSIONAL ENGINEER CURRENTLY LICENSED IN THE STATE IN WHICH CONSTRUCTION WILL OCCUR.

- 3. CONSTRUCTION:
A. ROOF AND FLOOR JOISTS SHALL BE AS NOTED ON THE PLANS. ALL JOISTS SHALL BE LATERALLY SUPPORTED AT THE ENDS BY SOLID BLOCKING AND/OR A METAL HANGER.
B. MANUFACTURED JOISTS SHALL BE ERECTED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AND SHALL BE DESIGNED TO SUPPORT THE MAXIMUM LOADS INDICATED IN THE MANUFACTURER'S PUBLISHED LOAD TABLES.
C. PROVIDE APPROVED BRIDGING AT 8'-0" O.C. MAXIMUM SPACING FOR ALL DIMENSIONAL LUMBER, LVL, PSL, AND LSL JOISTS. PROVIDE BRIDGING IN ALL OTHER MANUFACTURED JOISTS PER THE MANUFACTURER'S RECOMMENDATIONS UNLESS OTHERWISE SHOWN ON PLAN.
D. HOLES IN WOOD CONNECTORS (FRAMING ANCHORS, JOIST HANGERS, PURLIN ANCHORS, ETC.) MUST BE FILLED WITH NAILS AS SPECIFIED BY THE MANUFACTURER, TYPICAL, UNLESS NOTED OTHERWISE.
E. BOLTS THRU WOOD SHALL HAVE WASHERS UNDER NUTS. ALL BOLTS HOLES SHALL BE 1/32 TO 1/16 INCH LARGER THAN BOLTS. NUTS SHALL BE TIGHTENED SNUGLY, BUT NOT SO TIGHT AS TO CAUSE CRUSHING OF THE WOOD. DO NOT COUNTERSINK BOLTS UNLESS SPECIFICALLY NOTED.
F. NAILING OF MEMBERS SHALL CONFORM TO THE FASTENING SCHEDULE IN THE IBC, TABLE 2304.9.1 UNLESS NOTED OTHERWISE.
G. EDGE NAILING BETWEEN PANELS OF SHEATHING SHALL OCCUR ALONG A SINGLE COMMON BACK UP MEMBER. SHEATHING SHALL BE EDGE NAILED TO ALL MEMBERS ATTACHED TO DRAG STRUTS, HOLD DOWNS, FLOOR TIE ANCHORS, ETC.
H. CORNERS AND INTERSECTIONS OF SHEATHING SHALL BE BOLTED INTEGRALLY. THE SHEATHING FROM EACH WALL SHALL BE EDGE NAILED TO A COMMON BACK UP MEMBER.
I. SILL PLATES FOR SHEAR WALLS SHALL BE 2X MATERIAL (5X WHEN SPECIFIED), AND ANCHOR BOLTS SHALL HAVE A 3"x3" SIMPSON BPS 58-6 ANCHOR BOLT PLATE OR EQUAL WHICH SHALL BE INSTALLED A MAXIMUM OF 1/2" FROM THE WOOD STRUCTURAL PANEL FACE OF THE WALL.
J. LAMINATED BUILT-UP BEAMS OF 2X _ MEMBERS 10" DEEP OR LESS SHALL BE NAILED TO THE MEMBER WITH NOT LESS THAN 12" O.C. STAGGERED. USE 2X COMMON NAILS AT ALL SUPPORTS. 2X _ MEMBERS DEEPER THAN 10" SHALL BE BOLTED TOGETHER WITH 1/2" BOLTS AT 16" O.C. STAGGERED WITH 2 BOLTS AT SUPPORTS.
K. SPLIT RINGS SHALL BE TECO SPLIT RINGS AS MANUFACTURED BY THE _ TIMBER ENGINEERING COMPANY UNLESS OTHERWISE APPROVED BY THE ARCHITECT AND ENGINEER PRIOR TO BIDDING. SPLIT RINGS SHALL BE MANUFACTURED FROM HOT ROLLED S & E - 1010 CARBON STEEL. EACH RING SHALL FORM A CLOSED TIGHT CIRCLE WITH THE PRINCIPAL AXIS OF THE CROSS SECTION OF THE RING PARALLEL TO THE GEOMETRIC AXIS OF THE RING. THE RING SHALL FIT SNUGLY IN THE PREPARED GROOVE. GROOVES FOR SPLIT RINGS SHALL NOT BE GREATER THEN 1/16" DEEPER THAN REQUIRED. DEPTH OF GROVE SHALL BE EQUAL ON BOTH WOOD MEMBERS.

PRE-FABRICATED WOOD TRUSSES

- 1. PRODUCT:
A. PRE-FABRICATED WOOD TRUSSES SHALL BE DESIGNED AND FABRICATED IN ACCORDANCE WITH THE REQUIREMENTS OF THE TRUSS PLATE INSTITUTE (TPI). ALL METAL GUSSET PLATES SHALL BE GALVANIZED AND SHALL BE DESIGNED AND MANUFACTURED AS APPROVED BY THE RESEARCH COMMITTEE FOR THE ICBOT.
2. DESIGN:
A. THE TRUSS MANUFACTURER SHALL BE RESPONSIBLE FOR THE DESIGN AND FABRICATION OF THE PRE-FABRICATED WOOD TRUSSES.
B. ALL PRE-FABRICATED WOOD TRUSSES SHALL BE DESIGNED AND STAMPED BY A PROFESSIONAL ENGINEER CURRENTLY LICENSED IN THE STATE OF UTAH.
C. THE TRUSSES SHALL BE DESIGNED TO SUPPORT THE FOLLOWING UNIFORM LOADS:
DEAD LOAD (TOP CHORD) 15 PSF
DEAD LOAD (BOTTOM CHORD) 5 PSF
LIVE LOAD-SNOW (TOP CHORD) 30 PSF
LIVE LOAD (BOTTOM CHORD) 10 PSF (NON-CONCURRENT)
TOTAL LOAD 50 PSF
THEY SHALL BE DESIGNED FOR THE WIND LOADS SHOWN IN THE BASIS OF DESIGN SECTION OF THESE GENERAL NOTES. THEY SHALL ALSO BE DESIGNED IN ACCORDANCE WITH SNOW DRIFT REQUIREMENTS OF THE IBC AND ASCE7, FOR UNBALANCED LOADS, LOWER ROOFS, OVERHANGS, VALLEYS, RIDGES, GABLES, ETC.
D. THE EFFECTS OF ECCENTRIC LOADING SHALL BE CONSIDERED IN THE DESIGN OF JELT JOINTS.
E. TRUSS TO TRUSS CONNECTIONS SHALL BE DESIGNED BY THE TRUSS MANUFACTURER.

- 3. FABRICATION:
A. TRUSSES SHALL BE FABRICATED IN JOGS WITH LUMBER ACCURATELY CUT TO PROVIDE FULL BEARING AT ALL JOINTS.
B. LUMBER SHALL BE #2 DOUGLAS FIR OR BETTER.
C. LUMBER SHALL BE KILN DRIED.
D. POSITION ALL MEMBERS AS SHOWN ON THE DRAWINGS, MAINTAINING THE TRUSS CONFIGURATION, MEMBER SIZE AND CALCULATED STRESSES FOR EACH MEMBER AS DETAILED.
E. METAL GUSSET PLATES SHALL BE PRESSED INTO MEMBERS TO OBTAIN FULL PENETRATION WITHOUT CRUSHING THE OUT SIDE SURFACES OF THE WOOD.
F. PLATES SHALL BE BALANCED ON THE JOINT AS THE STRESSES REQUIRE AND SHALL HAVE A MINIMUM BITE OF 3" LENGTH ON ALL MEMBERS. THE MINIMUM SIZE FOR ANY CONNECTOR SHALL BE 16 SQUARE INCHES.
G. EACH CONNECTOR SHALL BE DIMENSIONED ON THE SHOP DRAWINGS AS TO THE EXACT LOCATION FOR EACH JOINT.
H. A STRESS INCREASE FOR THE VALUE OF A METAL CONNECTOR FOR DURATION OF LOADING OR OTHER FACTORS WILL NOT BE ALLOWED.
I. FOR TRUSSES OTHER THAN SCISSOR TRUSSES - SIZE PLATES, NAIL AND STEEL SECTION, FOR 160 PERCENT OF MEMBER FORCE. FOR SCISSOR TRUSSES - SIZE PLATES, NAIL AND STEEL SECTION, FOR 160 PERCENT OF MEMBER FORCE.

- 4. ERECTION:
A. ROOF TRUSSES SHALL BE BRACED IN ACCORDANCE WITH THE "LATERAL BRACING REQUIREMENTS" OF THE TRUSS PLATE INSTITUTE (TPI).
B. TRUSS TO TRUSS TRUSSES ARE USED. THEY SHALL BE CONNECTED TOGETHER PER THE MANUFACTURER'S RECOMMENDATIONS.

BID/PERMIT SET - 05.19.2023
FACILITIES SHOP
SPANISH FORK CITY
433 South Main Street
Spanish Fork, UT 84660
Tel: (801) 374-0800
info@wpa-architecture.com
WPA Architecture Inc.
475 North Freedom Blvd.
Provo, Utah 84601
Date: 3/14/2023
Revision:
ALAN R. POULSON
BRUCE T. FALLON
WPA ARCHITECTURE INC.
11400 SOUTH 1000 WEST
SUITE 100
PROVO, UTAH 84601
(801) 374-0800
www.wpa-arch.com



CONCRETE FOOTING SCHEDULE						BEARING PRESSURE = 1500 PSF
MARK	WIDTH	LENGTH	THICK	BOTTOM REINFORCING	TOP REINFORCING	NOTES
F-4	4'-0"	4'-0"	12"	(4) #5 E.W.	-	-
F-5	5'-0"	5'-0"	12"	(5) #5 E.W.	-	-
F-2C	2'-0"	CONT.	12"	(2) #5 L.W. #4 @ 48" O.C. C.W.	-	-
S-1	12"	CONT.	12"	(2) #5 L.W.	(2) #5 L.W.	#3 TIES @ 8" O.C.
C.W. = CROSSWISE		E.W. = EACH WAY		L.W. = LENGTHWISE		

NOTES:

- ALL FOOTINGS SHALL BEAR ON PROPERLY PREPARED MATERIAL. SEE THE SITE PREPARATION NOTES.
- ALL FOOTINGS SHALL BE CENTERED BELOW THE WALL AND/OR COLUMN ABOVE, TYP., U.N.O.
- ALL EXTERIOR FOOTINGS SHALL BEAR BELOW THE EFFECTS OF THE FROST.
- PROVIDE A 2X4 BEVELED KEY WAY IN ALL CONTINUOUS WALL FOOTINGS.
- PROVIDE DOWELS WITH STANDARD HOOKS FROM FOOTINGS TO ANY REINFORCED ELEMENT ABOVE WITH SIZE AND SPACING TO MATCH VERTICAL REINFORCING IN ELEMENT ABOVE.
- PROVIDE MINIMUM COVER FOR ALL REINFORCING PER GENERAL NOTES.
- ANY INCREASE IN THE SIZE OF FOOTINGS SHOWN MAY REQUIRE ADDITIONAL REINFORCING, COORDINATE WITH THE ARCHITECT AND STRUCTURAL ENGINEER.
- PENETRATIONS THROUGH FOOTINGS ARE NOT ALLOWED, UNLESS APPROVED BY THE ARCHITECT AND/OR STRUCTURAL ENGINEER IN WRITING PRIOR TO CASTING FOOTING.
- SEE GENERAL NOTES FOR ADDITIONAL INFORMATION.

CONCRETE PIER SCHEDULE						
MARK	WIDTH	LENGTH	REINFORCING		TYPE	NOTES
			VERTICAL	TIES SETS		
CP-1	1'-8"	2'-3"	(6) #7	(3) #4 @ 12" O.C.	C	
CP-2	1'-2"	2'-3"	(4) #6	(3) #4 @ 12" O.C.	D	
CP-3	1'-4"	1'-4"	(6) #5	(3) #4 @ 12" O.C.	A	

NOTES:

- PROVIDE MINIMUM COVER FOR ALL REINFORCING PER THE GENERAL NOTES.
- PROVIDE DOWELS WITH STANDARD HOOKS AND/OR PROPER LAP TO THE STRUCTURE BELOW WITH SIZE AND SPACING TO MATCH THE VERTICAL REINFORCING IN THE PIER ABOVE, TYP., U.N.O.
- PROVIDE A MINIMUM OF TWO SETS OF TIES IN THE TOP FIVE INCHES OF EVERY PIER, TYP., U.N.O.
- PENETRATIONS THROUGH CONCRETE PIERS ARE NOT ALLOWED.
- SEE GENERAL NOTES FOR ADDITIONAL INFORMATION.

CONCRETE WALL SCHEDULE						
MARK	THICKNESS	REINFORCING			WALL TYPE	NOTES
		VERTICAL	HORIZONTAL	TOP AND BOTTOM		
CW-8A	8"	#4 @ 16" O.C.	#4 @ 12" O.C.	(2) #4	-	-
I.F. = INSIDE FACE		O.F. = OUTSIDE FACE		E.F. = EACH FACE	* PLACE BARS CLOSEST TO FORMS.	

NOTES:

- PROVIDE MINIMUM COVER FOR ALL REINFORCING PER THE GENERAL NOTES.
- PROVIDE CORNER BARS AT ALL CORNERS AND INTERSECTING WALLS. SEE DETAIL???
- PROVIDE DOWELS WITH STANDARD HOOKS AND/OR PROPER LAP TO THE STRUCTURE BELOW WITH SIZE AND SPACING TO MATCH THE VERTICAL REINFORCING IN THE WALL ABOVE, TYP., U.N.O.
- WHEN SINGLE CURTAIN OF REINFORCING IS SPECIFIED, PLACE THE VERTICAL REINFORCING IN THE CENTER OF THE WALL, TYP., U.N.O.
- WHEN A DOUBLE CURTAIN OF REINFORCING IS SPECIFIED, PLACE EACH CURTAIN OF STEEL AT THE FACE OF THE WALL WITH MINIMUM COVER AS SPECIFIED IN THE GENERAL NOTES. PLACE THE VERTICAL REINFORCING CLOSEST TO THE FORMS, TYP., U.N.O.
- PROVIDE VERTICAL JAMB REINFORCING EACH SIDE OF OPENING PER THE GENERAL NOTES, U.N.O. EXTEND FULL HEIGHT OF WALL BETWEEN LEVELS.
- SPLICE VERTICAL REINFORCING AT FLOOR LEVELS ONLY, TYP., U.N.O.
- SPLICING IN HORIZONTAL REINFORCING IN ONE CURTAIN SHALL BE STAGGERED FROM SPLICES IN THE OPPOSITE CURTAIN A MINIMUM OF FOUR FEET.
- SEE GENERAL NOTES FOR ADDITIONAL INFORMATION.

ABBREVIATIONS

@	AT	IBC	INTERNATIONAL BUILDING CODE
AB	ANCHOR BOLT	ICBO	INTERNATIONAL CONFERENCE OF BUILDING OFFICIALS
ABV	ABOVE	ICC	INTERNATIONAL CODE COUNCIL
ALT	ALTERNATE	IN	INSULATION
APPROX	APPROXIMATE	INSUL	INSULATION
ARCH	ARCHITECT	INT	INTERIOR
BLDG	BUILDING	JT	JOINT
BLW	BELOW	JST	JOIST
BM	BEAM	K	KIPS - 1,000 POUNDS
BOT	BOTTOM	KLF	KIPS PER LINEAR FOOT
BRG	BEARING	KSF	KIPS PER SQUARE FOOT
BTWN	BETWEEN	KSI	KIPS PER SQUARE INCH
CJ	CONSTRUCTION / CONTROL JOINT	LBS	POUNDS
CJP	COMPLETE JOINT PENETRATION	LF	LINEAR FOOT
CMU	CONCRETE MASONRY UNIT	LH	LONG LEG HORIZONTAL
COL	COLUMN	LLV	LONG LEG VERTICAL
CONC	CONCRETE	MAS	MASONRY
CONST	CONSTRUCTION	MAX	MAXIMUM
CONT	CONTINUOUS	MECH	MECHANICAL
CONTR	CONTRACTOR	MFR	MANUFACTURER
CTR	CENTER	MIN	MINIMUM
D.B.	DECK BEARING	MISC	MISCELLANEOUS
D.B.A.	DEFORMED BAR ANCHOR	NTS	NOT TO SCALE
DBL	DOUBLE	O	OBSERVE
DET	DETAIL	O.C.	ON CENTER
DIA (Ø)	DIAMETER	O.F.	OUTSIDE FACE
DIAG	DIAGONAL	OPNG	OPENING
DIM	DIMENSION	OPP	OPPOSITE
DK	DECK	P	PERFORM
DN	DOWN	PCF	POUNDS PER CUBIC FOOT
DWG	DRAWING	PJP	PARTIAL JOINT PENETRATION
DWL	DOWEL	PL	PLATE
E.F.	EACH FACE	PLF	POUNDS PER LINEAR FOOT
E.J.	EXPANSION JOINT	PNL	PANEL
E.W.	EACH WAY	PP	PARTIAL PENETRATION
EA	EACH	PSF	POUNDS PER SQUARE FOOT
EL	ELEVATION	PSI	POUNDS PER SQUARE INCH
ELECT	ELECTRICAL	P/T	POST TENSIONED
ELEV	ELEVATOR	PT	POINT
ENG	ENGINEER	REINF	REINFORCING
EQ	EQUAL	REO'D	REQUIRED
EQUIP	EQUIPMENT	SFRS	SEISMIC FORCE RESISTING SYSTEM
EXIST (E)	EXISTING	SHT	SHEET
EXP	EXPOSED/ EXPANSION	SIM	SIMILAR
EXT	EXTERIOR	S.O.G.	SLAB ON GRADE
F.D.	FLOOR DRAIN	SQ	SQUARE
F.F.	FINISH FLOOR	STD	STANDARD
F.S.E.	FINISH FLOOR ELEVATION	ST	STEEL
F.V.	FIELD VERIFY	STIFF	STIFFENER
FDTN	FOUNDATION	STRUC	STRUCTURAL
FIN	FINISH	T&B	TOP AND BOTTOM
FL	FLOOR	T.O.	TOP OF
FT	FOOT	TEMP	TEMPERATURE
FTG	FOOTING	T.C.	TOP OF CONCRETE
GA	GAUGE	T.F.	TOP OF FOOTING
GALV	GALVANIZED	T.S.	TOP OF SLAB
GLB	GLU LAMINATED	T.ST.	TOP OF STEEL
GR	GRADE	T.W.	TOP OF WALL
G.S.N.	GENERAL NOTES	TYP	TYPICAL
	STRUCTURAL	U.N.O.	UNLESS NOTED OTHERWISE
	NOTES	VERT	VERTICAL
HB	HORIZONTAL BRIDGING	W.P.	WORK POINT
HORIZ	HORIZONTAL	W/	WITH
H.S.A.	HEADED STUD ANCHORS	WF	WIDE FLANGE
	HOLLOW STRUCTURAL STEEL	WT	WEIGHT
HSS	HOLLOW STRUCTURAL STEEL	W.W.F.	WELDED WIRE FABRIC
HT	HEIGHT	YD	YARD
I.F.	INSIDE FACE		

CONCRETE CONSTRUCTION (IBC 2018 1705.3)			
ITEM	CONTINUOUS	PERIODIC	DETAILED INSTRUCTION AND FREQUENCIES
CONCRETE CONSTRUCTION (IBC 1705.3)			
REINFORCING STEEL, INCLUDING PRESTRESSING TENDONS		X	VERIFY PRIOR TO PLACING CONCRETE THAT REINFORCING IS OF SPECIFIED TYPE, GRADE AND SIZE, THAT IT IS FREE OF OIL, DIRT, AND RUST, THAT IT IS LOCATED AND SPACED PROPERLY, THAT HOOKS, BENDS, TIES, STIRRUPS, AND SUPPLEMENTAL...
REINFORCING BAR WELDING		X	A. VERIFY WELDABILITY OF REINFORCING BARS OTHER THAN ASTM A706 B. INSPECT SINGLE-PASS FILLET WELDS, MAXIMUM 5/16"
C. INSPECT ALL OTHER WELDS	X		
CAST-IN BOLTS AND EMBEDS		X	INSPECTION OF ANCHORS OR EMBEDS CAST IN CONCRETE IS REQUIRED WHEN ALLOWABLE LOADS HAVE BEEN INCREASED OR WHERE STRENGTH DESIGN IS USED.
POST-INSTALLED ANCHORS OR DOWELS		X	ALL POST-INSTALLED ANCHORS/DOWELS SHALL BE SPECIALLY INSPECTED AS REQUIRED BY THE APPROVED ICC-ES REPORT.
A. ADHESIVE ANCHORS INSTALLED IN HORIZONTALLY OR UPWARDLY INCLINED ORIENTATIONS TO RESIST SUSTAINED TENSION LOADS	X		
B. MECHANICAL ANCHORS AND ADHESIVE ANCHORS NOT DEFINED IN 4.8		X	
USE OF REQUIRED MIX DESIGN		X	VERIFY THAT ALL MIXES USED COMPLY WITH THE APPROVED CONSTRUCTION DOCUMENTS, ACI 318-11; CH. 4.5.2.5.4; AND IBC 1904.3, 1913.2, 1913.3.
CONCRETE SAMPLING FOR STRENGTH TESTS, SLUMP, AIR CONTENT, AND TEMPERATURE		X	
CONCRETE AND SHOTCRETE PLACEMENT CURING TEMPERATURE AND TECHNIQUES		X	VERIFY THAT THE AMBIENT TEMPERATURE FOR CONCRETE IS KEPT AT >50°F FOR AT LEAST 7 DAYS AFTER PLACEMENT. HIGH-EARLY-STRENGTH CONCRETE SHALL BE KEPT AT >50°F FOR AT LEAST 3 DAYS. ACCELERATED CURING METHODS MAY BE USED (SEE ACI 318: 5.11.3). THE AMBIENT TEMPERATURE FOR SHOTCRETE SHALL BE >40°F FOR THE SAME PERIOD OF TIME AS NOTED FOR CONCRETE. SHOTCRETE SHALL BE KEPT CONTINUOUSLY MOIST FOR AT LEAST 24 HOURS AFTER SHOTCRETING. ALL CONCRETE MATERIALS, REINFORCEMENT, FORMS FILLERS, AND GROUND SHALL BE FREE FROM FROST. IN HOT WEATHER CONDITIONS ENSURE THAT APPROPRIATE MEASURES ARE TAKEN TO AVOID PLASTIC SHRINKAGE CRACKING AND THAT THE SPECIFIED WATER/CEMENT RATIO IS NOT EXCEEDED.
PRE-STRESSED CONCRETE	X		APPLICATION OF PRESTRESSING FORCES AND GROUTING OF BONDED PRESTRESSING TENDONS.
ERECTION OF PRECAST CONCRETE		X	VERIFY THAT ALL PRECAST ELEMENTS ARE LIFTED, ASSEMBLED AND BRACED IN ACCORDANCE WITH THE APPROVED CONSTRUCTION DOCUMENTS.
STRENGTH VERIFICATION		X	VERIFY THAT ADEQUATE STRENGTH HAS BEEN ACHIEVED PRIOR TO THE REMOVAL OF SHORES AND FORMS OR THE STRESSING OF POST-TENSIONED TENDONS.
FORMWORK		X	VERIFY THAT THE FORMS ARE PLACED PLUMB AND CONFORM TO THE SHAPES, LINES, AND DIMENSIONS OF THE MEMBERS AS REQUIRED BY THE APPROVED CONSTRUCTION DOCUMENTS.
REINFORCEMENT COMPLYING WITH ASTM A 615 IN SPECIAL MOMENT FRAMES, SPECTION STRUCTURAL WALLS, AND COUPLING BEAMS		X	VERIFY THAT ASTM A 615 REINFORCING STEEL USED IN THESE AREAS COMPLIES WITH ACI 318: 21.1.5.2 BY MEANS OF CERTIFIED MILL TEST REPORTS. IF THIS REINFORCING STEEL IS TO BE WELDED CHEMICAL TESTS SHALL BE PERFORMED IN ACCORDANCE WITH ACI 318: 3.5.2.

CONCRETE CONSTRUCTION (IBC 1705.3 AND 1705.12.1)			
ITEM	CONTINUOUS	PERIODIC	DETAILED INSTRUCTION AND FREQUENCIES
CONCRETE CONSTRUCTION (IBC 1705.3)			
REINFORCING STEEL, INCLUDING PRESTRESSING TENDONS		X	VERIFY PRIOR TO PLACING CONCRETE THAT REINFORCING IS OF SPECIFIED TYPE, GRADE AND SIZE, THAT IT IS FREE OF OIL, DIRT, AND RUST, THAT IT IS LOCATED AND SPACED PROPERLY, THAT HOOKS, BENDS, TIES, STIRRUPS, AND SUPPLEMENTAL...
CAST-IN BOLTS AND EMBEDS		X	INSPECTION OF ANCHORS OR EMBEDS CAST IN CONCRETE IS REQUIRED WHEN ALLOWABLE LOADS HAVE BEEN INCREASED OR WHERE STRENGTH DESIGN IS USED.
POST-INSTALLED ANCHORS OR DOWELS		X	ALL POST-INSTALLED ANCHORS/DOWELS SHALL BE SPECIALLY INSPECTED AS REQUIRED BY THE APPROVED ICC-ES REPORT.
USE OF REQUIRED MIX DESIGN		X	VERIFY THAT ALL MIXES USED COMPLY WITH THE APPROVED CONSTRUCTION DOCUMENTS, ACI 318-11; CH. 4.5.2.5.4; AND IBC 1904.3, 1913.2, 1913.3.
CONCRETE SAMPLING FOR STRENGTH TESTS, SLUMP, AIR CONTENT, AND TEMPERATURE		X	
CONCRETE AND SHOTCRETE PLACEMENT CURING TEMPERATURE AND TECHNIQUES		X	VERIFY THAT THE AMBIENT TEMPERATURE FOR CONCRETE IS KEPT AT >50°F FOR AT LEAST 7 DAYS AFTER PLACEMENT. HIGH-EARLY-STRENGTH CONCRETE SHALL BE KEPT AT >50°F FOR AT LEAST 3 DAYS. ACCELERATED CURING METHODS MAY BE USED (SEE ACI 318: 5.11.3). THE AMBIENT TEMPERATURE FOR SHOTCRETE SHALL BE >40°F FOR THE SAME PERIOD OF TIME AS NOTED FOR CONCRETE. SHOTCRETE SHALL BE KEPT CONTINUOUSLY MOIST FOR AT LEAST 24 HOURS AFTER SHOTCRETING. ALL CONCRETE MATERIALS, REINFORCEMENT, FORMS FILLERS, AND GROUND SHALL BE FREE FROM FROST. IN HOT WEATHER CONDITIONS ENSURE THAT APPROPRIATE MEASURES ARE TAKEN TO AVOID PLASTIC SHRINKAGE CRACKING AND THAT THE SPECIFIED WATER/CEMENT RATIO IS NOT EXCEEDED.
PRE-STRESSED CONCRETE		X	
ERECTION OF PRECAST CONCRETE		X	VERIFY THAT ALL PRECAST ELEMENTS ARE LIFTED, ASSEMBLED AND BRACED IN ACCORDANCE WITH THE APPROVED CONSTRUCTION DOCUMENTS.
STRENGTH VERIFICATION		X	VERIFY THAT ADEQUATE STRENGTH HAS BEEN ACHIEVED PRIOR TO THE REMOVAL OF SHORES AND FORMS OR THE STRESSING OF POST-TENSIONED TENDONS.
FORMWORK		X	VERIFY THAT THE FORMS ARE PLACED PLUMB AND CONFORM TO THE SHAPES, LINES, AND DIMENSIONS OF THE MEMBERS AS REQUIRED BY THE APPROVED CONSTRUCTION DOCUMENTS.
REINFORCEMENT COMPLYING WITH ASTM A 615 IN SPECIAL MOMENT FRAMES, SPECTION STRUCTURAL WALLS, AND COUPLING BEAMS		X	VERIFY THAT ASTM A 615 REINFORCING STEEL USED IN THESE AREAS COMPLIES WITH ACI 318: 21.1.5.2 BY MEANS OF CERTIFIED MILL TEST REPORTS. IF THIS REINFORCING STEEL IS TO BE WELDED CHEMICAL TESTS SHALL BE PERFORMED IN ACCORDANCE WITH ACI 318: 3.5.2.

SOILS CONSTRUCTION (IBC 1705.6)			
ITEM	CONTINUOUS	PERIODIC	DETAILED INSTRUCTION AND FREQUENCIES
SOILS CONSTRUCTION (IBC 1705.6):			
VERIFY SUBGRADE IS ADEQUATE TO ACHIEVE DESIGN BEARING CAPACITY		X	PRIOR TO PLACEMENT OF CONCRETE.
VERIFY EXCAVATIONS EXTEND TO PROPER DEPTH AND MATERIAL		X	PRIOR TO PLACEMENT OF COMPACTED FILL OR CONCRETE.
VERIFY THAT SUBGRADE HAS BEEN APPROPRIATELY PREPARED PRIOR TO PLACING COMPACTED FILL		X	PRIOR TO PLACEMENT OF COMPACTED FILL.
PERFORM CLASSIFICATION AND TESTING OF COMPACTED FILL MATERIALS		X	ALL MATERIALS SHALL BE CHECKED AT EACH LIFT FOR PROPER CLASSIFICATIONS AND GRADATIONS NOT LESS THAN ONCE FOR EACH 10,000 SQUARE-FEET OF SURFACE AREA.
VERIFY PROPER MATERIALS, DENSITIES AND LIFT THICKNESSES DURING PLACEMENT AND COMPACTION		X	

FLOOR AND ROOF SHEATHING SCHEDULE

LOCATION	SHEATHING	EDGE NAILING	FIELD NAILING	BOUNDARY NAILING	BLOCKING AT PANEL EDGES
FLOOR	23/32" T & G 48/24 SPAN RATING	10D AT 6" O.C.	10D AT 12" O.C.	10D AT 6" O.C.	NO
ROOF	15/32" 40/20 SPAN RATING	10D AT 6" O.C.	10D AT 12" O.C.	10D AT 6" O.C.	NO

NOTES:

- SEE PARTIAL PLAN BELOW FOR LOCATION OF BOUNDARY, EDGE, AND FIELD NAILING.
- ALL FASTENERS, INCLUDING NAILS IN PRESERVATIVE TREATED WOOD, SHALL BE HOT DIPPED ZINC COATED GALVANIZED STEEL, STAINLESS STEEL, SILICONE BRONZE, OR COPPER UNLESS SILL PLATE IS BORATE TREATED OR IS OF LSL MATERIAL.
- FLOOR SHEATHING SHALL BE GLUED AND NAILED TO THE STRUCTURE.
- JOIST SUPPLIER TO PROVIDE JOIST HANGERS.
- JOIST SUPPLIER TO PROVIDE WEB STIFFENERS ON JOISTS AT BEARING AND CONCENTRATED LOADS.

ROOF AND FLOOR SHEATHING ATTACHMENT DETAILS

Labels in diagram: DIAPHRAGM BOUNDARY, TRUSSED RAFTERS/JOISTS, 1/8" GAP AT JOINTS, EDGE NAILING AT BOUNDARY EDGES, STAGGER JOINTS, 2X4 BLOCKING (IF BLOCKING IS SCHEDULED LAID FLAT, SEE DETAIL BELOW), FIELD NAILING, BOUNDARY NAILING AT CONTINUOUS PANEL EDGES, EDGE NAILING, 2X4 LAID FLAT BLOCKING BETWEEN FRAMING, FIELD NAILING, EDGE NAILING, SHEATHING, TRUSSED RAFTER, OUTLOOKER, OR JOIST, AT CONTINUOUS PANEL JOINT, AT MULTIPLE TRUSSED RAFTERS OR JOISTS, EDGE NAILING MUST OCCUR AT A COMMON TRUSSED RAFTER OR JOIST. ALL ROOF AND FLOOR SHEATHING EDGES MUST BE SUPPORTED BY TRUSSED RAFTER, JOIST OR 2X4 LAID FLAT IF BLOCKING SCHEDULED.

WOOD WALL SCHEDULE

MARK	WALL STUDS	STUD SPACING	SILL PLATE	TOP PLATE	NOTES
WW-4.1	2X4	16" O.C.	2X4	(2) 2X4	5/8" ANCHOR BOLTS @ 48" O.C. U.N.O.
WW-4.2	2X4	12" O.C.	2X4	(2) 2X4	5/8" ANCHOR BOLTS @ 48" O.C. U.N.O.
WW-6.1	2X6 UP TO 16'-0" TALL	16" O.C.	2X6	(2) 2X6	5/8" ANCHOR BOLTS @ 48" O.C. U.N.O.
	1 1/2" X 5 1/2" LVL UP TO 21'-0"				

WALL SHEATHING SCHEDULE

MARK	MIN. PLATE SIZE	MIN STUD SIZE AT ABUTTING JOINT	WOOD SHEATHING THICKNESS AND TYPE	FASTENERS	EDGE NAIL SPACING	FIELD NAIL SPACING	SILL ATTACHMENT	A35LTP4 SPACING	NOTES
-A	2X	2X	7/16" APA RATED	8d NAILS	6" O.C.	12" O.C.	16d NAILS AT 8" O.C. IN WOOD, OR 5/8" X 6" EMBED AT 48" O.C.	32" O.C.	
-B	2X	2X	7/16" APA RATED	8d NAILS	4" O.C.	12" O.C.	16d NAILS AT 5" O.C. IN WOOD, OR 5/8" X 6" EMBED AT 48" O.C.	22" O.C.	

NOTES:

- ALL ANCHOR BOLTS SHALL HAVE A 1 1/4" x 3" x SILL PLATE WIDTH MINUS 1" SQUARE WASHER MINIMUM BETWEEN THE SILL PLATE AND THE NUT. SEE ANCHOR BOLT PLATE WASHER DETAIL ON THIS SCHEDULE.
- MINIMUM SILL PLATE ANCHORAGE SHALL BE 16d NAILS AT 16" O.C. IN WOOD, OR 5/8" X 7" EMBED AT 48" O.C. (2 BOLTS PER WALL MIN.) IN CONCRETE. SEE SHEATHING SCHEDULE FOR ADDITIONAL ANCHORAGE REQUIREMENTS, IF APPLICABLE.
- 5/8" ANCHOR BOLTS MAY BE REPLACED WITH 5/8" BY MANUFACTURER SPECIFIED EMBEDMENT CONCRETE SCREW ANCHORS OR EXPANSION WEDGE ANCHORS. THE SCREW ANCHORS MAY BE POWERS "WEDGE-BOLT" (ICC ESR-2528), SIMPSON "TITEN HD" (ICC ESR-2713), THE EXPANSION WEDGE ANCHORS MAY BE POWERS "POWER-STUD+SD1" (ICC ESR-1917), HILTI "KWIK BOLT TZ" (ICC ESR-1917), OR SIMPSON "STRONG-BOLT" (ICC ESR-1771). CLEAN HOLE WITH OIL FREE COMPRESSED AIR BEFORE INSTALLING BOLT.
- POST-INSTALLED ANCHORS NOT ALLOWED IN POST-TENSIONED CONCRETE SLAB.
- ALL WOOD IN CONTACT WITH CONCRETE SHALL BE PRESSURE TREATED.
- ALL FASTENERS, INCLUDING NAILS IN PRESERVATIVE TREATED WOOD, SHALL BE HOT-DIPPED ZINC COATED GALVANIZED STEEL, STAINLESS STEEL, SILICONE BRONZE, OR COPPER UNLESS SILL PLATE IS BORATE TREATED OR IS OF LSL MATERIAL.
- ALL STUDS AND PLATES SHALL MEET THE MATERIALS REQUIREMENTS SPECIFIED IN THE GENERAL NOTES.
- ALIGN STUDS WITH FRAMING MEMBERS ABOVE, TYP. U.N.O.
- PROVIDE SILL PLATE AT BOTTOM OF WALL AND DOUBLE TOP PLATE AT TOP OF WALL, TYP., U.N.O.
- SILL PLATES NEXT TO GYPCRETE SHALL BE DOUBLE SILL PLATES, TYP. U.N.O.
- PROVIDE SPLICES IN PLATES CENTERED OVER STUDS ONLY. STAGGER TOP PLATE SPLICES AT LEAST SIX FEET.
- PROVIDE FULL HEIGHT STUDS BETWEEN FRAMING LEVELS, TYP., U.N.O. PROVIDE PLATES AT BEARING LOCATIONS ONLY. DO NOT PROVIDE INTERMEDIATE PLATES IN WALLS BETWEEN FRAMING LEVELS.
- ANCHOR BOLTS IN SILL PLATES SHALL BE PLACED SO AS NOT TO COINCIDE WITH THE LOCATION OF THE STUDS ABOVE.
- ANCHOR BOLTS SHALL BE CENTERED IN SILL PLATE, TYP., U.N.O.
- SEE GENERAL NOTES FOR ADDITIONAL INFORMATION.

Labels in diagram: BLOCK AT PANEL JOINTS (WHERE OCCURS), EDGE NAIL, STUD AT ADJOINING PANEL EDGES, EDGE NAIL, EDGE NAIL (REQUIRED ON EACH STUD AT HOLD DOWN), FIELD NAIL, (2) WALL STUDS MIN AT HOLD-DOWN, HOLD-DOWN (WHERE OCCURS), EDGE NAIL, ORIENTATION VERTICAL OR HORIZONTAL AT CONTRACTOR'S OPTION, EXCEPT AT SHEATHING TYPES D AND E PLACE HORIZONTAL, 1/4" ADJUSTABLE PLATE WASHER, STUD WIDTH - 1", 1/2" TYP., WOOD STUD WALL, SEE PLAN AND SCHEDULE, STANDARD ANCHOR BOLT.

MINIMUM NAILING

CONNECTION	NAILING	LOCATION
JOIST TO SILL OR GIRDER BRIDGING TO JOIST	(3) 8d COMMON	TOENAIL TOENAIL EACH END
	(2) 8d COMMON	TYP. FACE NAIL
	(2) 16d COMMON	END NAIL
	(2) 16d COMMON	END NAIL
DOUBLE TOP PLATES	(2) 16d COMMON	FACE NAIL
	(2) 16d COMMON	TYP. FACE NAIL
	(8) 16d COMMON	LAP SPLICE
	(3) 8d COMMON	TOENAIL
TO TOP PLATE	(3) 8d COMMON	FACE NAIL
	(2) 16d COMMON	FACE NAIL
RIM JOIST TO TOP PLATE TOP PLATES, LAPS, AND INTERSECTIONS	(3) 8d COMMON	FACE NAIL
	(2) 16d COMMON	FACE NAIL
CONT. HEADER, (2) PCS. CEILING JOIST TO PLATE CONT. HEADER TO STUD CEILING JOISTS, LAPS OVER PARTITIONS	(3) 8d COMMON	FACE NAIL
	(4) 8d COMMON	FACE NAIL
CEILING JOISTS TO PARALLEL RAFTERS	(3) 16d COMMON	FACE NAIL
	(3) 8d COMMON	TOENAIL
1" DIAGONAL BRACE TO EACH STUD AND PLATE	(2) 8d COMMON	FACE NAIL
	(3) 8d COMMON	FACE NAIL
BUILT-UP CORNER STUDS	(3) 8d COMMON	FACE NAIL
	(3) 8d COMMON	FACE NAIL
BUILT-UP GIRDER/BEAM COLLAR TIE TO RAFTER JACK RAFTER TO HIP	(3) 16d COMMON	FACE NAIL
	(2) 16d COMMON	TOENAIL
ROOF RAFTER TO 2X RIDGE BEAM	(2) 16d COMMON	TOENAIL/FACENAIL
	(2) 8d COMMON	FACE NAIL
JOIST TO BAND JOIST	(3) 16d COMMON	FACE NAIL @ EACH JOIST
	(3) 16d COMMON	FACE NAIL @ EACH JOIST
LEDGER STRIP	8d COMMON	1/2" AND LESS
	10d COMMON	19/32" TO 3/4"
PANEL SHEATHING	8d COMMON	7/8" TO 1"
	10d COMMON	3/4" OR LESS
COMBINATION SUBFLOOR UNDERLAYMENT TO FRAMING	8d COMMON	7/8" TO 1"
	10d COMMON	7/8" TO 1"

Labels in diagram: WHERE SILL PLATE IS DRILLED OR NOTCHED MORE THAN 1/3 OF THE WIDTH (W), INSTALL ANCHOR BOLTS EACH SIDE. D = 9" MAX AND 7 BOLT DIAMETERS MIN.

NOTE: ANY SEGMENT OF BASE PLATE SHALL HAVE A MINIMUM OF (2) ANCHOR BOLTS. IF BOTTOM PLATE IS NOTCHED EXTRA BOLT SHALL BE INSTALLED INTO CONCRETE.

SEE PLANS AND WOOD WALL SCHEDULE FOR ANCHOR BOLT SIZE AND SPACING.

HOLDOWN AND STRAP SCHEDULE

MARK	HOLDOWN OR STRAP TYPE	MIN. STUDS AT HOLDOWN/STRAP	FASTENERS	STRAP END LENGTH	HOLDOWN ANCHOR BOLT DIAMETER	ANCHOR BOLT EMBED LENGTH
HOU2	HOU2-SDS2.5	(2) 2X	(6) SDS 1/4"x2.1/2"	-	5/8"	10"
HOU4	HOU4-SDS2.5	(2) 2X	(10) SDS 1/4"x2.1/2"	-	5/8"	10"

NOTES:

- ALL WOOD COLUMNS TO BE NAILED OR BOLTED TOGETHER PER DETAIL A3/SE511.
- NO NAILS REQUIRED IN CLEAR SPAN SECTION OF STRAP.
- HALF OF STRAP FASTENERS IN EACH END.
- ANCHORS MAY BE DRILLED AND EPOXIED WITH HILTI HIT-HY 200 EPOXY OR EQUIVALENT.
- DRILL AND EPOXY EMBEDMENT LENGTH LISTED IN PARENTHESIS.

Labels in diagram: END OF WALL OR EDGE OF OPENING, SEE PLAN, STUDS AT HOLD-DOWN, FASTENERS, HOLD-DOWN, ANCHOR BOLT, CONCRETE FOUNDATION WALL, END LENGTH, CUT LENGTH, CLEAR SPAN, USE EVERY OTHER NAIL HOLE IN A ROW TO PROVIDE THE CODE-REQUIRED MINIMUM CENTER-TO-CENTER SPACING FOR NAILS. PROVIDE MINIMUM 7/8" END DISTANCE EQUAL NUMBER OF SPECIFIED NAILS IN EACH END. WOOD COLUMN, SEE SCHEDULE FOR NUMBER OF STUDS, WOOD STUD WALL, SEE PLAN AND SCHEDULE, EXTERIOR CORNER, WOOD STUD WALL, SEE PLAN AND SCHEDULE, WALL SHEATHING, SEE PLAN FOR SIDE OF WALL, WOOD COLUMN, SEE SCHEDULE FOR NUMBER OF STUDS, HOLD-DOWN, SEE SCHEDULE, INTERIOR TO EXTERIOR WALL INTERSECTION, 0'-2 3/4".

TOP PLATE SPLICE SCHEDULE

HOLE SIZE	STRAPS
LESS THAN 1/3 STUD WIDTH	NONE REQUIRED
BETWEEN 1/3 AND 2/3 STUD WIDTH	ST2115 WITH (6) 16d COMMON NAILS EACH END
GREATER THAN 2/3 STUD WIDTH	ST6224 WITH (10) 16d COMMON NAILS EACH END

Labels in diagram: SIMPSON STRAP EACH SIDE, SEE TABLE, PIPE, VERIFY SIZE AND LOCATION WITH ARCH, MECH, AND ELECTRICAL DRAWINGS, DOUBLE TOP PLATE, TYPICAL STUDS, 3'-0" MIN. LAP, SPLICE, (2) 16d NAILS @ 6" O.C.

NOTES:

- MAXIMUM ACCUMULATED LENGTH OF HORIZONTAL OPENINGS SHALL NOT EXCEED 10% OF WALL LENGTH.
- MAXIMUM ACCUMULATED LENGTH OF VERTICAL OPENINGS SHALL NOT EXCEED 20% OF WALL HEIGHT.

Labels in diagram: SIMPSON CS22 X 2-0" WITH (24) 8d NAILS, TYP., WOOD BEAM (2) 2X6 AT 2X4 STUD WALL OR (3) 2X6 AT 2X6 STUD WALL WHERE OPENING OCCURS BETWEEN WALL STUDS, NO HEADER REQUIRED. 10' TO 24" OPENING. (1) TRIMMER STUD EACH SIDE OF OPENING, TYP. (1) KINGPOST, EACH SIDE OF OPENING, TYP. WOOD STUD WALL, SEE PLAN AND SCHEDULE. SPACE LARGER OF OPENING WIDTHS, 9" MAX, 4 1/2" TO 9" SQUARE OPENING, EDGE NAILING, SEE SCHEDULE. SPACE LARGER OF OPENING HEIGHTS, EDGE NAILING, SEE SCHEDULE. UP TO 4 1/2" SQUARE OPENING, NO BLOCKING OR EDGE NAILING REQUIRED. ADD FULL DEPTH BLOCKING ON SIDE, TOP, AND BOTTOM OF OPENING. INSTALL EDGE NAILING TO BLOCKING AND STUDS AT OPENING. 10' TO 24", 10' TO 24", 10' TO 24".

BID/PERMIT SET - 05.19.2023

FACILITIES SHOP

Spanish Fork City

Spanish Fork, UT 84660

Alan R. Poulsen
Bruce T. Fallon

WPA Architecture
 475 North Freedom Blvd.
 Provo, Utah 84601
 Tel: (801) 374-0800
 info@wpa-architecture.com



Date: 3/14/2023
 Revision:

These plans, drawings, and designs are the exclusive property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

433 South Main Street
 S-003
 SCHEDULES WOOD

SHEET NOTES

- INDICATES NOTES ARE KEYED ON PLAN.
- 6" CONCRETE SLAB REINFORCE WITH #5 AT 18" O.C. EACH WAY. CENTER OF SLAB. PLACE SLAB ON 4" OF FREE DRAINING FILL EXTENDING TO SUITABLE NATIVE SOIL, SEE SOILS REPORT.
- 5" CONCRETE SLAB REINFORCE WITH #4 AT 18" O.C. EACH WAY. CENTER OF SLAB. PLACE SLAB ON 4" OF FREE DRAINING FILL EXTENDING TO SUITABLE NATIVE SOIL, SEE SOILS REPORT.
- SEE ARCHITECTURAL DRAWINGS FOR SLOPES AND RECESSES IN FLOOR SLABS.
- DRILL AND EPOXY DOWELS TO MATCH HORIZONTAL REINFORCING IN NEW WALL AND FOOTING INTO EXISTING WALL AND FOOTING. 6 INCH MINIMUM EMBED.
- FOR CONCRETE SLAB ON GRADE CONTROL JOINTS, SEE DETAILS D1.D2 & D3/S-101. NO CONTROL JOINTS SHALL OCCUR WITHIN 1'-0" PARALLEL TO CROSS TIES. CONTRACTOR SHALL PROVIDE PRELIMINARY LAYOUT OF CONTROL JOINTS FOR APPROVAL PRIOR TO CASTING OF SLAB ON GRADE.

These plans, drawings, and designs are the exclusive property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 3/14/2023
Revision:

PROFESSIONAL STRUCTURAL ENGINEER
3/14/2023
No. 550196-2203
LUKAS JACK
BALLING
STATE OF UTAH

Alan R. Poulsen
Bruce T. Fallon


WPA Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

Spanish Fork, UT 84660

FACILITIES SHOP
Spanish Fork City

433 South Main Street

S-101
FOOTING AND FOUNDATION PLAN

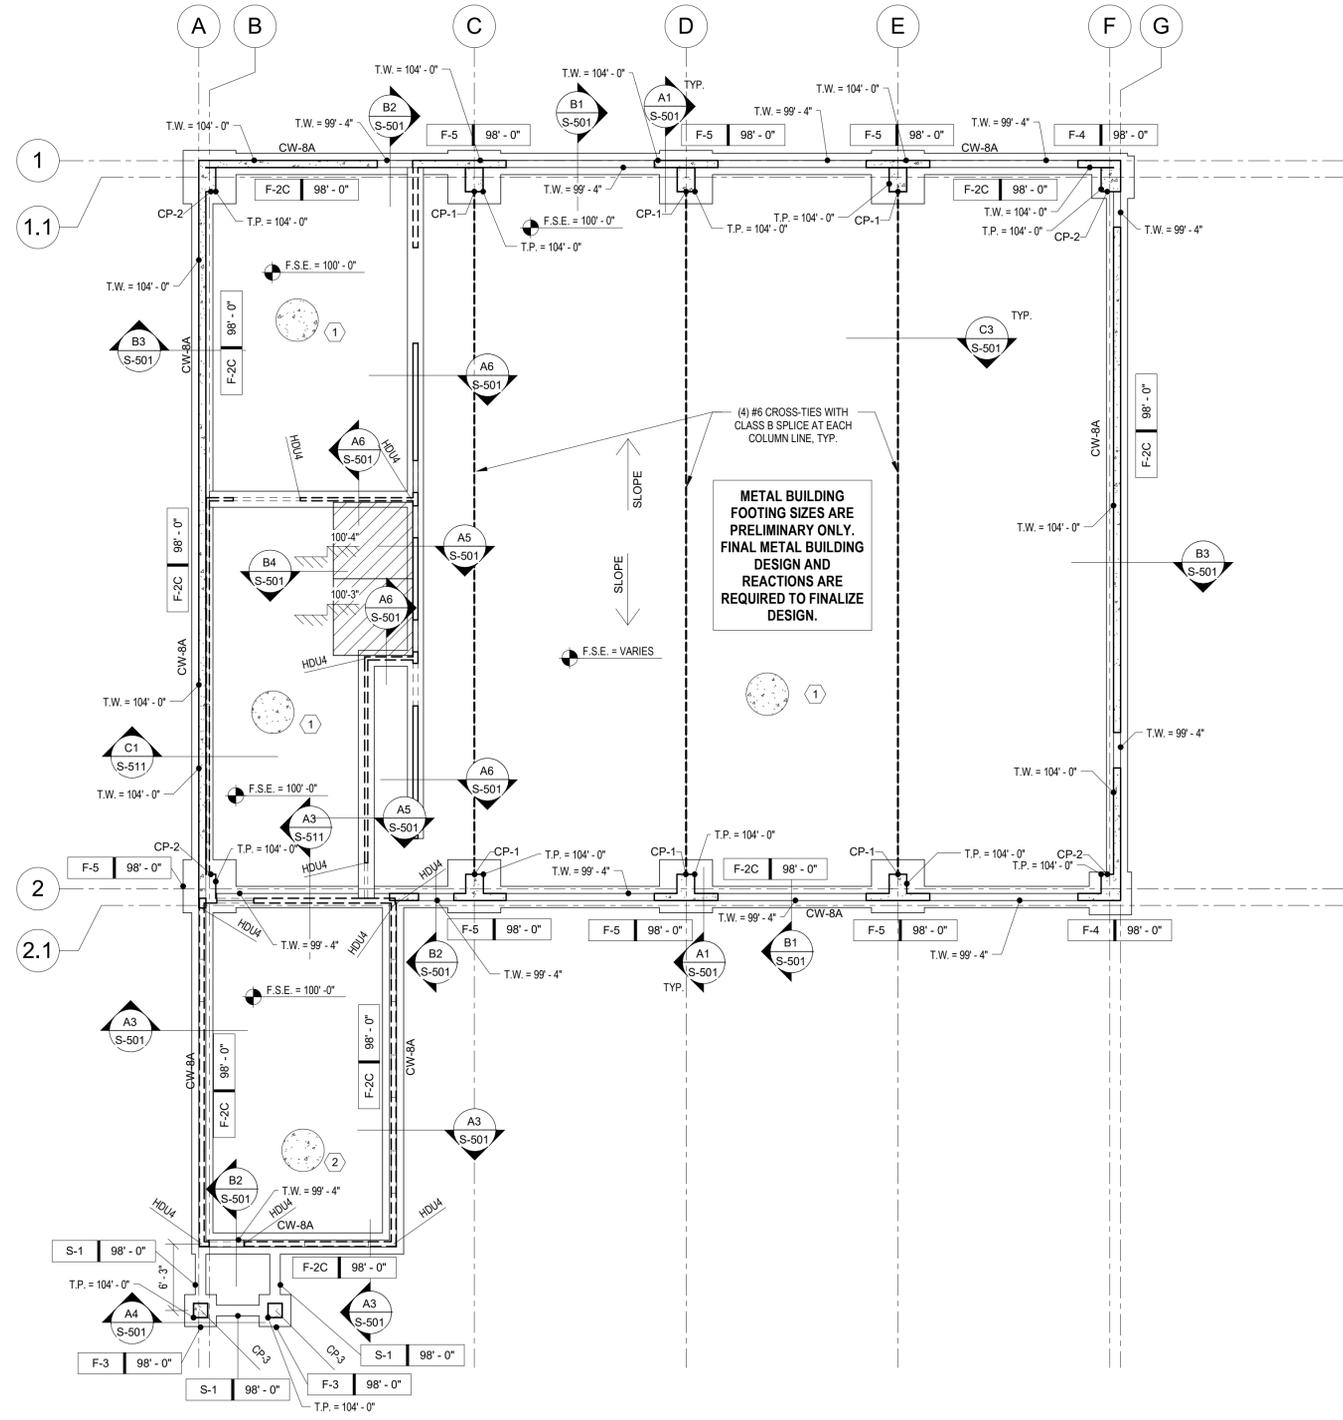

LEGEND

- INDICATES CONCRETE SLAB ON GRADE. SHEET NOTES FOR THICKNESS AND REINFORCING
- INDICATES CHANGE IN ELEVATION OR RECESSED SLAB
- INDICATES CONCRETE FOOTING TYPE AND TOP OF FOOTING ELEVATION
- INDICATES CONCRETE FOOTING & FOUNDATION WALL. SEE SCHEDULES FOR SIZE AND REINFORCING
- INDICATES CONCRETE WALL. SEE SCHEDULES FOR SIZE AND REINFORCING
- INDICATES CONCRETE PIER. SEE SCHEDULE FOR SIZE AND REINFORCING
- F.S.E. = INDICATES FLOOR SLAB ELEVATION
- T.F. = ??-??' INDICATES TOP OF FOOTING ELEVATION
- T.P. = ??-??' INDICATES TOP OF PIER ELEVATION
- T.W. = ??-??' INDICATES TOP OF WALL ELEVATION
- HDU?? / MST?? INDICATES STRAP OR HOLD DOWN. SEE HOLD DOWN AND STRAP SCHEDULE
- ? / SE?-??' INDICATES DETAIL SECTION VIEW.
- ? / SE?-??' INDICATES DETAIL VIEW OR ENLARGED PLAN CALLOUT.

SHEET NOTES

- INDICATES NOTES ARE KEYED ON PLAN.
- 1. SEE ARCHITECTURAL DRAWINGS FOR SLOPES AND RECESSES IN FLOOR SLABS.
- 2. FLOOR SHEATHING. SEE SCHEDULE ON SHEET S-003

These plans, drawings, and designs are the exclusive property of WPA-Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 3/14/2023
Revision:



Alan R. Pouison
Bruce T. Fallon

WPA architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com


Spanish Fork, UT 84660

FACILITIES SHOP
Spanish Fork City

433 South Main Street

S-201
MEZZANINE FRAMING PLAN


BID/PERMIT SET - 05.19.2023

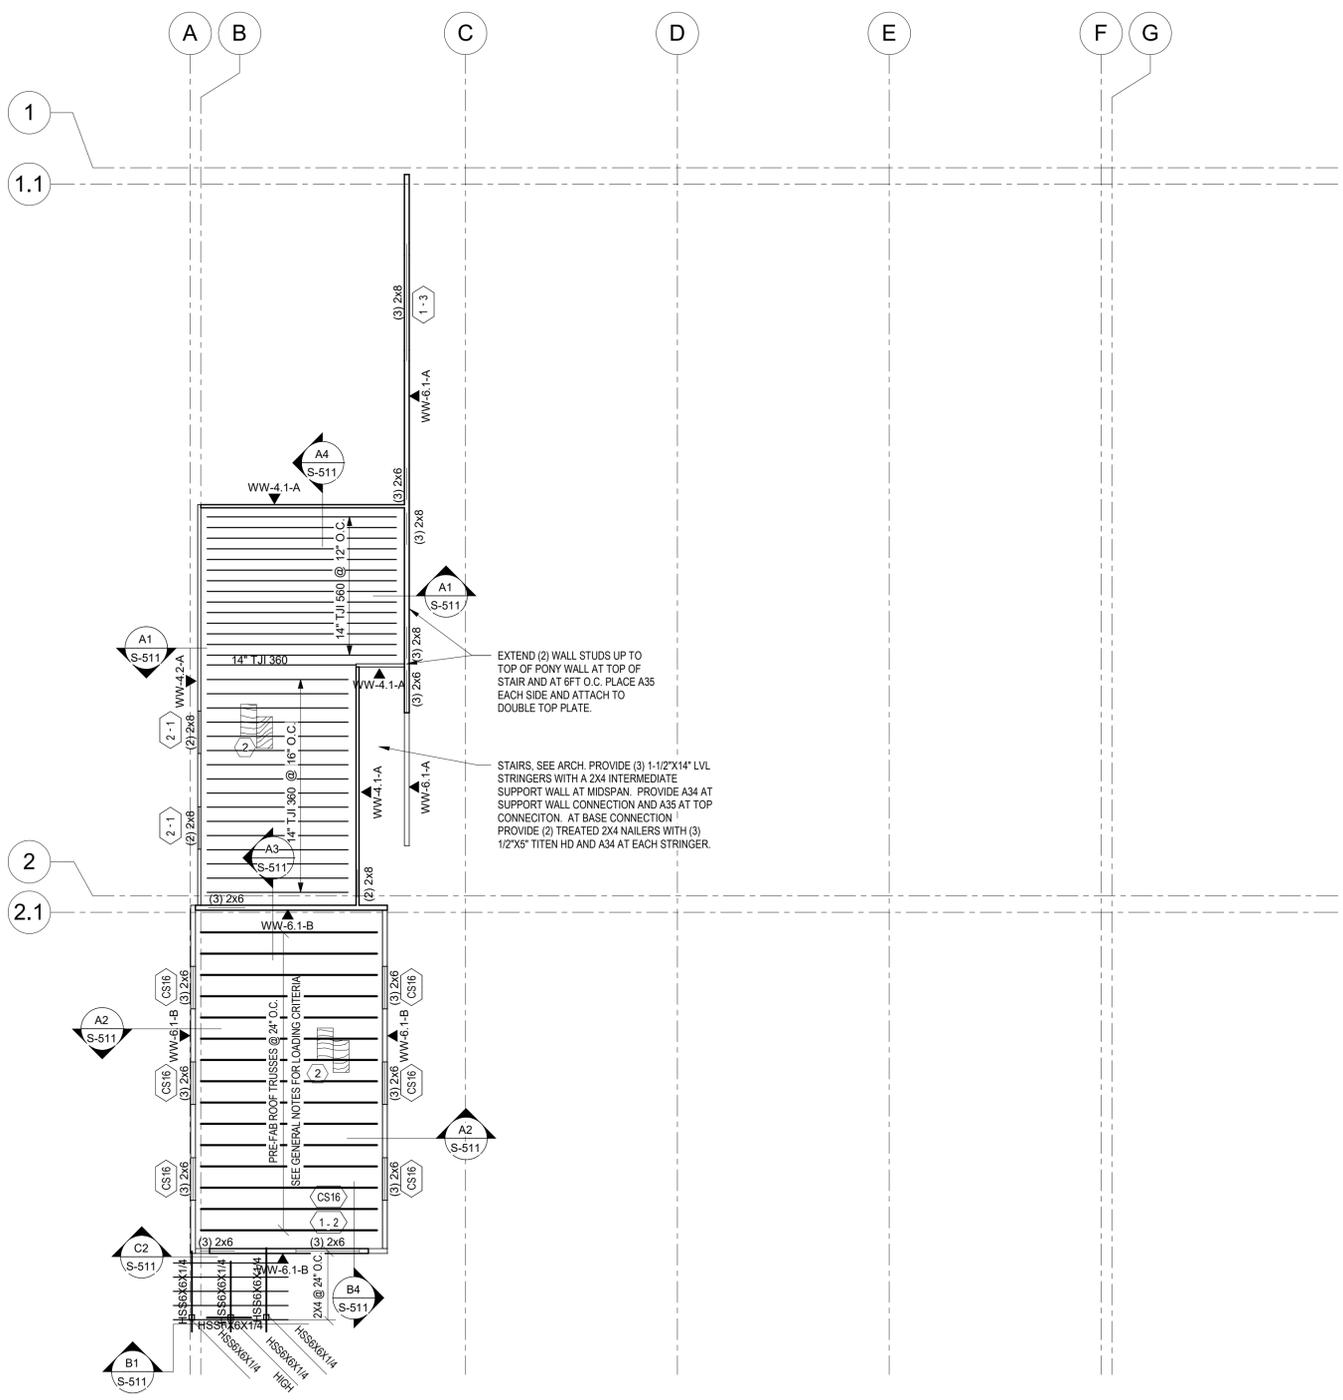


LEGEND

- INDICATES WOOD SHEATHING SPAN DIRECTION. SEE PLAN NOTES.
- T.W. = ?? - ?? INDICATES TOP OF WALL ELEVATION.
- T.P. = ?? - ?? INDICATES TOP OF PIER ELEVATION.
- T.S. = ?? - ?? INDICATES TOP OF STEEL ELEVATION.
- WW-X-X-Y
SW-X-X-Y INDICATES WOOD WALL (WW) OR STEEL STUD WALL (SW) TYPE (X,X) AND SHEATHING (-Y) IF REQUIRED. SEE SCHEDULE
- INDICATES FACE OF WALL SHEATHING. SEE WALL TYPE AND SCHEDULES FOR NAILING
- T-K INDICATES NUMBER OF OF TRIMMER STUDS (T) AND KINGPOSTS (K)
- CS?? INDICATES SIZE/TYPE OF STRAP ABOVE AND BELOW WINDOW/DOOR. SEE TYPICAL STRAPPING OVER WINDOWS/DOORS DETAIL.
- 1 Ref
SE?-?? INDICATES FRAME ELEVATION VIEW.
- ? SE?-?? INDICATES DETAIL SECTION VIEW.
- ? SE?-?? INDICATES DETAIL VIEW OR ENLARGED PLAN CALLOUT.


1 MEZZANINE FRAMING PLAN
S-201 1/8" = 1'-0"

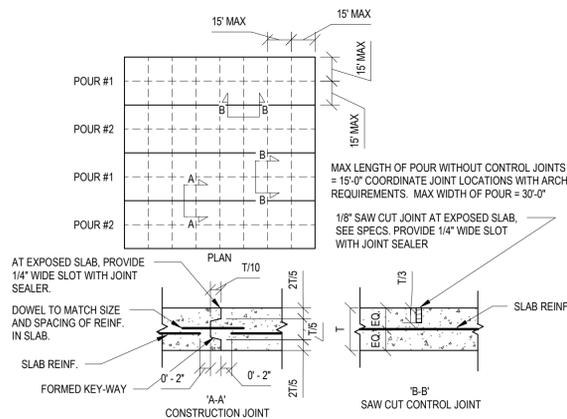


D1 TYPICAL CONCRETE SLAB JOINT DETAIL
NO SCALE

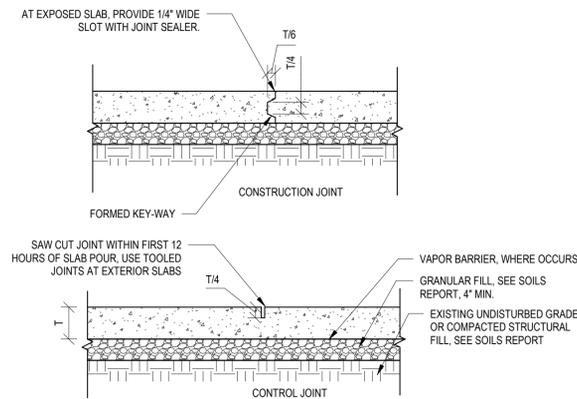


D2 TYPICAL UNREINFORCED SLAB ON GRADE JOINTS
NO SCALE

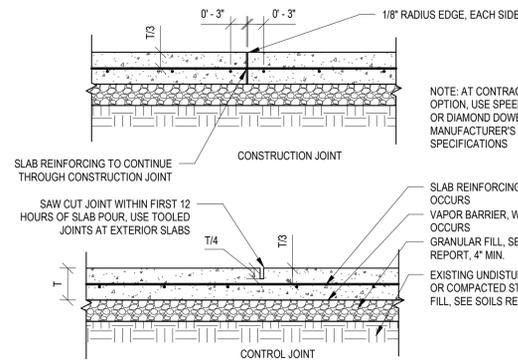


D3 TYPICAL REINFORCED SLAB ON GRADE JOINTS
NO SCALE

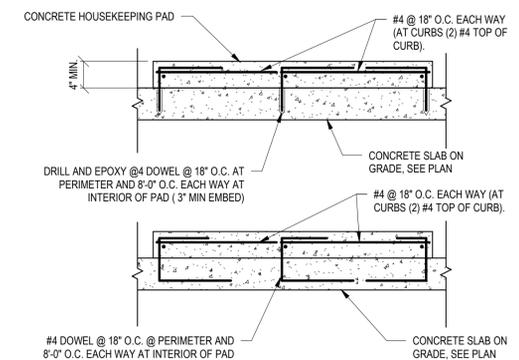


D4 TYPICAL HOUSEKEEPING PAD REINFORCING
NO SCALE

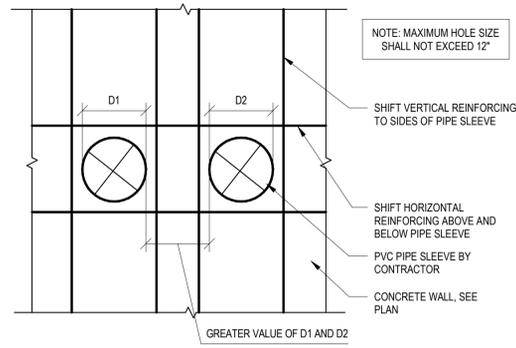


C1 TYPICAL PIPE SLEEVE IN CONCRETE WALL
NO SCALE

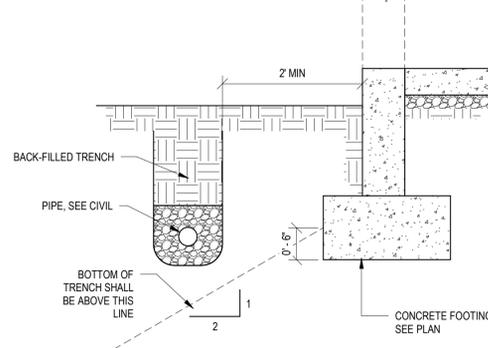


C2 TYPICAL ADJACENT TRENCH LIMITS
NO SCALE

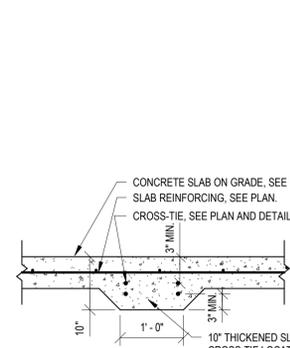


C3 TYPICAL CROSS-TIE IN SLAB DETAIL
NO SCALE

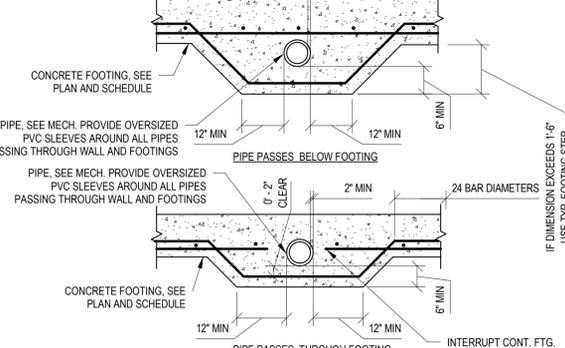


C4 TYPICAL FOOTING PENETRATION
NO SCALE

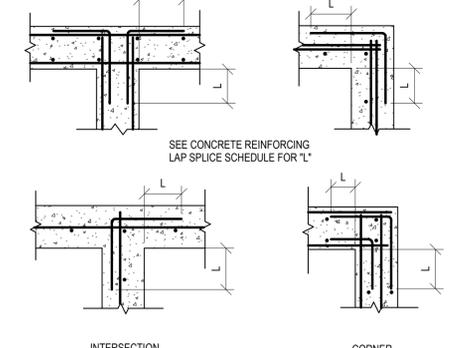


C5 TYPICAL WALL INTERSECTION REINFORCING
NO SCALE

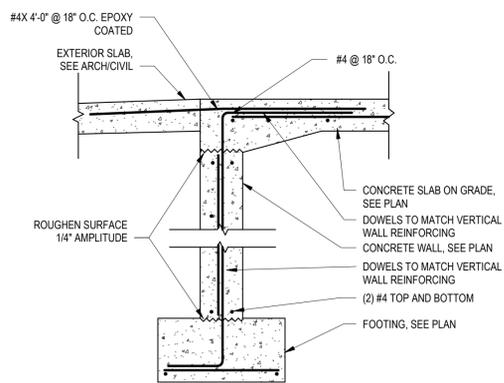


B1 TYP. FOUNDATION WALL AT GARAGE DETAIL
NO SCALE

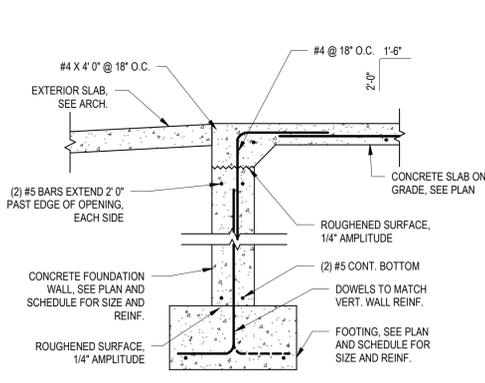


B2 TYPICAL CONCRETE SLAB AT DOORWAY
NO SCALE

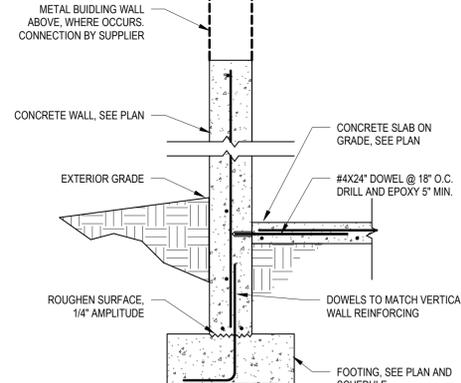


B3 TYP. FOUNDATION WALL DETAIL
NO SCALE

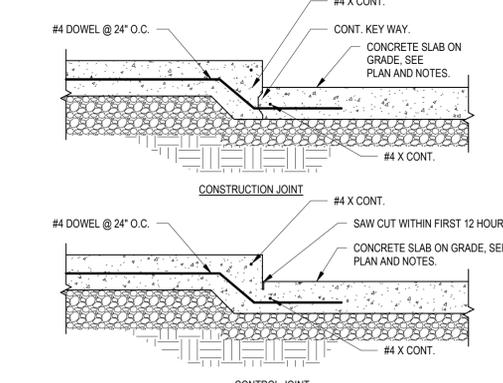


B4 TYPICAL RECESS IN SLAB ON GRADE
NO SCALE

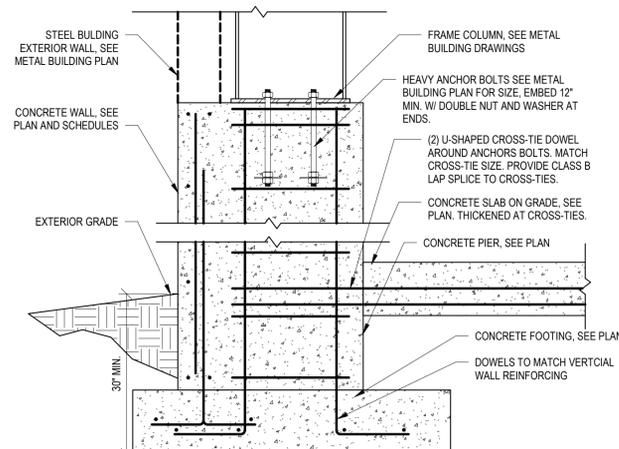


A1 TYP. PIER AND COLUMN DETAIL
NO SCALE

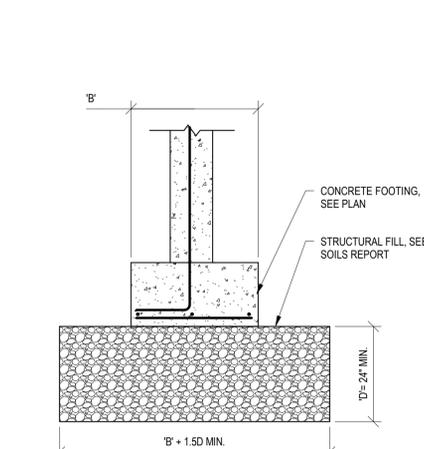


A2 TYPICAL COMPACTED STRUCTURAL FILL
NO SCALE

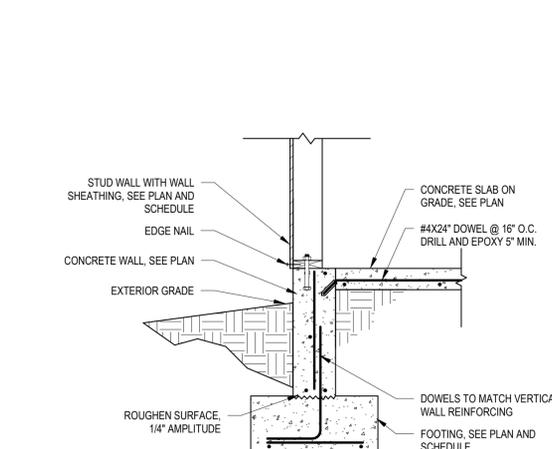


A3 TYP. FOUNDATION DETAIL WITH WALL ABOVE
NO SCALE

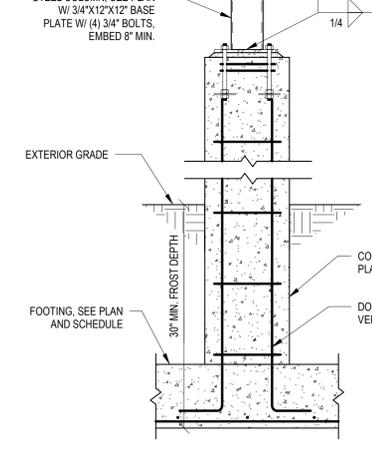

A4 STEEL COLUMN ON CONCRETE PIER
NO SCALE

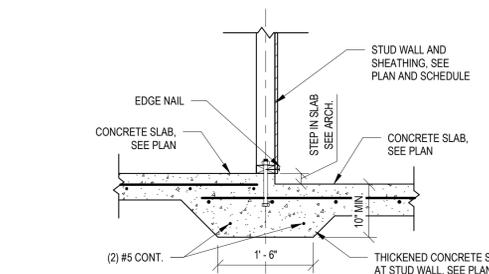

A6 CONCRETE SLAB SLOPE DETAIL
NO SCALE

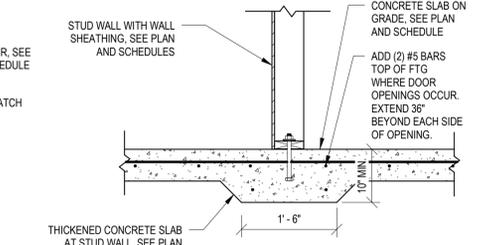

A5 TYPICAL INTERIOR SHOVEL FOOTING
NO SCALE

Date: 3/14/2023
Revision:
Professional Structural Engineer
No. 550196-2023
Lukas Jack
Balling
STATE OF UTAH
These plans, drawings, and designs are the exclusive property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Alan R. Poulsen
Bruce T. Fallon


WPA Architecture
No. 550196-2023
Lukas Jack
Balling
STATE OF UTAH
Tel: (801) 374-0800
475 North Freedom Blvd.
Provo, Utah 84601
info@wpa-architecture.com

Spanish Fork, UT 84660


FACILITIES SHOP
Spanish Fork City

433 South Main Street

BID/PERMIT SET - 05.19.2023
S-501
FOUNDATION DETAILS



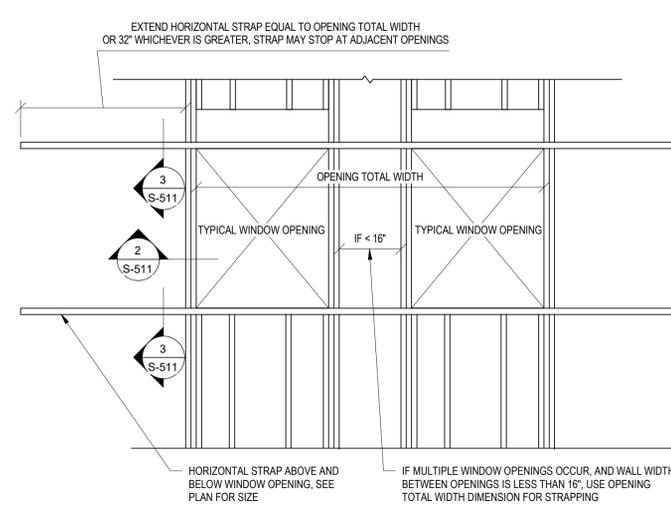


D2
S-511
NO SCALE
TYPICAL STRAPPING OVER WINDOWS/DOORS

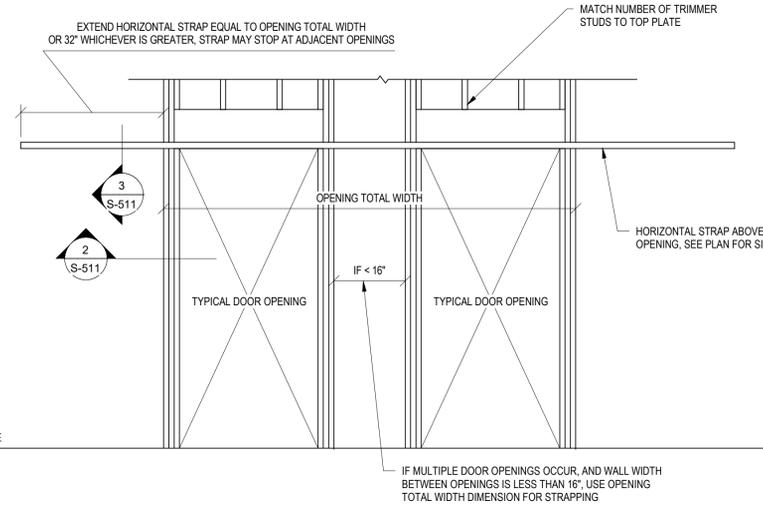


2
S-511
NO SCALE
VIEW 'A'


3
S-511
NO SCALE
VIEW 'B'

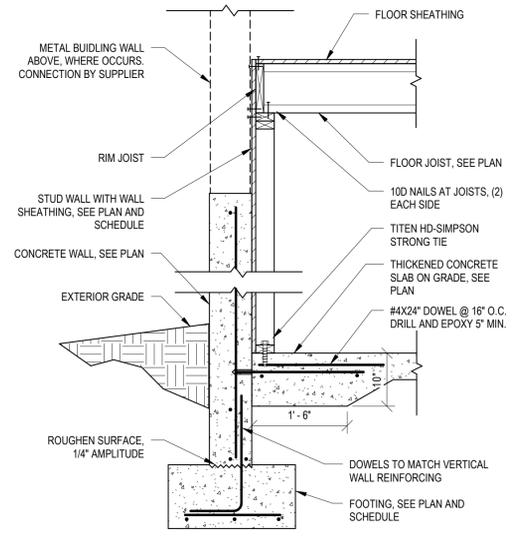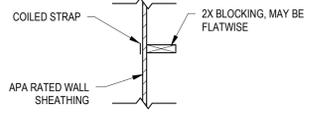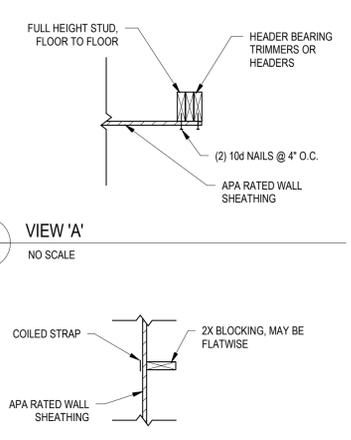


C1
S-511
NO SCALE
TYP. FOUNDATION WALL DETAIL AT WOOD STUD WALL

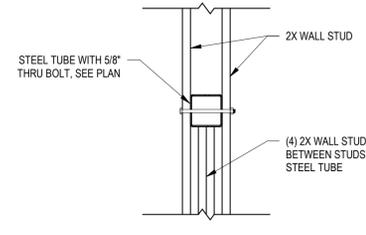


C2
S-511
NO SCALE
STEEL TUBE CONNECTION TO STUD WALL

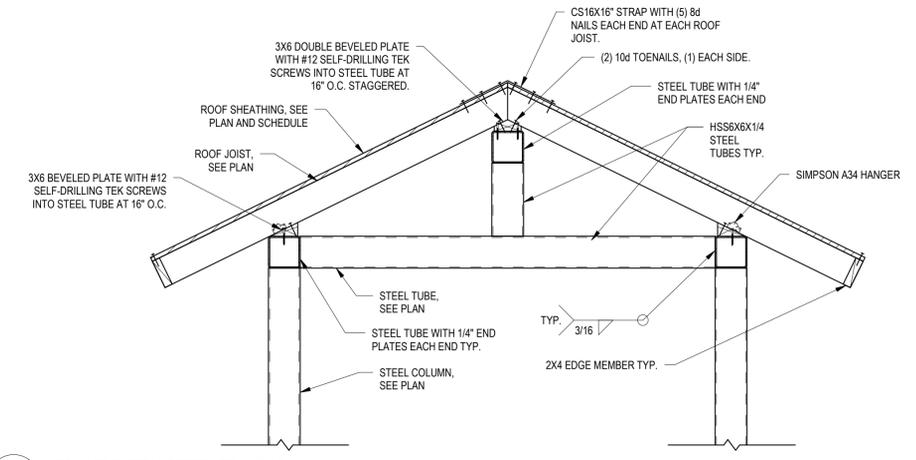


B1
S-511
NO SCALE
FRONT ENTRY STEEL FRAMING

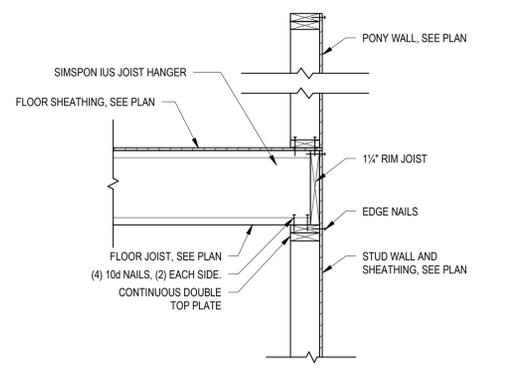


A1
S-511
NO SCALE
TYP. FLOOR JOIST AT STUD WALL DETAIL

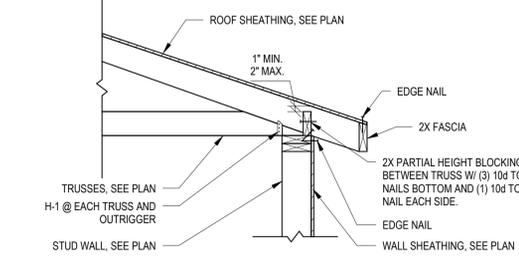


A2
S-511
NO SCALE
TYPICAL TRUSS BEARING DETAIL

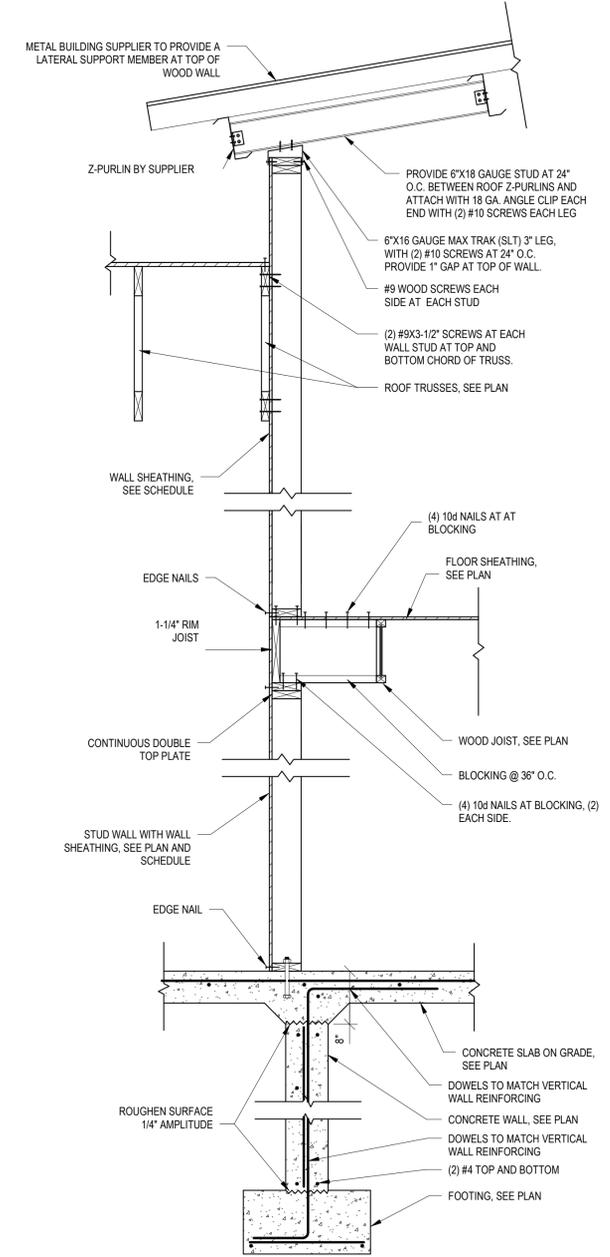

A3
S-511
NO SCALE
FOUNDATION TO ROOF EDGE DETAIL

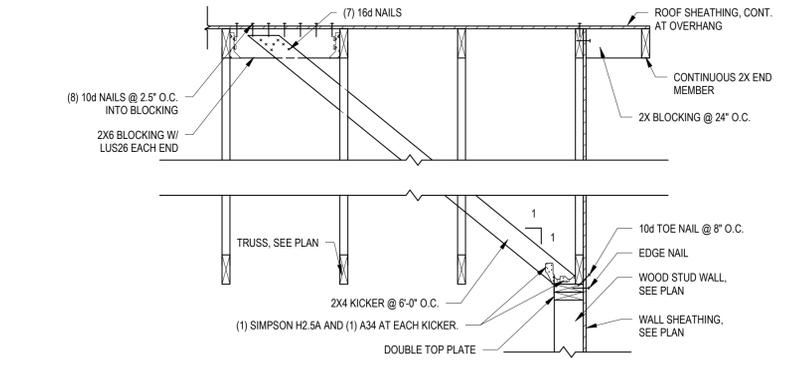

B4
S-511
NO SCALE
TRUSS GABLE END DETAIL

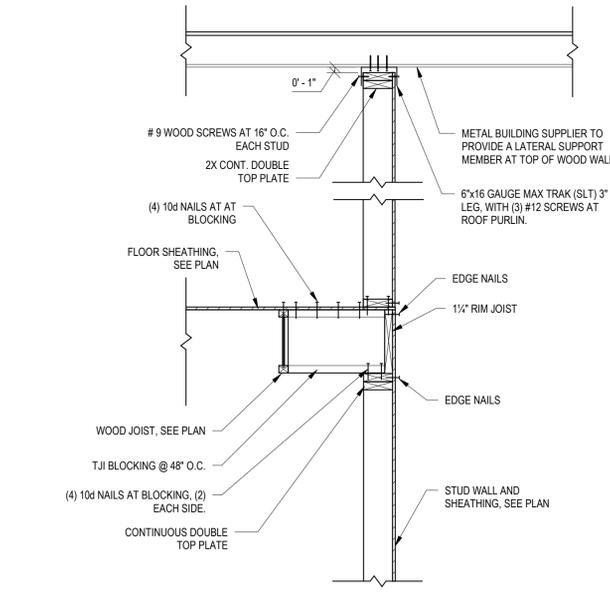

A4
S-511
NO SCALE
TYPICAL FLOOR JOIST AT STUD WALL PARALLEL

These plans, drawings, and designs are the exclusive property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 3/14/2023
Revision:



Alan R. Pouison
Bruce T. Fallon

WPA
Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

Spanish Fork, UT 84660

FACILITIES SHOP
Spanish Fork City

433 South Main Street

S-511
FRAMING DETAILS

BID/PERMIT SET - 05.19.2023

MECHANICAL SYMBOLS	
NOTES: 1. ALL SYMBOLS MAY NOT BE USED. 2. DOTTED SYMBOLS INDICATE EXISTING EQUIPMENT, ETC	
SYMBOL	EXPLANATION
∅	ROUND MEASUREMENT
☐	RETURN AIR GRILLE/DUCT
☒	SUPPLY AIR DIFFUSER/DUCT
☒	EXHAUST AIR INTAKE GRILLE
☐	EXHAUST FAN
⊕ X-X	THERMOSTAT/SENSOR
⊕	MECHANICAL EQUIPMENT SYMBOL
⊕	KEYED NOTE REFERENCE
NECK CFM / SIZE CFM TAG	NECK: NECK AND BRANCH DUCT SIZE CFM: CFM OF DIFFUSER OR GRILLE TAG: DIFFUSER OR GRILLE CALL-OUT
=====	SUPPLY AIR DUCTWORK
-----	RETURN AIR DUCTWORK
-----	EXHAUST AIR DUCTWORK
=====	OUTSIDE AIR DUCTWORK
R/D	RADIATION DAMPER
F/D	FIRE/SMOKE DAMPER
└─┘	BALANCING DAMPER

COMMISSIONING NOTES:

MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE TO PROVIDE ALL DOCUMENTATION TO THE OWNER AS PER THE LISTED 2018 IECC CODE REFERENCES BELOW:

C408.2.1 A COMMISSIONING PLAN SHALL BE DEVELOPED BY A REGISTERED DESIGN PROFESSIONAL OR APPROVED AGENCY AND SHALL INCLUDE THE FOLLOWING ITEMS:

- A NARRATIVE DESCRIPTION OF THE ACTIVITIES THAT WILL BE ACCOMPLISHED DURING EACH PHASE OF COMMISSIONING, INCLUDING THE PERSONNEL INTENDED TO ACCOMPLISH EACH OF THE ACTIVITIES.
- A LISTING OF THE SPECIFIC EQUIPMENT, APPLIANCES OR SYSTEMS TO BE TESTED AND A DESCRIPTION OF THE TESTS TO BE PERFORMED.
- FUNCTIONS TO BE TESTED, INCLUDING, BUT NOT LIMITED TO CALIBRATIONS AND ECONOMIZER CONTROLS.
- CONDITIONS UNDER WHICH THE TESTS WILL BE PERFORMED. AT A MINIMUM, TESTING SHALL AFFIRM WINTER AND SUMMER DESIGN CONDITIONS AND FULL OUTSIDE AIR CONDITIONS.
- MEASURABLE CRITERIA FOR PERFORMANCE.

C408.2.4 PRELIMINARY COMMISSIONING REPORT. A PRELIMINARY REPORT OF COMMISSIONING TEST PROCEDURES AND RESULTS SHALL BE COMPLETED AND CERTIFIED BY THE REGISTERED DESIGN PROFESSIONAL OR APPROVED AGENCY AND PROVIDED TO THE BUILDING OWNER OR OWNER'S AUTHORIZED AGENT. THE REPORT SHALL BE ORGANIZED WITH MECHANICAL AND SERVICE HOT WATER FINDINGS IN SEPARATE SECTIONS TO ALLOW INDEPENDENT REVIEW. THE REPORT SHALL INCLUDE THE COMPLETED COMMISSIONING COMPLIANCE CHECKLIST, FIGURE C408.2.4, AND SHALL IDENTIFY:

- ITEMIZATION OF DEFICIENCIES FOUND DURING TESTING REQUIRED BY THIS SECTION THAT HAVE NOT BEEN CORRECTED AT THE TIME OF REPORT PREPARATION.
- DEFERRED TESTS THAT CANNOT BE PERFORMED AT THE TIME OF REPORT PREPARATION BECAUSE OF CLIMATIC CONDITIONS.
- CLIMATIC CONDITIONS REQUIRED FOR PERFORMANCE OF THE DEFERRED TESTS.
- RESULTS OF FUNCTIONAL PERFORMANCE TESTS.
- FUNCTIONAL PERFORMANCE TEST PROCEDURES USED DURING THE COMMISSIONING PROCESS, INCLUDING MEASURABLE CRITERIA FOR TEST ACCEPTANCE.

C408.2.4.1 ACCEPTANCE OF REPORT. BUILDINGS, OR PORTIONS THEREOF, SHALL NOT BE CONSIDERED AS ACCEPTABLE FOR A FINAL INSPECTION PURSUANT TO SECTION C105.2.6 UNTIL THE CODE OFFICIAL HAS RECEIVED THE PRELIMINARY COMMISSIONING REPORT FROM THE BUILDING OWNER OR OWNER'S AUTHORIZED AGENT.

C408.2.4.2 THE CODE OFFICIAL SHALL BE PERMITTED TO REQUIRE THAT A COPY OF THE PRELIMINARY COMMISSIONING REPORT BE MADE AVAILABLE FOR REVIEW BY THE CODE OFFICIAL.

C408.2.5 DOCUMENTATION REQUIREMENTS. THE CONSTRUCTION DOCUMENTS SHALL SPECIFY THAT THE DOCUMENTS DESCRIBED IN THIS SECTION BE PROVIDED TO THE BUILDING OWNER WITHIN 90 DAYS OF THE RECEIPT OF THE CERTIFICATE OF OCCUPANCY.

DOCUMENTS SHALL INCLUDE BUT ARE NOT LIMITED TO: DRAWINGS, MANUALS, SYSTEM BALANCING REPORT, AND FINAL COMMISSIONING REPORT.

DESIGN CONTACTS	
MECHANICAL ENGINEER:	MARK MAKIN
MECHANICAL PROJECT MANAGER:	CHRIS FALSLEV
MECHANICAL DESIGNER:	TRE PRESSON

PROJECT MECHANICAL NOTES:

- MECHANICAL CONTRACTOR TO PROVIDE AND INSTALL A 7-DAY PROGRAMMABLE THERMOSTAT FOR EACH FURNACE AND FAN COIL (PROVIDE PAIRING KIT AS REQUIRED). PROVIDE AND INSTALL A SIMPLE THERMOSTAT FOR EACH UNIT HEATER AND RADIANT TUBE HEATER. VERIFY THERMOSTAT LOCATION WITH OWNER'S REPRESENTATIVE IN FIELD. INSTALL THERMOSTAT AT 48" A.F.F.. PROVIDE AND INSTALL A HEAVY DUTY VANDAL RESISTANT COVER IN ALL COMMON AREAS.
- COORDINATE EXACT LOCATION OF ALL MECHANICAL UNITS WITH GENERAL CONTRACTOR. VERIFY IN FIELD.
- PROVIDE AND INSTALL OUTSIDE AIR SYSTEM AS SPECIFIED ON THE PLANS. SEE TYPICAL OUTSIDE AIR DETAIL FOR FAN COILS AND FURNACES.
- PROVIDE AND INSTALL ALL NECESSARY COMPONENTS FOR FURNACE/CONDENSING UNIT SYSTEMS. (IE REFRIGERANT LINES, COMBUSTION AIR PIPING, EXHAUST PIPING, CONCENTRIC TERMINATION KIT). ALL PER MANUFACTURER'S RECOMMENDATIONS.
- PROVIDE AND INSTALL ALL NECESSARY COMPONENTS FOR FAN COIL/HEAT PUMP UNIT SYSTEMS. (IE REFRIGERANT LINES, CONDENSATE PIPING, FILTER GRILLE(S), ACCESS PANELS (FIRE RATED AS REQUIRED), MOUNTING/SUPPORT HARDWARE, ETC.) ALL PER MANUFACTURER'S RECOMMENDATIONS.
- PROVIDE AND INSTALL MANUAL CONTROL DAMPERS AT EACH BRANCH TAKE-OFF. EACH SUPPLY AIR GRILLE SHALL BE DOWNSTREAM FROM A CONTROL DAMPER FOR BALANCING AND ADJUSTMENT. SOME INSTALLATIONS MAY REQUIRE OPPOSED BLADE DAMPERS OR CONCEALED DAMPER REGULATORS THAT ARE REMOTELY ADJUSTED.
- SIZING FOR EQUIPMENT COMBUSTION AIR AND VENT PIPING DETERMINED USING MANUFACTURER'S SPECIFICATIONS, ACTUAL LENGTH AND CONFIGURATION INFORMATION FROM FIELD.
- PROVIDE AND INSTALL FIRE DAMPERS IN MECHANICAL DUCT WITH REQUIRED ACCESS DOORS AT ALL FIRE RATED ASSEMBLY PENETRATIONS. FIRE BARRIER IS AT GYP. BOARD. VERIFY AND COORDINATE ASSEMBLY AND BARRIER LOCATIONS WITH ARCHITECTURAL PLANS.
- MECHANICAL CONTRACTOR TO PROVIDE DOCUMENTATION OF REQUIRED MANUFACTURER START-UP FOR EQUIPMENT INCLUDING MANUFACTURER, MODEL NUMBER, SERIAL NUMBER, COOLING CAPACITY, GAS HEATING INPUT, ALL ENTERING AND LEAVING TEMPERATURES, CONNECTED CIRCUIT VOLTAGE, AND VERIFICATION OF PROPER FUNCTION OF THERMOSTAT. CONTRACTOR SHALL PROVIDE MANUALS FOR EQUIPMENT AND NAME OF SERVICE AGENCY.
- MECHANICAL CONTRACTOR TO PROVIDE AND INSTALL SINGLE THICKNESS TURNING VANES AT EACH 90 DEGREE SQUARE DUCT ELBOW.
- USING CFM NOTED ON PLANS INSTALL GRILLES AND DIFFUSERS WITH MAXIMUM NOISE CRITERIA (NC) OF 25.
- DUCTWORK SIZING, ROUTING, AND LOCATION TO BE FIELD VERIFIED AND APPROVED FOR ANY CHANGES TO THE DUCT SIZING AND/OR ROUTING PRIOR TO DUCT FABRICATION AND INSTALLATION. DUCTWORK FABRICATED PRIOR TO FIELD VERIFICATION AND APPROVALS THAT NEEDS TO BE ALTERED WILL BE ALTERED AS NEEDED BY THE CONTRACTOR WITH NO ADDITIONAL COST TO THE OWNER.

DUCTWORK SEISMIC SUPPORT NOTES:

- PER ASCE STANDARD 7-22 SEISMIC SUPPORTS ARE NOT REQUIRED FOR THE FOLLOWING CONDITIONS:
 - HVAC DUCTS ARE SUSPENDED WITH HANGERS 12" OR LESS IN LENGTH.
 - HVAC DUCTS HAVE A CROSS-SECTIONAL AREA OF LESS THAN 6 SQUARE FEET.
- IF INSTANCES OCCUR WHERE HVAC DUCT IS SUSPENDED WITH HANGERS GREATER THAN 12" IN LENGTH AND HVAC DUCT HAS A CROSS-SECTIONAL AREA GREATER THAN 6 SQUARE FEET SYSTEM CONNECTORS AND COMPONENTS SHALL BE COMPATIBLE AND DESIGNED FOR THE APPLICATION THAT THEY ARE USED FOR. SHALL HAVE A MINIMUM OF TWO TRANSVERSE BRACES PER STRAIGHT DUCT RUN WITH A MAXIMUM DISTANCE OF 30' BETWEEN TRANSVERSE BRACES. SHALL HAVE A MINIMUM OF ONE LONGITUDINAL BRACE PER STRAIGHT DUCT RUN WITH A MAXIMUM DISTANCE OF 40' BETWEEN LONGITUDINAL BRACES. BRACING SHALL ONLY OCCUR AT OR NEAR AREAS WHERE SUFFICIENT DUCT STIFFNESS IS PRESENT (AT OR NEAR JOINT CONNECTIONS).
- FOR SEISMIC BRACING OF MECHANICAL EQUIPMENT AN INDEPENDENT SEISMIC AND VIBRATION CONTROL SUBCONTRACTOR WITH EXPERIENCE, COMPUTING CAPABILITIES, AND MANUFACTURED PRODUCTS SHALL BE FURNISHED BY MECHANICAL CONTRACTOR. INDEPENDENT SEISMIC CONSULTANT SHALL PROVIDE REQUIRED COMPUTATIONS, SHOP DRAWINGS, AND MANUFACTURED PRODUCTS TO MEET THE MINIMUM REQUIREMENTS OF ASCE 7-22 AND INTERNATIONAL BUILDING CODES (LATEST ADOPTED EDITION) FOR THE RESPECTIVE SEISMIC DESIGN FOR SEISMIC ZONE WITH IMPORTANCE FACTOR 1.5. SEISMIC SUBCONTRACTOR SHALL EXERCISE THE QUALITY CONTROL FOR THIS WORK AND SHALL NOT BE LIMITED TO INSTRUCTIONS DIRECTED TO THE MECHANICAL CONTRACTOR. THE SEISMIC SUBCONTRACTOR SHALL CERTIFY IN WRITING THAT THEY HAVE INSPECTED THE INSTALLATION AND THAT ALL ISOLATION ANCHORS AND SEISMIC RESTRAINT MATERIALS ARE INSTALLED CORRECTLY AND FUNCTIONING PROPERLY. CERTIFICATION SHALL BE PROVIDED AFTER ALL CORRECTIVE WORK HAS BEEN COMPLETED.

SUBMITTALS:

- CONTRACTOR TO ALLOW 10 WORKING DAYS FOR SUBMITTAL TURNAROUND.
- CONTRACTOR TO PROVIDE SUBMITTALS FOR ALL EQUIPMENT AND MATERIALS IN A SINGLE PACKAGE. PIECEMEAL SUBMITTALS WILL BE RETURNED WITH A NOTE TO REVISE AND RESUBMIT.
- SUBMITTALS WILL BE CHECKED FOR COMPLIANCE WITH CAPACITY REQUIREMENTS AND ELECTRICAL REQUIREMENTS. CONTRACTOR TO VERIFY THAT WEIGHTS, DIMENSIONS, AND DUCT CONNECTIONS ON SUBMITTED EQUIPMENT IS CONSISTENT WITH SCHEDULED EQUIPMENT PRIOR TO SUBMITTAL. CHANGES IN SCOPE BROUGHT ABOUT BY SUBMITTED EQUIPMENT THAT DOES NOT COMPLY WITH THE WEIGHTS, DIMENSIONS, OR CONNECTION LOCATIONS ON SCHEDULED EQUIPMENT SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR.

PROJECT MECHANICAL NOTES:

- ALL FRESH/OUTSIDE AIR INTAKES SHALL BE 10 FEET MIN. FROM ALL EXHAUST AND PLUMBING VENTS.
- ALL RETURN AIR AND SUPPLY AIR DUCTWORK IN UNCONDITIONED SPACES SHALL BE INSULATED PER APPLICABLE CODES.
- ALL EQUIPMENT SHALL HAVE A FLEXIBLE CONNECTION FOR THE RETURN AIR AND SUPPLY AIR DUCTWORK.
- BALANCE ALL SYSTEMS TO CFM NOTED AT EACH DIFFUSER AND GRILLE BY AN INDEPENDENT BALANCING CONTRACTOR.
- ALL GAS FIRED EQUIPMENT WILL BE TESTED BY CERTIFIED GAS INSTALLERS AND HAVE GREEN STICKERS STATING COMPLIANCE WITH ALL REQUIRED LOCAL AND 2018 IFGC REQUIREMENTS.
- HEATING LOADS COMPLETED USING CHVAC OR OTHER APPROVED CALCULATION METHODS.
- REFRIGERANT PIPING INSULATION.
- INSULATE ALL REFRIGERANT SUCTION PIPING WITH 1/2" THICK FLEXIBLE FOAMED PLASTIC CLOSED CELL PIPE INSULATION.
- INSULATION SHALL HAVE A "K" FACTOR OF NOT MORE THAN .26 AT 70°F AND A WATER VAPOR TRANSMISSION RATE OF 0.1 PERM-INCH OR LESS IN CONFORMANCE WITH ASTM C-177 AND ASTM C-355 WATER METHOD.
- WHEN INSULATION IS EXPOSED TO SUNLIGHT WRAP WITH POLYTAPE WITH ONE THIRD OVERLAP.
- INSTALL INSULATION BY SLITTING TUBULAR SECTIONS AND APPLYING OVER PIPING.
- PAINT ALL INSULATION AND/OR TAPE EXPOSED TO THE EXTERIOR WITH ULTRAVIOLET RESISTING PAINT.
- PROVIDE AND INSTALL B-VENT EXHAUST DUCT TO EXTERIOR FOR EACH GAS APPLIANCE. SIZING DETERMINED USING IFGC TABLE 504.2(1) AND 504.2(2) USING ACTUAL LENGTH AND CONFIGURATION INFORMATION FROM FIELD. COORDINATE IN FIELD WITH PLUMBING CONTRACTOR. PROVIDE CLAMPS TO SECURE B-VENT PIPE TO STRUCTURE. (UNIT HEATERS)
- COORDINATE ALL RETURN AIR AND SUPPLY AIR DUCTWORK AND DIFFUSERS IN FIELD WITH LIGHTING AND OTHER SYSTEMS.
- COORDINATE ALL WORK WITH OTHER TRADES AS REQUIRED.
- MECHANICAL CONTRACTOR SHALL PROVIDER AND INSTALL LINE VOLTAGE THERMOSTAT. ELECTRICAL CONTRACTOR SHALL PROVIDE AND INSTALL CIRCUIT CONDUIT AND MAKE CONNECTION. SET T-STAT AT 70°F. SEE EXHAUST FAN SCHEDULE FOR ADDITIONAL INFORMATION ON CONTROLS AND DIVISION OF LABOR WITH ELECTRICAL CONTRACTOR.

SITE CONDITIONS

SITE:
CITY: SPANISH FORK, UTAH
ELEVATION: 4,577'

OUTDOOR CONDITIONS:
WINTER: HTG: 3° F
SUMMER: CLG: 98° F
INDOOR CONDITIONS:
OFFICE AREA:
WINTER: HTG: 75° F
SUMMER: CLG: 72° F
SHOP/WAREHOUSE AREA:
WINTER: HTG: 55° F
SUMMER: CLG: N/A

IF TEMPERATURES SHOWN DO NOT MATCH CONDITIONS DESIRED FOR THIS PROJECT CONTACT THE ENGINEER OF RECORD.

SHEET INDEX	
SHEET NUMBER	SHEET TITLE
M0.1	MECHANICAL NOTES AND LEGENDS
M1.1	MECHANICAL FLOOR PLAN
M1.2	MECHANICAL MEZZ. PLAN
M5.1	MECHANICAL DETAILS
M5.2	MECHANICAL DETAILS
M6.1	MECHANICAL SCHEDULES
M7.1	MECHANICAL SPECIFICATIONS
M7.2	MECHANICAL SPECIFICATIONS
M7.3	MECHANICAL SPECIFICATIONS



ROYAL ENGINEERING

ELECTRICAL 1837 S. EAST BAY BLVD. PHONE: 801.375.2228

MECHANICAL PROVO, UTAH 84606 FAX: 801.375.2676

COPYRIGHT JOB# J22162.00 DATE PLOTTED: 03/29/2023

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INTENDED TO BE CONSIDERED WITH ROYAL ENGINEERING'S INTERPRETATION, OBSERVATIONS AND ASSUMPTIONS. USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT THE WRITTEN CONSENT OF ROYAL ENGINEERING IS PROHIBITED. ROYAL ENGINEERING AND OTHER RESERVES WITH THE AREA OF COPYRIGHT U.S. PAT. NO. 7,198,811, WHICH INCLUDES STATE AND LOCAL PUBLIC RECORD ACTS. REFER TO ALL U.S.C. PAR. 301 (1991).

Date: 03.03.2023

Revision:



Alan R. Poulson
Bruce T. Fallon

WPA
Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

BID/PERMIT SET - 05.19.2023


FACILITIES SHOP

SPANISH FORK CITY

433 SOUTH MAIN STREET

M0.1

MECHANICAL NOTES AND LEGENDS

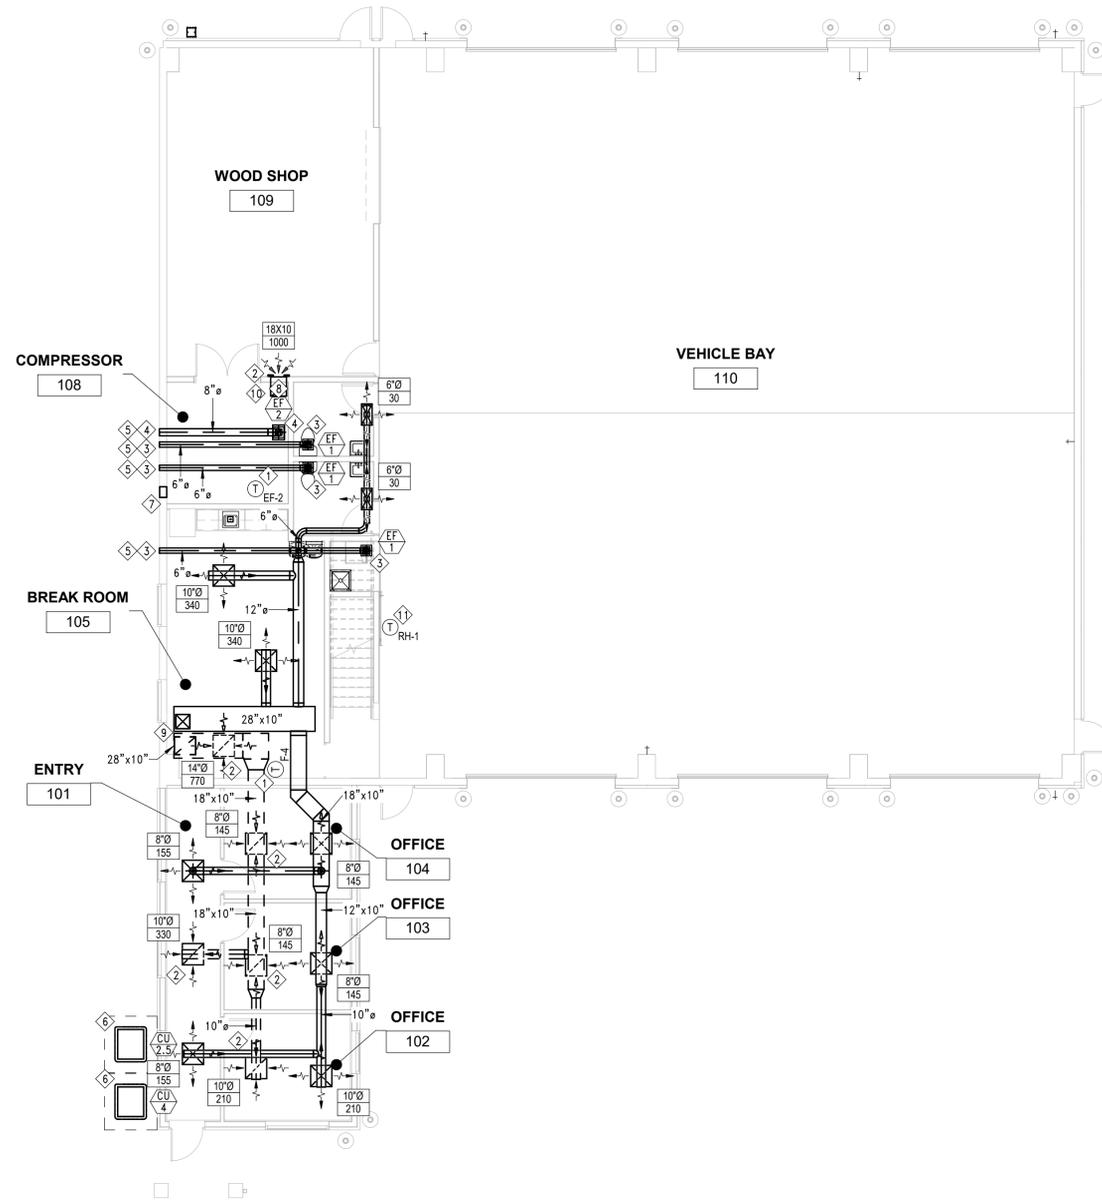

MAIN FLOOR MECHANICAL PLAN - BUILDING #1

1/8" = 1'-0"

MECHANICAL KEYED NOTES:

- 1 PROVIDE AND INSTALL 7-DAY PROGRAMMABLE THERMOSTAT. FIELD VERIFY THERMOSTAT LOCATION WITH OWNER'S REPRESENTATIVE. INSTALL THERMOSTAT AT 48" A.F.F. WITH HEAVY DUTY LOCKABLE COVER.
- 2 PROVIDE AND INSTALL RETURN AIR GRILLE CAPABLE OF CFM NOTED WITH AN NC OF NO GREATER THAN 25.
- 3 PROVIDE AND INSTALL 6" ROUND EXHAUST DUCT TO OWNER'S REPRESENTATIVE APPROVED EXHAUST VENT TERMINATION. VERIFY LOCATION IN FIELD. ACTUAL DUCT SIZE DETERMINED BY EXHAUST FAN OUTLET. EXHAUST TERMINATION SHALL 10' FROM FRESH AIR INTAKES.
- 4 PROVIDE AND INSTALL 8" ROUND EXHAUST DUCT TO OWNER'S REPRESENTATIVE APPROVED EXHAUST VENT TERMINATION. VERIFY LOCATION IN FIELD. ACTUAL DUCT SIZE DETERMINED BY EXHAUST FAN OUTLET. EXHAUST TERMINATION SHALL 10' FROM FRESH AIR INTAKES.
- 5 ALL EXHAUST AIR DUCTING SHALL TERMINATE WITH A BACKDRAFT DAMPER AND MANUFACTURER/OWNER'S REPRESENTATIVE RECOMMENDED TERMINATION GRILLE AT A MINIMUM OF 3 FEET FROM OPERABLE BUILDING OPENINGS AND 10' FROM MECHANICAL FRESH AIR INTAKES (IMC SECTION 501.3.1 #3).
- 6 PROPOSED LOCATION OF OUTDOOR CONDENSING UNITS/HEAT PUMPS INSTALLED ON COMMON MECHANICAL CURB SYSTEM(S). SEE SCHEDULES AND DETAILS FOR MORE INFORMATION.
- 7 PROVIDE AND INSTALL 12"x10" RELIEF AIR LOUVER WITH BAROMETRIC DAMPER (120 SO IN. MINIMUM AT 50% OPEN) AT 24" ABOVE FINISHED FLOOR. COORDINATE FINAL LOCATIONS WITH STRUCTURE AND ARCHITECTURAL DRAWINGS.
- 8 PROVIDE AND INSTALL THROW AWAY DISPOSABLE FOR WOOD SHOP AREA TO MINIMIZE SAWDUST ENTERING THE FURNACE.
- 9 ANTICIPATED LOCATION OF 16"x16" SUPPLY AIR AND 20"x24" RETURN AIR DROP FROM FURNACE ON MEZZANINE ABOVE. SEE MEZZANINE LEVEL FOR CONTINUATION.
- 10 ANTICIPATED LOCATION OF 18"x10" RETURN AIR DROP FROM FURNACE ON MEZZANINE ABOVE. SEE MEZZANINE LEVEL FOR CONTINUATION.
- 11 PROVIDE AND INSTALL A SIMPLE THERMOSTAT. FIELD VERIFY THERMOSTAT LOCATION WITH OWNER'S REPRESENTATIVE. INSTALL THERMOSTAT AT 48" A.F.F. WITH HEAVY DUTY LOCKABLE COVER.

These plans, drawings, and designs are the property of WPA-Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 03.03.2023



Alan R. Poulsen
Bruce T. Fallon

WPA Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

SPANISH FORK, UTAH 84660


FACILITIES SHOP
SPANISH FORK CITY

433 SOUTH MAIN STREET

M1.1
MECHANICAL FLOOR PLAN

ROYAL ENGINEERING
ELECTRICAL 1837 S. EAST BAY BLVD. PHONE: 801.375.2228
MECHANICAL PROVO, UTAH 84606 FAX: 801.375.2676
COPYRIGHT © JOB# J2162.00 DATE PLOTTED: 03/29/2023
THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INCOMPLETE UNLESS IN CONJUNCTION WITH ROYAL ENGINEERING INTERPRETATIONS, SPECIFICATIONS, OBSERVATIONS AND ADMINISTRATIVE USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT ROYAL ENGINEERING'S CONSENT IS PROHIBITED. ALL RIGHTS RESERVED. COPYRIGHT © 2011 BY ROYAL ENGINEERING. ALL RIGHTS RESERVED. REFER TO U.S.G. PAT. 5,119,811, WHICH PRESERVES STATE AND LOCAL PUBLIC RECORDS ACTS. REFER TO ACT 17 U.S.G. PAR. 201 (1991).

BID/PERMIT SET - 05.19.2023

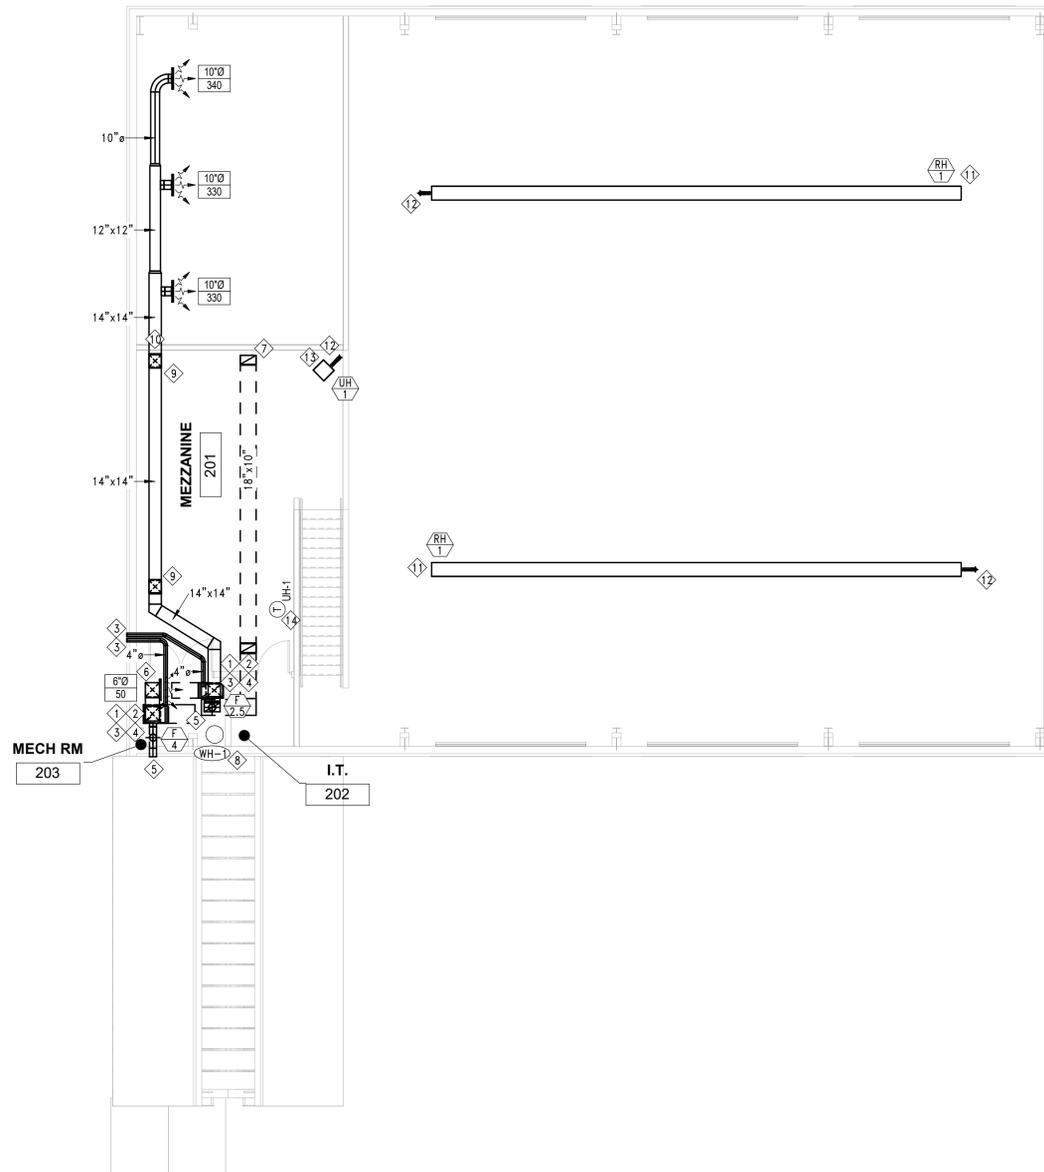

MEZZANINE MECHANICAL PLAN - BUILDING #1

1/8" = 1'-0"

MECHANICAL KEYED NOTES:

- 1 PROPOSED FURNACE LOCATION. SEE MECHANICAL PERFORMANCE NOTES, SCHEDULES AND DETAILS. MAKE ALL CONNECTIONS TO COMPLETE SYSTEM. COORDINATE FINAL LOCATION WITH OWNER'S REPRESENTATIVE.
- 2 PROVIDE AND INSTALL REFRIGERANT PIPING PER MANUFACTURER'S RECOMMENDATIONS.
- 3 ANTICIPATED ROUTING OF PVC EXHAUST AND COMBUSTION PIPING PER MANUFACTURER'S RECOMMENDATIONS SHOWN FOR REFERENCE. COORDINATE TERMINATION WITH PLUMBING CONTRACTOR TO MAINTAIN ALL REQUIRED CLEARANCES.
- 4 PROVIDE AND INSTALL CONDENSATE DRAIN PIPE FROM FURNACE COOLING COIL TO FLOOR DRAIN.
- 5 PROVIDE AND INSTALL 8" ROUND OUTSIDE AIR DUCT TO OWNER REPRESENTATIVE APPROVED TERMINATION. VERIFY EXACT LOCATION IN FIELD. MAINTAIN A MINIMUM OF 10' CLEARANCE FROM ALL EXHAUST AIR TERMINATIONS.
- 6 ANTICIPATED LOCATION OF 28"x10" SUPPLY AIR AND 28"x10" RETURN AIR RISER TO LEVEL BELOW.
- 7 ANTICIPATED LOCATION OF 18"x10" RETURN AIR RISER TO LEVEL BELOW.
- 8 ELECTRIC WATER HEATER TO BE INSTALLED BY PLUMBING CONTRACTOR. COORDINATE CLEARANCES.
- 9 ANTICIPATED LOCATION OF DUCT TRANSITION.
- 10 ANTICIPATED DUCT HEIGHT FOR THIS RUN TO BE 13' 0" FROM GRADE (2' 11" ON MEZZANINE LEVEL).
- 11 PROPOSED LOCATION OF RADIANT TUBE HEATER TO BE INSTALLED PER MANUFACTURER'S RECOMMENDATIONS (MINIMUM MOUNTING HEIGHT OF 14' A.F.F.). FIELD VERIFY EXACT LOCATION WITH OWNER'S REPRESENTATIVE AND STRUCTURE.
- 12 PROPOSED LOCATION OF 3" B-VENT TO ROOF VENT TERMINATION TO BE INSTALLED PER MANUFACTURER'S RECOMMENDATIONS. FIELD VERIFY FINAL LOCATION AND SIZING WITH OWNER'S REPRESENTATIVE AND STRUCTURE.
- 13 PROPOSED LOCATION OF UNIT HEATER TO BE INSTALLED PER MANUFACTURER'S RECOMMENDATIONS (MINIMUM MOUNTING HEIGHT OF 14' A.F.F.). FIELD VERIFY EXACT LOCATION WITH OWNER'S REPRESENTATIVE AND STRUCTURE.
- 14 PROVIDE AND INSTALL A SIMPLE THERMOSTAT. FIELD VERIFY THERMOSTAT LOCATION WITH OWNER'S REPRESENTATIVE. INSTALL THERMOSTAT AT 48" A.F.F. WITH HEAVY DUTY LOCKABLE COVER.

These plans, drawings, and designs are the property of WPA-Architect and shall not be reproduced in any form without written consent. All rights reserved.

Date: 03.03.2023
Revision:



Alan R. Pouison
Bruce T. Fallon

WPA Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

BID/PERMIT SET - 05.19.2023

FACILITIES SHOP

SPANISH FORK CITY









SPANISH FORK, UTAH 84660

433 SOUTH MAIN STREET

M1.2

MECHANICAL MEZZ. PLAN

ROYAL ENGINEERING
ELECTRICAL 1837 S. EAST BAY BLVD. PHONE: 801.375.2228
MECHANICAL 1837 S. EAST BAY BLVD. PROVO, UTAH 84606 FAX: 801.375.2676
COPYRIGHT © JOB# J22162.00 DATE PLOTTED: 03/29/2023
THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INCOMPLETE UNLESS IN CONJUNCTION WITH ROYAL ENGINEERING'S INTERPRETATIONS, SPECIFICATIONS, OBSERVATIONS AND ADMINISTRATIONS. USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT ROYAL ENGINEERING'S CONSENT IS A VIOLATION OF UTAH AND FEDERAL COPYRIGHT STATUTES AND OTHER RESERVED RIGHTS. REFER TO UTAH U.L.E.P. PAR. 31-11-901, WHICH PREEMPTS STATE AND LOCAL PUBLIC RECORD ACTS. REFER TO ACT 17 U.S.C. PAR. 201 (1991).

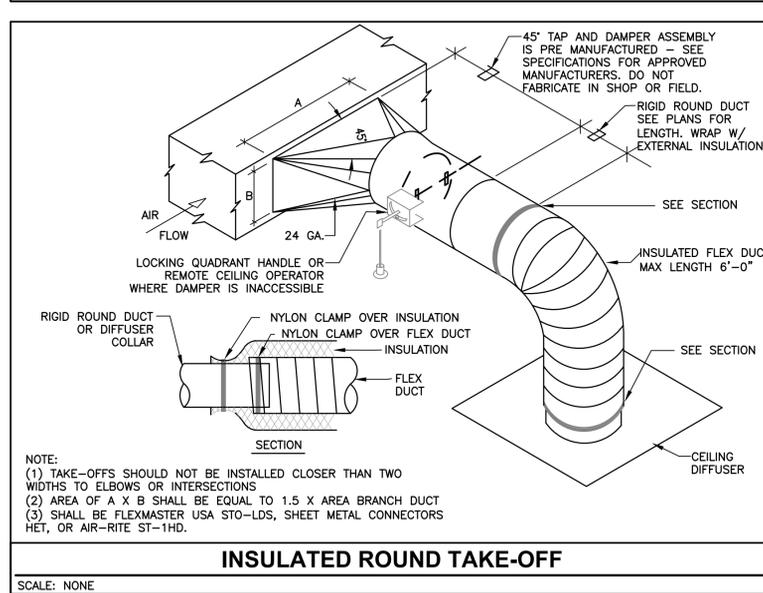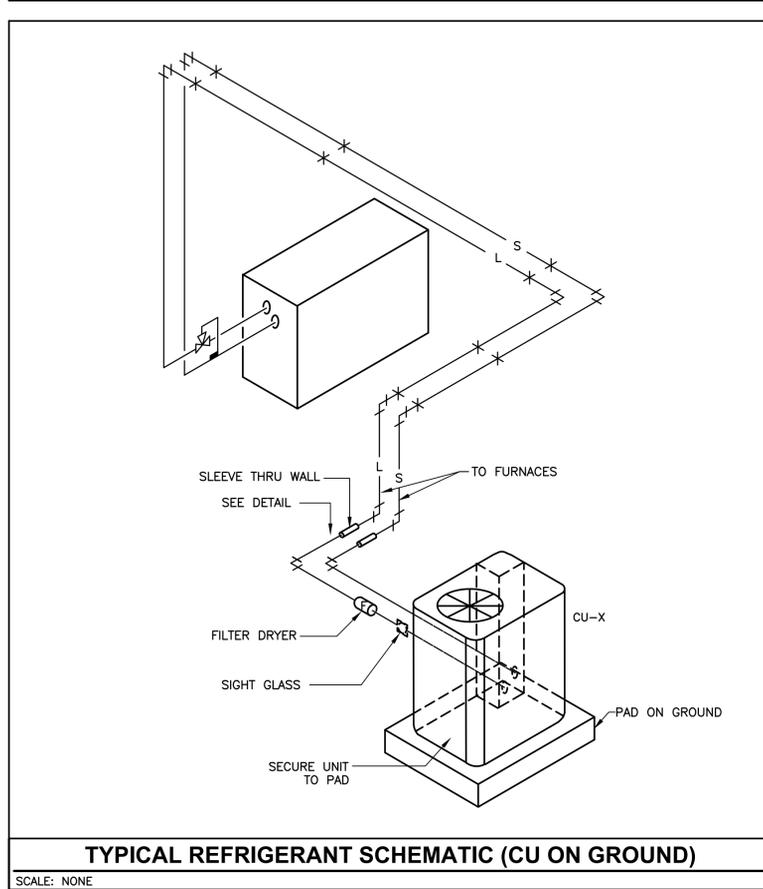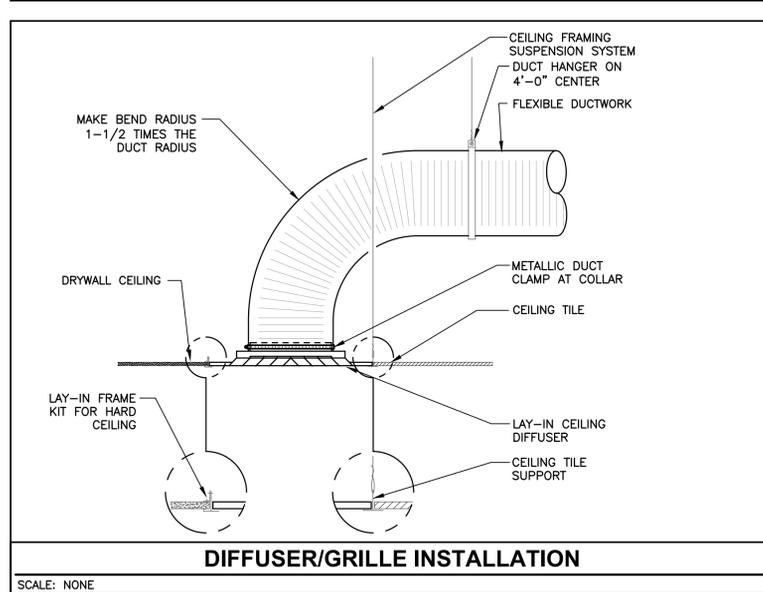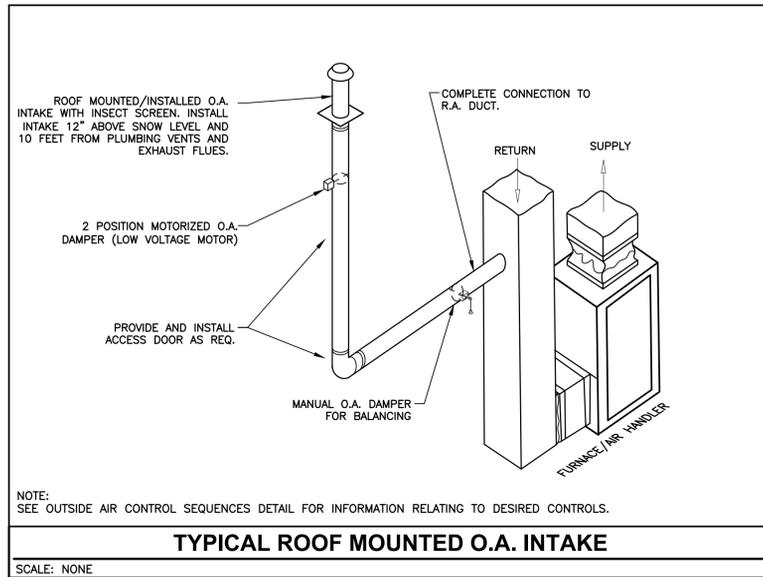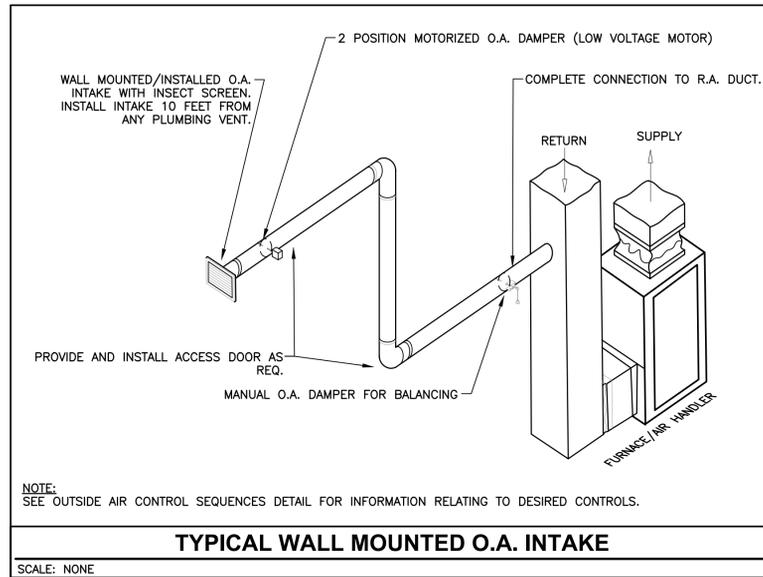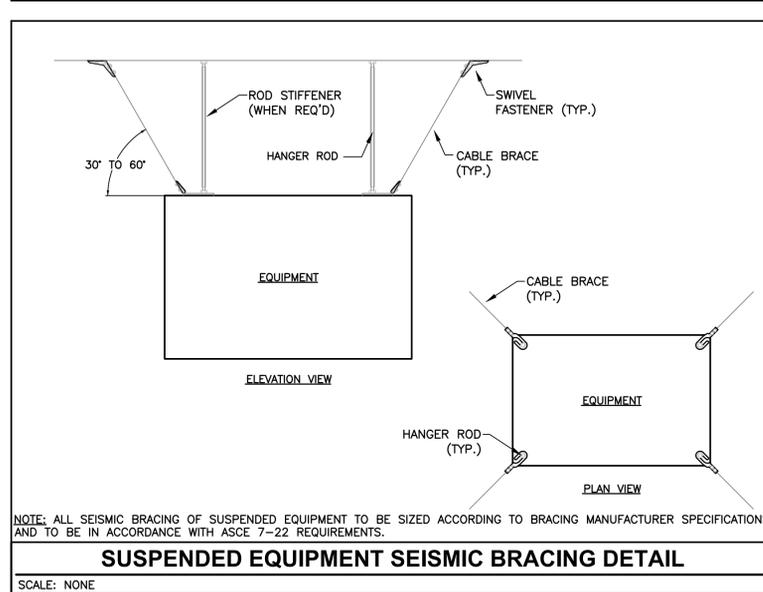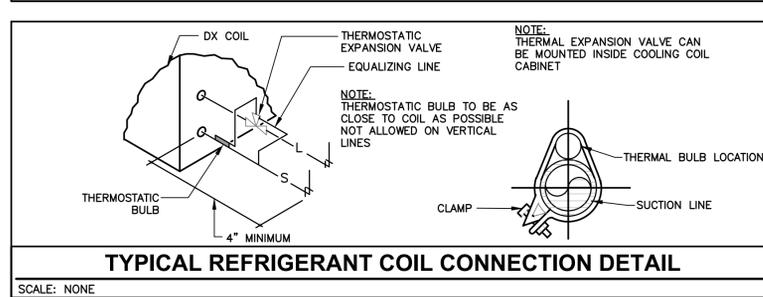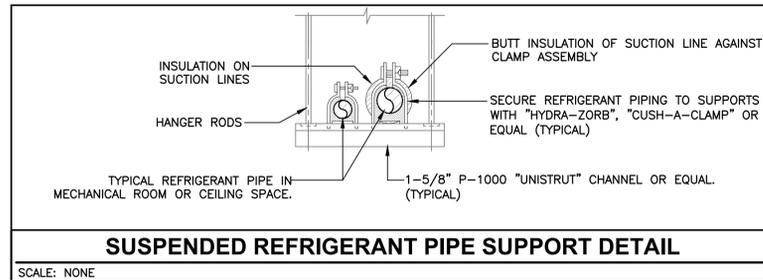

These plans, drawings, and designs are the exclusive property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 03.03.2023
 Revision:

Alan R. Poulson
 Bruce T. Fallon

WPA
Architecture
 475 North Freedom Blvd.
 Provo, Utah 84601
 Tel: (801) 374-0800
 info@wpa-architecture.com

SPANISH FORK, UTAH 84660

BID/PERMIT SET - 05.19.2023

FACILITIES SHOP

SPANISH FORK CITY


433 SOUTH MAIN STREET

ROYAL ENGINEERING
 ELECTRICAL MECHANICAL
 1837 S. EAST BAY BLVD. PROVO, UTAH 84606
 PHONE: 801.375.2228 FAX: 801.375.2676

COPYRIGHT © JOB# J22162.00 DATE PLOTTED: 03/29/2023

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INCOMPLETE UNLESS IN CONJUNCTION WITH OTHER ENGINEERING INFORMATION, OBSERVATIONS, AND/OR ADMINISTRATIVE USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT WRITTEN CONSENT IS IN VIOLATION OF UTAH AND FEDERAL COPYRIGHT LAWS AND OTHER APPLICABLE LAWS. THESE DOCUMENTS ARE THE PROPERTY OF ROYAL ENGINEERING AND SHALL BE KEPT IN CONFIDENTIALITY. THESE DOCUMENTS ARE NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF ROYAL ENGINEERING. UTAH PROFESSIONAL ENGINEERING ACT 33A-2-101(1), WHICH DOES NOT STATE AND LOCAL PUBLIC RECORD ACTS. REFER TO ASB 11-1981(1), WHICH DOES NOT STATE AND LOCAL PUBLIC RECORD ACTS. REFER TO ASB 11-1981(1).

M5.1
 MECHANICAL DETAILS

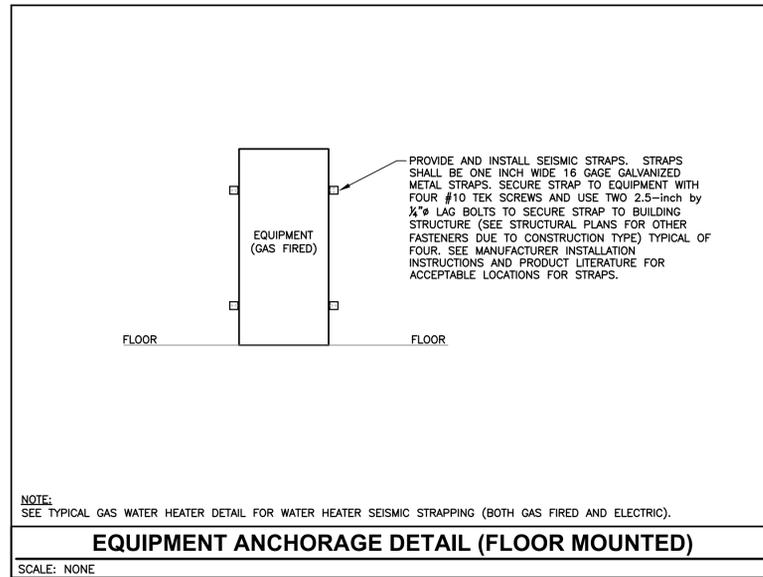







TRANSVERSE REINFORCING (1)

DIMENSION OF LONGEST SIDE, INCHES	SHEET METAL GAGE (ALL FOUR SIDES)	MINIMUM REINFORCING ANGLE SIZE AND MAXIMUM LONGITUDINAL SPACING BETWEEN TRANSVERSE JOINTS &/OR INTERMEDIATE REINFORCING	AT JOINTS				
			DRIVE SLIP	HEMMED S SLIP	ALTER'NT BAR SLIP	REINFORCED BAR SLIP	
			PLAIN S SLIP	RECOMMENDED GAUGE	RECOMMENDED GAUGE	RECOMMENDED GAUGE	RECOMMENDED GAUGE
UP THRU 12	26	NONE REQUIRED	1	26	26	24	24
13 - 18	24	NONE REQUIRED	1	24	24	24	24
19 - 30	24	1"x1"x1/8" @ 60 IN	1	24	24	24	24
31 - 36	22	1"x1"x1/8" @ 60 IN	1	-	-	22	22

(1) TRANSVERSE REINFORCING SIZE IS DETERMINED BY DIMENSION OF SIDE TO WHICH ANGLE IS APPLIED.
(2) LONGITUDINAL JOINTS TO BE PITTSBURG OR SNAP LOCK TYPE.
(3) ALL DUCTING TO BE CONSTRUCTED TO SMACNA INSTALLATION STANDARDS AND SPECIFICATIONS.

DUCT CONSTRUCTION DETAIL

SCALE: NONE

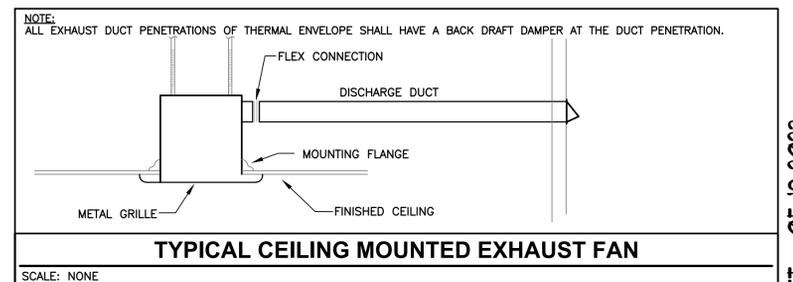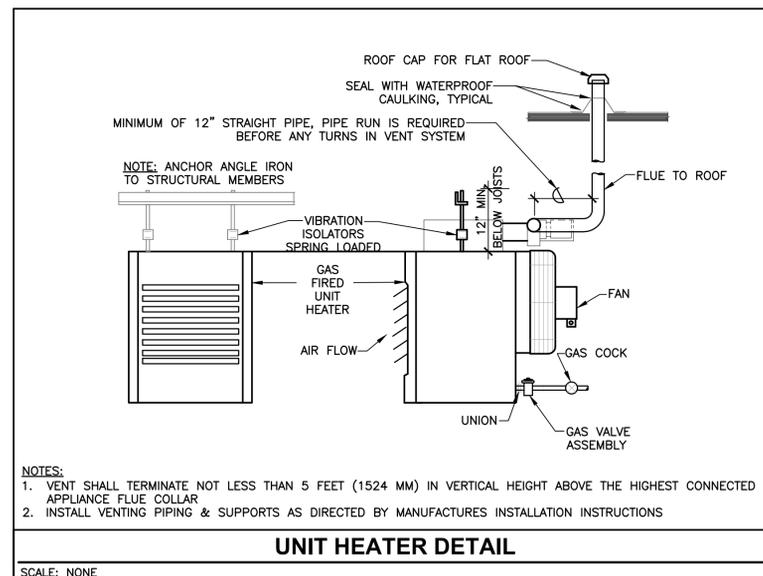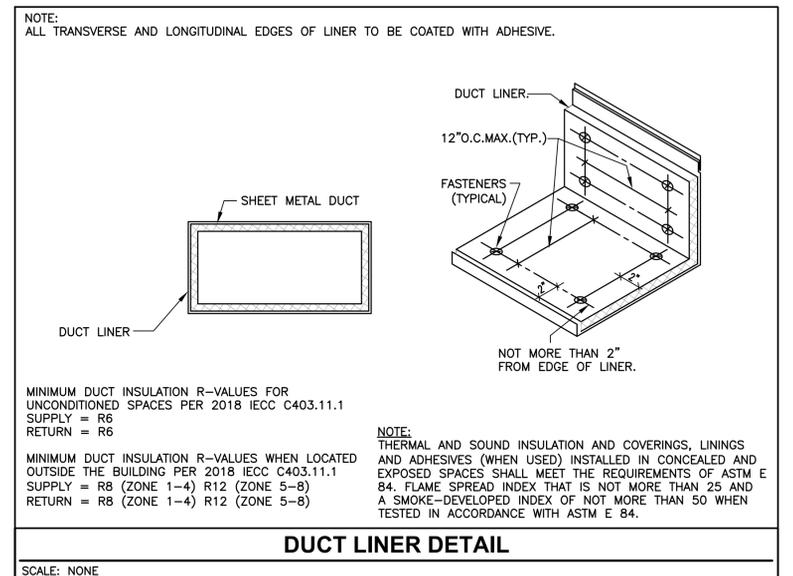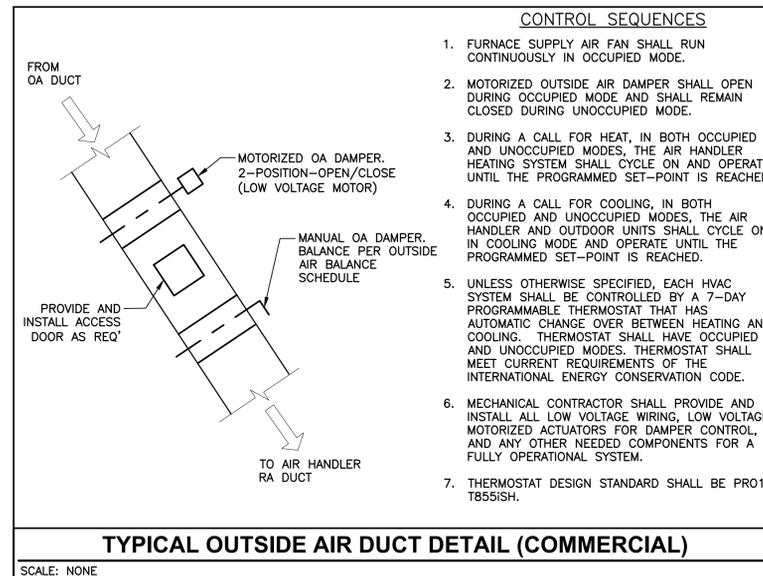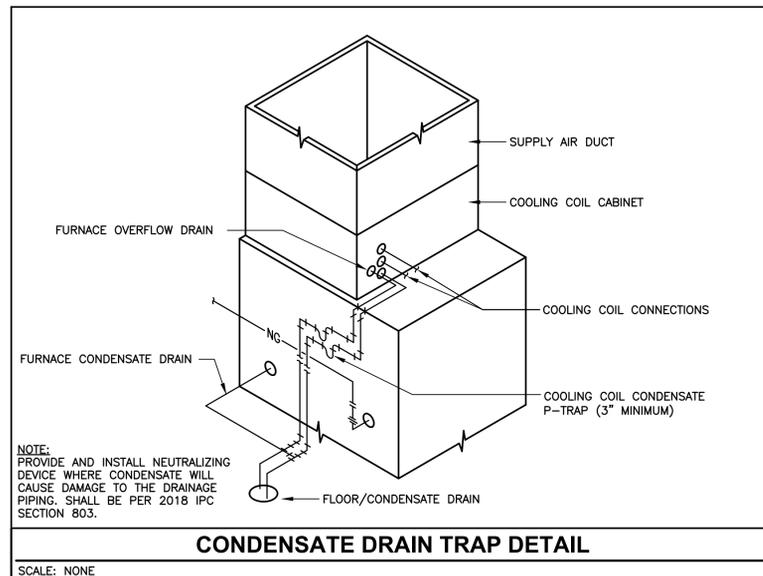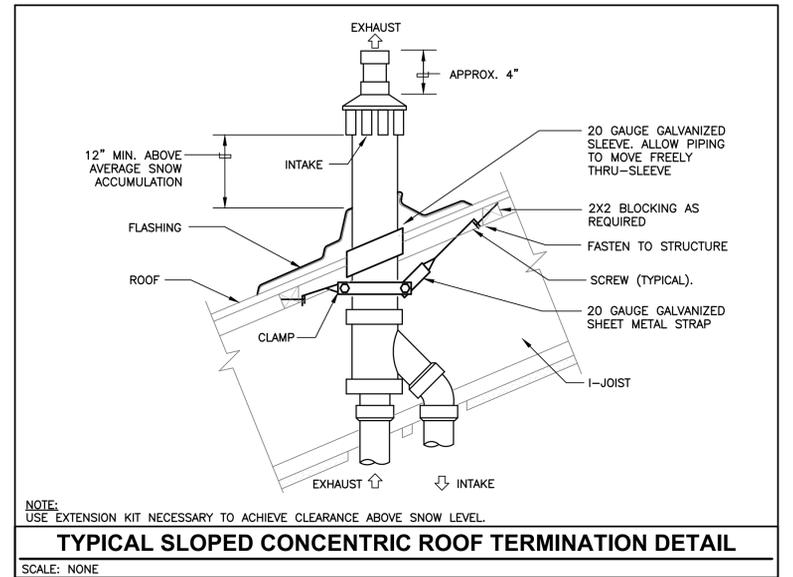

These plans, drawings, and designs are the exclusive property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 03.03.2023
 Revision:

MARK L. MAKIN
Professional Engineer
STATE OF UTAH

Alan R. Poulson
 Bruce T. Fallon

WPA Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

SPANISH FORK, UTAH 84680

BID/PERMIT SET - 05.19.2023

FACILITIES SHOP
 SPANISH FORK CITY

433 SOUTH MAIN STREET

ROYAL ENGINEERING
ELECTRICAL 1837 S. EAST BAY BLVD. PHONE: 801.375.2228
MECHANICAL 1837 S. EAST BAY BLVD. PROVO, UTAH 84606 FAX: 801.375.2676

COPYRIGHT JOB# J22162.00 DATE PLOTTED: 03/29/2023

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS SOLELY FOR THE USE OF THE CLIENT. ANY REPRODUCTION OR TRANSMISSION OF THESE DOCUMENTS IN ANY FORM OR BY ANY MEANS WITHOUT THE WRITTEN PERMISSION OF ROYAL ENGINEERING IS STRICTLY PROHIBITED. ROYAL ENGINEERING AND ITS AFFILIATES SHALL BE HELD HARMLESS FROM ANY AND ALL LIABILITY, INCLUDING REASONABLE ATTORNEY'S FEES, ARISING FROM THE USE OF THESE DOCUMENTS IN ANY MANNER OTHER THAN THAT AUTHORIZED BY THE CLIENT. THIS AGREEMENT SHALL BE GOVERNED BY THE LAWS OF THE STATE OF UTAH. U.S.G. PAR. 301 (1991).

M5.2
 MECHANICAL DETAILS

FURNACE 95% AFUE (1-STAGE, SPLIT SYSTEM)																			
FURNACE										CONDENSING UNIT									
MARK	NOMINAL COOLING SUPPLY CFM	ESP (IN)	COOLING EAT DB/WB (°F)	COOLING LAT DB/WB (°F)	MINIMUM COOLING AT SITE (BTU/hr)	MINIMUM HEATING AT SITE (BTU/hr)	HEATING EAT/LAT DB (°F)	ELECTRICAL			MARK	MINIMUM NOMINAL SIZE (TONS)	ELECTRICAL			SEER	REFRIGERANT	MAX OPERATING WEIGHT	REMARKS
								VOLT/PH/HZ	UNIT MCA	UNIT MOCP			VOLT/PH/HZ	UNIT FLA	UNIT MOCP				
F 2.5	1,000	0.5	80/62	55.6/53.5	30,000	30,000	65/95	120/1/60	9.8	15	CU 2.5	2.5	208/1/60	16.8	30	15	R410	165	1 2 3 4 5 6
F 4	1,600	0.5	80/62	55.3/53.6	45,000	60,000	65/95	120/1/60	16.3	20	CU 4	4	208/1/60	26.1	40	15	R410	275	1 2 3 4 5 6

1 SITE CONDITIONS ARE 98/62° DB/WB SUMMER, 3°F DB WINTER, AND AN ELEVATION OF 4,577 FEET ABOVE SEA LEVEL.
 2 APPROVED MANUFACTURERS: AMERICAN STANDARD, CARRIER, LENNOX, TRANE, YORK. (SUBJECT TO DOCUMENT CONFORMANCE).
 3 WITH CONCENTRIC VENT KIT AND TXV.
 4 MATCH COOLING COIL WITH CONDENSING UNIT. SHALL BE COMPATIBLE WITH FURNACE. FURNACE SHALL BE DESIGNED FOR MULTI-POSITION INSTALLATION. COORDINATE COIL WITH FURNACE ORIENTATION.
 5 SINGLE STAGE HEATING AND COOLING.
 6 WITH LOW AMBIENT OPERATION KIT AND HARD-START ASSIST AT CONDENSING UNIT.

RADIANT TUBE HEATER SCHEDULE							
MARK	DESCRIPTION	ELECTRICAL		MIN. REQ'D INPUT BTU/HR	NOMINAL LENGTH (FEET)	DESIGN GUIDE	REMARKS
		FLA	VOLTAGE				
RH 1	TUBE HEATER	1.7	115V	125,000	50	REZNR VPT	1, 2, 3, 4

1. APPROVED MANUFACTURERS: RE-VERBER-RAY, SUPERIOR, SOLARONICS, REDD-I, SCHWANK, COMBUSTION RESEARCH, REZNR, DORNBACK, AMBIRAD. (SUBJECT TO PROJECT DOCUMENT CONFORMANCE)
 2. POLISHED REFLECTOR AND ALL MOUNTING HARDWARE.
 3. PROVIDE AND INSTALL EXTERNAL THERMOSTAT.
 4. INSTALL AT HEIGHT AND CLEARANCES TO COMBUSTIBLES AS RECOMMENDED BY INSTALLATION INSTRUCTIONS.

NOTE: VERIFY ALL EQUIPMENT MANUFACTURERS, EFFICIENCIES, AND OPTIONS WITH OWNER BEFORE ORDERING.

OUTSIDE AIR BALANCING SCHEDULE				
MARK	ZONE / AREA	BALANCE TO CFM	MINIMUM DUCT SIZE	REMARKS
F 2.5	WOODSHOP	175	8"	SEE OUTSIDE AIR DUCT DETAIL
F 4	OFFICE AREA	170	8"	SEE OUTSIDE AIR DUCT DETAIL

CEILING EXHAUST FAN SCHEDULE									
MARK	NOMINAL CFM	TOTAL STATIC PRESSURE IN. W.C.	ELECTRICAL				SOUND RATING SONES	SELECTION BASED ON GREENHECK MODEL	REMARKS
			RATED LOAD WATTS	VOLTS	HERTZ	PHASE			
EF 1	50	0.25	15.2	115	60	1	1.2	SP-B80	1 2 3 4
EF 2	250	0.25	32.3	115	60	1	3.0	SP-A390-VG	1 2 3 4

1 APPROVED MANUFACTURERS: BROAN, FANTECH, ACME, CARNES, PENN, COOK, BREIDERT, COOLAIR, CAPTIVE AIRE, S&P, GREENHECK, TWIN CITY FAN, DELTA BREEZ, AIR KING. (SUBJECT TO PROJECT DOCUMENT CONFORMANCE)
 2 CONTROL WITH LIGHTS BY ELECTRICAL CONTRACTOR.
 3 EXHAUST FAN SHALL HAVE INTEGRAL BACKDRAFT DAMPER.
 4 WITH METAL GRILLE KIT.
 5 MECHANICAL CONTRACTOR SHALL PROVIDE LINE VOLTAGE THERMOSTAT. ELECTRICAL CONTRACTOR SHALL PROVIDE AND INSTALL CIRCUIT CONDUIT AND MAKE CONNECTION. SET T-STAT AT 70 deg F.

UNIT HEATER SCHEDULE								
MARK	DESIGN GUIDE	GAS CAPACITIES		ELECTRICAL			MAX OPERATING WEIGHT LBS	REMARKS
		INPUT BTUH	OUTPUT BTUH	VOLTS/PH/HZ	NOMINAL LOAD WATTS	FULL LOAD AMPS		
UH 1	REZNR UBX SERIES	30,000	24,600	120/1/60	109	1.9	90	1, 2, 3, 4, 5, 6

1. APPROVED MANUFACTURERS: REZNR, MODINE, STERLING, YORK, TRANE (SUBJECT TO PROJECT DOCUMENT CONFORMANCE)
 2. CEILING HUNG WITH ALL MOUNTING HARDWARE.
 3. CONTRACTOR SHALL INSTALL EQUIPMENT PER MANUFACTURER'S SPECIFICATIONS FOR EXHAUST PIPING/VENTING, COMBUSTION INTAKE/PIPING, GAS PIPING/CONNECTION AND CLEARANCES TO COMBUSTIBLES.
 4. WITH DOWNTURN/DISCHARGE NOZZLE/HOOD AS RECOMMENDED PER MANUFACTURER'S INSTALLATION INSTRUCTIONS.
 5. PROVIDE AND/OR INCLUDE ALTITUDE KIT/ADJUSTMENT AS REQUIRED PER MANUFACTURER'S INSTALLATION INSTRUCTIONS.
 6. ELECTRICAL CONTRACTOR SHALL VERIFY CONNECTION REQUIREMENTS (i.e. VOLTAGE, PHASE, MCA, MOCP, ETC.) WITH MECHANICAL SUBMITTALS BEFORE ROUGH IN.

These plans, drawings, and designs are the exclusive property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 03.03.2023
 Revision:



MARK L. MAKIN
7/29/23

Alan R. Poulson
 Bruce T. Fallon



WPA Architecture
 475 North Freedom Blvd.
 Provo, Utah 84601
 Tel: (801) 374-0800
 info@wpa-architecture.com

SPANISH FORK, UTAH 84608

SPANISH FORK CITY

433 SOUTH MAIN STREET

M6.1

MECHANICAL SCHEDULES

BID/PERMIT SET - 05.19.2023



ROYAL ENGINEERING
 1837 S. EAST BAY BLVD. PROVO, UTAH 84606
 PHONE: 801.375.2228 FAX: 801.375.2676

COPYRIGHT © JOB# J22162.00 DATE PLOTTED: 03/29/2023

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INCOMPLETE UNLESS IN CONJUNCTION WITH ARCHITECTURAL PREPARATIONS, DESCRIPTIONS, SPECIFICATIONS AND ADMINISTRATIVE USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT WRITTEN PERMISSION CONSTITUTES A VIOLATION OF UTAH AND FEDERAL COPYRIGHT LAWS AND OTHER APPLICABLE LAWS. UTAH U.C.A. § 33-2-10(1), WHICH DOES NOT STATE AND LOCAL PUBLIC RECORD ACTS. REFER TO ACT 17 U.S.C. PAR. 301 (1991).

SECTION 23 Mechanical – GENERAL PROVISIONS
Not all specification items are used in every project.

PART 1 – GENERAL

- **Scope:**
 - A. Provisions of this section apply to all work specified in all sections under Division 23.
 - B. In addition, work in Division 23 is governed by the provisions of the Bidding Requirements, Contract Forms, General Conditions and all sections under Division 1, General Requirements.
 - C. Contractor is responsible for results deviating from the plans.
- **Examination of Premises:** Visit the site, verify all measurements and job conditions, and pay all costs necessary to perform the work. Coordinate division of fee responsibilities with the General Contractor.
- **The Mechanical Contractor** shall be licensed and hold a current contracting license that has been valid for a minimum of two years as a Mechanical Contractor in the State where the project is located.
- **The Mechanical Contractor** shall have a minimum of five years experience installing commercial cooling and heating systems similar to those described in these specifications and provide a list of previous projects, including name of project and contact person names and phone numbers as a separate document in addition to the mechanical bid submitted if required by the General Contractor.
- **The Mechanical Contractor** shall be able to bond work he is bidding to perform and shall provide a written statement from the bonding agency proposed to be used for this project as a separate document in addition to the mechanical bid submitted if required by the General Contractor. The bonding agency shall be one having a Best's insurance rating of A or A+.
- **Regulations, Permits, Fees, Charges, Inspections:**
 - A. Regulations: Comply with all applicable codes, rules and regulations. All materials and work must comply with local construction, mechanical, plumbing, electrical and fire codes. As a minimum, comply with the following: IBC, IMC, IPC, NEC, NFPA codes and all City codes.
 - B. In addition to the requirements of all governing codes, ordinances and agencies, conform to the requirements of the following codes and standards:
 1. 2018 International Mechanical Code
 2. 2018 International Building Code
 3. 2018 International Energy Conservation Code
 4. 2018 International Plumbing Code
 5. 2020 International Electrical Code
 6. 2018 International Fuel Gas Code
 7. ASHRAE 90.1 – 2016***Current codes adopted by the respective jurisdiction will supercede this list of codes.
 - C. Fees and Permits: Pay all connection, installation, use, development, etc., fees and/or charges. Obtain and pay for all required permits and licenses. Coordinate division of fee responsibilities with the General Contractor.
 - D. Inspections: All work must be inspected and approved by local authorities. Prior to final approval, furnish the Architect with certificates of inspections and approvals by the local authorities in accordance with Division 1.
 1. Preheat and interpass temperature shall be determined by temperature indicating crayons, contact pyrometers or other equally suitable means.
 - D. Postweld Heat Treatment: Postweld heat treatment for pressure components shall be as specified in Table 131 of ANSI B31.1.
- **Drawings and Specifications:**
 - A. Refer to Division 1 for information on submittals and shop drawings.
 - B. If a conflict exists between the drawings and specifications, promptly notify the Architect and Engineer.
- **Record Drawings:** Provide record drawings for all work under sections in Division 22 and 23. See Division 1 for detailed requirements covering preparation of record drawings.
- **Work and Materials:** Unless otherwise specified, all materials must be new and of the quality specified. The workmanship shall be of a quality that is acceptable to the Architect and is equal to the standards of the trades. Contractor must staff the project with sufficient skilled workmen, including a fully qualified construction Superintendent, to complete the work in the time allotted. The Superintendent must be qualified to supervise all of the work in his work category.
- **Approvals of Materials and Equipment:** Refer to Division 1 for description of the material and equipment for prior approvals and substitutions. Must be received by Engineer 10 days prior to due date/bid opening.
- **Maintenance Manual:**
 - A. Prior to completion of the project, compile a complete equipment and maintenance manual for all equipment supplied under sections of Division 23, as described in Division 1.
 - B. Manuals shall be bound in a three-ring binder. A preliminary submittal of the manual shall be made to the Architect 90 days after receiving approved submittals. Final submittal of the manual shall be made four weeks prior to substantial completion of the project.
- **Equipment Purchases:** Arrange for purchase and delivery of all materials and equipment within 15 days after approval of submittals. Coordinate with General Contractor.
- **Cooperative Work:**
 - A. Correct without charge any work requiring alteration due to lack of proper supervision or failure to make proper provision in time. Correct without charge any damage to adjacent work caused by the alteration. See Division 1 for additional requirements.
 - B. Cooperative Work Includes:
 1. General supervision and responsibility for proper location, rough-in and size of work related to Division 22 and 23 but provided under other divisions of these specifications.
 2. Installation of sleeves, inserts and anchors bolts for work under sections in Division 23.
 3. Electrical work as specified herein. Refer to Division 26 for requirements.
- **Construction Facilities:**
 - A. General: Under this division of the specifications execute all work in a manner to provide safe and lawful ingress and egress to the Owner's establishment and such facilities shall be kept clear of materials or equipment as directed by the Architect. Refer to Division 1 for additional requirements.
 - B. Furnish and maintain from the beginning to the completion of all work all lawful and necessary guards, railings, fences, canopies, lights, and warning signs. Take all necessary precautions required by city and state laws to avoid injury or damage to any and all persons and property.
- **Guarantee:** Guarantee all material, equipment, and workmanship for all sections under Division 23 in writing to be free from defects of material and workmanship for one year from date of final acceptance as outlined in Division 1. Replace without charge any material or equipment proving defective during this period. The guarantee shall include performance of the equipment under all conditions of load, installing any additional items of control and/or protective devices as required and the replacing of any refrigerant lost.
- **Mechanical Wiring:**
 - A. Provide all temperature control wiring, all interlock wiring, and equipment control wiring for the equipment that is to be provided under this Division unless specifically shown on electrical drawings.
 - B. All wiring shall be not less than No. 14 insulated, color coded wire in electrical metallic tubing. Installation shall comply with Division 26.
 - C. Before ordering motors, equipment, etc., verify the available voltage and phase with the electrical trades.ion 26.

- **Electrical Work:**
 - A. Electrical wiring, including power wiring and control wiring (except as otherwise specified under Automatic Temperature Controls), all raceways, wiring, outlet and junction boxes, and labor for installation of the wiring and equipment shall be included in Electrical Division 26 of the specifications.
 - B. All starters in motor control centers are to be furnished and installed under the Electrical Division of the specifications.
 - C. Under the Automatic Temperature Control section of these specifications, furnish and install all wiring, conduit, electric automatic temperature control devices, thermostats, relays, pneumatic electric switches, automatic control switches and pilot lights. See the Automatic Temperature Control Section, for additional detailed information.
 - D. All loose starters and control devices for equipment furnished under Division 23 (except as otherwise specified under Automatic Temperature Control Section) are to be furnished under that particular section of Division 23 and installed under the electrical division.
 - E. Contractor shall be responsible for the checking and testing of all controls and the interlocks for a complete and satisfactory operating system.
 - F. Before ordering any motors and equipment. Verify the available voltage and phase for all motors with the Electrical Contractor.
 - G. Submit a complete list of all motors prior to final closeout of job indicating the location, horsepower, voltage, phase specified in Table 132 of ANSI B.1.
 - H. All field wiring and equipment must conform to the applicable section of the Electrical specifications, Division 26.
- **Welding Codes and Standards:** All welding and other criteria covered by this specification shall be in accordance with the following code:
 - A. ASME Boiler and Pressure Vessel Code
 - B. Section IX ANSI Code for Power Piping: B31.1
- **Product Handling**
 - A. Protection: Take all precautions necessary to protect the materials of this section, before, during and after installation.
 - B. Replacements: In the event of damage immediately repair all damaged and defective work to the approval of the Engineer, at no additional cost to the Owner.
- **Job Conditions**
 - A. Examination of site: Examine the site and include in bid proposal all conditions under which work is to be performed.
- **Miscellaneous**
 - A. Permit and Fees: Apply and pay for all necessary permits, inspections, examinations and fees or charges required by Public Authorities having jurisdiction.
 - B. Locations and Accessibility: Contractor shall fully inform himself regarding peculiarities and limitations of space available for installation of work under this section. Valves, motors, controls and other devices requiring service. Maintenance and adjustments shall be placed in fully accessible positions and locations, provide access doors where required in ductwork and/or construction whether specifically detailed or not, and mender all such devices accessible.
 - C. Scaffolding: Furnish all scaffolding, rigging and hoisting as required for the proper execution of the work.
 - D. All HVAC equipment shall be labeled. Information on labels shall include: Identification number and name same as the drawings, flow and static pressure and the area to which the unit serves. Labels shall be black faced Formica with white engraved lettering at least 1/8" inch high.
 - E. All gas fired equipment shall include a label indication that the appliance has been adjusted, modified or re-calibrated for the altitude wherein the project is to be located. The appliance shall also include a compliance statement indicating that the appliance has been adjusted, modified or re-calibrated for the proper operation at the altitude of the project and shall be listed capable for use with natural gas or propane gas if propane is listed on the drawings.
- **Submittals**
 - A. Shop Drawings: Within 15 days after award of contract, and before any of the materials of this section are fabricated and delivered to the jobsite, submit complete shop drawings and equipment submittals for the Engineer to review in accordance with these specifications. show all details of all ductwork and equipments pads.
 - B. Product Data:
 1. Submit six (6) copies of all manufacturer's product data simultaneously with all shop drawings submittals.
 2. Product data to include, all air conditioning equipment, hangers, fans and other standard items as required to complement shop drawings for a submittal indications products to be used on this work.
 - C. Record Drawings: Maintain throughout the progress of the work project record drawings and submit to the Owner.
 - D. Operating Manuals and Maintenance Manuals:
 1. Submit four (4) copies of all operating instructions and maintenance manuals.
 2. Fully instruct Owner's operating personnel and demonstrate performance, operation and maintenance of equipment. Amount of allocated for said instruction and demonstration of equipment and systems shall be part of these obligations. Submit to Engineer a letter signed by Owner's representative who will operate system stating that he has been fully instructed by contractor about operation and maintenance of equipment and system.
 3. Submit one (1) additional set of approved instructions and one (1) additional set of approved control diagrams.
 - E. Guarantees: In addition to equipment warranties, furnish a written guarantee against defects in materials and workmanship for one year. Guarantee shall include repair of damage to, or replacement of any part of equipment or premises caused by leaks or breaks in pipe or equipment provided under this section.
- **Equipment Identification**
 - A. Except for individual room heating units and items furnished under temperature control all items of mechanical equipment, including fans, pumps, boilers and electrical switches and starters for mechanical equipment and gauges shall be labeled.
 - B. Information on labels shall include the following:
 1. Identification number and name. Generally this number and name shall be the same as that shown on the drawings or in the specs.
 2. If the item is a fan or pump, the flow and head shall be indicated.
 3. If the item is part of a unit, the label shall have in addition to its item number, the number of the main item it is serving.
 4. Valves shall be tagged with the area served and their normal operating positions shall be indicated.
 5. Where the main unit is served by the valve is apparent, only the valve function needs to be included on the nameplate.
 - C. The types of Nameplates shall be as follows:
 1. The valve tags shall be 1/4" embossed aluminum tapes with identification on one side for valves. Tags for magnetic starters shall be screwed to the metal starter cover. Gags sags shall be Addressograph No. B-5300.
 2. Equipment nameplates shall be black faced Formica with white engraved lettering at least 1/8" high.
 - D. Valve tags shall be connected to valve stems by steel rings or chains. Screws shall be used for equipment labels prior to installation. The contractor shall submit to the Engineer a complete list of all valves and each item of equipment to be identified with the proper identification.

Fire Stopping

- A. Only tested fire stop systems shall be used.
- B. Fire stop system installation must meet requirements of ASTM E-814, UL 1479 or UL 2079 tested assemblies that provide a fire rating equal to that of construction being penetrated.
- C. Proposed fire stop materials and methods shall conform to applicable having codes having local jurisdiction.
- D. Fire stop systems do not reestablish the structural integrity of the load bearing partitions/assemblies, or support live loads and traffic. Installer shall consult the Structural Engineer prior to penetrating any load bearing assembly.
- E. For those fire stop applications that exist for which no UL tested system is available through a manufacturer, and engineering judgment derived from similar UL system design or other test will be submitted to local authorities having jurisdiction for their review and approval prior to installation. Engineer judgment drawings must follow requirements set forth by the International Fire stop Council.
- F. The work of this section shall be accomplished by a single source contractor or by those contractors who, by their contract, are penetrating rated construction with their work. Regardless of responsibility the General Contractor shall be responsible to assure and verify that all products, systems, etc. used under this section are appropriate and meet the intent of this specification and is accomplished by factory trained workmen.
- G. Acceptable manufacturers are subject to compliance with through penetration firestop systems (XHEZ) listed in volume 2 of the UL fire resistance directory. Provide products from the following manufacturers as identified: 1. Hilti Inc. 2. 3M Corporations. 3. Specified Technologies Inc. 4. Metacaulk, Rectorseal Corp. F. Tremco. 6. Catco, Isolotek International. 7. Nelson Firestop Product.
- H. Use only firestop products that have been UL 1479, ASTM E-814, or UL 2079 listed for specific fire-rated construction conditions conforming to construction assembly type, penetrating item type, annular space requirements and fire-rating involved for each separate instance.
- I. Cast-in-place firestop devices for use with non-combustible and combustible plastic pipe (closed and open piping systems) penetrating concrete floors, the following products are acceptable:
 1. HILTI CP 680 cast-in-place firestop device.
- J. Add aerator adaptor when used in conjunction with aerator ("Sovent") system.
 1. HILTI CP 681 tub box kit for use with tub installations.
- K. Sealants, caulking materials, or foams for use with non-combustible items including steel pipe, copper pipe, rigid steel conduit and electrical metallic tubing (EMT). The following products are acceptable:
 1. HILTI FS-One Intumescent Firestop Sealant
 2. HILTI CP 604 Self-leveling Firestop Sealant
 3. HILTI CP 620 Fire Foam
 4. HILTI CP 606 Flexible Firestop Sealant
 5. HILTI CP 601S Elastomeric Firestop Sealant
- L. Sealants or caulking materials for use with sheet metal ducts. The following products are acceptable:
 1. HILTI CP 601S Elastomeric Firestop Sealant
 2. HILTI CP 606 Flexible Firestop Sealant
 3. HILTI FS-One Intumescent Firestop Sealant
- M. Intumescent sealants, caulking materials for use with combustible items (penetrants consumed by high heat and flame) including insulated metal pipe, PVC jacketed, flexible cable or cable bundles and plastic pipe. The following products are acceptable:
 1. HILTI FS-One Intumescent Firestop Sealant
- N. Firestop collar or wrap devices attached to assembly around combustible plastic pipe (closed or open piping systems). The following products are acceptable:
 1. HILTI CP 642 Firestop Collar
 2. HILTI CP 643 Firestop Collar
 3. HILTI CP 645 Wrap Strips
- O. Materials used for complex penetrations made to accommodate cable trays, multiple steel and copper pipes, electrical busways in raceways. The following products are acceptable:
 1. HILTI CP 637 Trowelable Firestop Compound
 2. HILTI FS 657 Fire Block
 3. HILTI CP 620 Fire Foam
- P. Non curing, re-penetrable materials used for large size/complex penetrations made to accommodate cable trays, multiple steel and copper pipes, electrical busways in raceways. The following products are acceptable:
 1. HILTI FS 657 Fire Block

PART 2 – PRODUCTS

Machinery Drives:

- A. Use V-belts designed for 150% of capacity for all belt drives. For multiple belt drives, use matched sets, so marked at the factory.
- B. On drives with not more than two belts, provide adjustable pitch motor sheaves with the midpoint of the adjustment range equal to that required to achieve the specified fan capacity.
- C. On motors with drives with more than two belts, furnish nonadjustable sheaves, providing the specified fan capacity.

Machinery Accessories:

- A. Lubricating Devices: Provide all oil level gauges, oil pressure gauges, grease cups, grease gun fittings, as required by the equipment. Extend all lubricating fittings to readily accessible locations.
- B. Guards: Provide totally-enclosed OSHA type belt guards for all rotating equipment. Design guards to be readily removable for access to belt drives.

Equipment Design and Installation:

- A. Uniformity: Unless otherwise specified, provide all equipment of same type or classification by the same manufacturer.
- B. Design: Design all equipment in accordance with ASME, AGA, UL and other applicable technical standards as follows:
- C. Pressures vessels – ASME Code constructed and stamped
- D. Electric appliances – UL labeled
- E. Fire protection equipment – UL approved and labeled
- F. Fans – AMCA rated and stamped
- G. Cooling equipment – ARI certified
- H. Fire dampers, smoke dampers, combination fire and smoke dampers – UL listed
- I. Concrete Inserts:
 1. The work under this section includes furnishing and installing all concrete inserts required for all materials and equipment specified herein or in other sections of Division 23.
 2. Provide concrete inserts equal to Unistrut Series 3200 with standard, plain, oiled finish. Provide exposed Unistrut pipe supports with factory finished enamel paint.

These plans, drawings, and designs are the exclusive property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 03.03.2023

Revision:



Alan R. Poulson
Bruce T. Fallon



WPA
Architecture

475 North Freedom Blvd.
Provo, Utah 84601

Tel: (801) 374-0800
info@wpa-architecture.com

SPANISH FORK, UTAH 84660

FACILITIES SHOP

SPANISH FORK CITY

433 SOUTH MAIN STREET

M7.1

MECHANICAL SPECIFICATIONS



ROYAL ENGINEERING

ELECTRICAL 1837 S. EAST BAY BLVD. PHONE: 801.375.2228

MECHANICAL PROVO, UTAH 84606 FAX: 801.375.2676

COPYRIGHT © JOB# J22162.00 DATE PLOTTED: 03/29/2023

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS SOLELY FOR THE USE OF THE CLIENT. ANY REPRODUCTION, DISTRIBUTION, OR DISSEMINATION OF THESE DOCUMENTS TO ANY OTHER PARTY WITHOUT THE WRITTEN CONSENT OF ROYAL ENGINEERING IS STRICTLY PROHIBITED. ROYAL ENGINEERING AND ITS AFFILIATES SHALL BE HELD HARMLESS FROM AND AGAINST ALL SUCH REPRODUCTION, DISTRIBUTION, OR DISSEMINATION. THIS AGREEMENT SHALL BE GOVERNED BY THE LAWS OF THE STATE OF UTAH. UTAH PROFESSIONAL ENGINEERING ACT 33-11, WHICH DOES NOT STATE AND LOCAL PUBLIC RECORDS ACT, REFER TO AS 33-11, U.S.C. PAR. 301 (1991).

BID/PERMIT SET - 05.19.2023

- Diffusers, Registers and Grilles

Air distribution equipment shall be of sizes, types, and capacities indicated.

- A. Registers, grilles, and diffusers of the sizes shown on the drawings and described here in shall be furnished and installed. All grilles, diffusers and registers shall be complete with frames with rubber gaskets suitable for the area and wall construction where shown on the drawings.
- B. Finish for all registers, diffusers, grilles, etc. shall be off-white unless otherwise selected by the Owner/Owner's Representative. Approved manufacturers for all air distribution products shall be Price Industries, Nalor, Metal Air, Tuttle & Bayley, Carnes, Hart and Cooley, or Anemostat.
- C. Supply air shall be introduced into conditioned space in such a manner that conditioned air and room air is rapidly and evenly mixed, resulting in equalization of temperature and draftless air distribution through zone of occupancy with temperature differentials up to 25 degrees F for both cooling and heating air. Quantities and throws shall be as indicated.
- D. Velocity of moving air below 5 foot level, during cooling cycle, shall not exceed limits of either 50 fpm at 1.5 degrees F below average room temperature or 70 fpm at 1 degree F below average room temperature. Velocity of moving air at the 1 foot level, during heating cycle shall not be less than 10 fpm. Temperature difference at or below the 5 foot level shall not exceed the following: 2 degrees F below average room temperature at 30 fpm, 1.5 degrees F below average room temperature at 50 fpm, 1 degree F below average room temperature at 70 fpm. Sound pressure level in all octave bands for each diffuser shall not exceed NC35 noise criteria curve at task level when units operate at designed capacities.
- E. Ceiling diffusers, grilles and registers shall be independently supported from the structure so that they are not depending on the ceiling for support.
- F. Ceiling diffusers may be round necked or equivalent size square neck. Provide square to round neck adapter as necessary. Flex duct shall typically connect directly to the diffuser using a 1-1/2" radius flexible duct elbow. If space does not allow for a full 1-1/2" radius to be provided, then a lined sheet metal boot shall be provided. The flexible duct shall be connected to the side of the sheet metal boot. The flexible duct shall not be connected to the top of the sheet metal boot.
- G. Ceiling supply air diffusers shall be louvered faced directional diffuser model SMD manufactured by Price Industries with border type 36 for lay in ceiling or border type 1 for surface mounting in other than lay in ceilings, baked enamel finish, blow and pattern shown on the drawings.
- H. Supply, exhaust, transfer and return air grilles mounted on walls 6 feet above the floor shall be Price Industries model 635, with 45-degree deflection, 1/2" blade spacing, horizontal extruded aluminum blades, baked enamel finish.
- I. Supply, exhaust, transfer and return air grilles mounted on walls lower than 6 feet above the floor shall be sight-proof, heavy duty gymnasium type equal to Price Industries model 91 (or equal) with horizontal 45-degree deflection blades, 3/8" blade spacing, baked enamel finish.
- J. Drum louvers shall be Price Industries model HCD (or equal) with opposed blade damper.
- K. Exposed duct round diffuser shall be Price Industries model RCD (or equal), 3-position adjustment, 4 cone style, baked enamel finish.
- M. Linear slot supply diffusers shall be Price Industries model SDS75, extruded aluminum frame construction with 180° range of air pattern adjustments.
- N. Make up air supply diffusers shall be Price Industries model PDC perforated face ceiling diffusers, fixed 1-way air pattern, hinged removable perforated face screen, baked enamel finish.
- O. Ceiling filter return air grilles in lay in ceiling shall be Price Industries model 10FF, with hinged, perforated faceplate and 1" filter for lay in T-bar application, baked enamel finish. The contractor shall provide the 1" filter.
- P. Ceiling filter return grilles and transfer air grilles shall be Price Industries model PDR or PDDR perforated diffuser with removable perforated faceplate in lay in T-bar application, bake enamel finish.
- Q. Ceiling return, exhaust and transfer air grilles for surface mounting in other than lay in ceilings shall be Price industries model 10F, with perforated removable faceplate, baked enamel finish.

- Ducts and Sheet Metal Work

- A. Provide ducts, plenums, access doors, fresh air intakes, and exhaust as indicated and required. All ductwork shall be constructed, erected and tested in accordance with the most restrictive of local regulations, procedures and detailed in the ASHRAE Handbook of Fundamentals or the applicable standards adopted by the Sheet Metal and Air Conditioning Contractors National Association (SMACNA). Provide prefabricated spiral lockseam duct and fittings and rectangular ducts of galvanized steel. Aluminum flexible ductwork or gypsum board ductwork is not acceptable.
- B. All connections to main ducts shall be made with low loss fittings.
- C. Flat duct surfaces shall be crimped diagonally regardless of size. Longitudinal joints in all duct sizes may be flat lock joints. Transverse joints and intermediate bracing shall be constructed of galvanized sheet metal or galvanized structural angles in accordance with requirements of ASHRAE Guide and public authorities having jurisdiction.
- D. Transverse joints on all ducts shall be sealed with mastic or tape.
- E. Longitudinal joints on ducts with internal static pressures in excess of 0.75 inches of water pressure shall be sealed with mastic or tape.
- F. Lock joints shall be hammered to make them airtight. Inside of duct shall present a smooth surface to flow air.
- G. Changes in size of ducts shall increase gradually with a slope of not more than 12 inches in 5 feet where possible, but not more than 12 inches in 3 feet in any event.
- H. Turns shall be made with throat radius of not less than the duct width.
- I. Plenums shall be made of 18 gauge galvanized sheet steel reinforced horizontally on a maximum of 48" centers by 1-1/2"x1-1/4"x 3/8" galvanized angles reinforced vertically by 1-1/2" standing seams.

- Refrigerant Lines

- A. Refrigerant lines are to be sized as per manufacturer's requirements. Lines to be fully insulated with 1 inch foam flex or equal. Insulation exposed to the sun shall be painted with two coats of protective paint. The system is to be evacuated to 200 microns, hold vacuum 24 hours. Break with freon and leak test with halide detector. Each heat pump to be provided with a refrigerant line kit.

- Radiant Heaters

- A. The heaters shall be radiant tubular heaters with a power burner housed in a burner/control box firing into a 4" diameter combustion chamber tube. The burner/control box and tubular system shall be designed for horizontal suspension from field-supplied hanging chains. Units shall be equipped for use with natural gas and 115 volt single phase supply voltage and will operate at full input rate at elevation of 8000 ft. The burner control system shall have a 24-volt transformer; a spark ignited, intermittent safety pilot with electronic flame supervision, redundant single-stage combination gas valve; a burner-on indicator light, sight glass for observing flame, a power burner with post-purge, a differential air pressure switch to measure combustion air, a safety interlock switch on the service door, a test port with removable cover, and a terminal board for connection for remote thermostat. Electrical supply connection is with a grounded, plug-in cord. Gas connection to the valve must be with field-supplied expansion coil or A.G.A approved flexible connector. The tubular system shall include a 14-gauge aluminumized steel combustion chamber, high emissivity radiant 10' (5') straight heat exchanger tubes, tail pipe, tubular strips, built in suspension hangers, slip fit tube connectors and polished aluminum reflectors with reflector retainers. Heater may be individually vented vertically and may operate on outside combustion air. Reflectors may be positioned from horizontal to 45° angle. Horizontal reflectors may include optional side shield. All connection hardware kits shall be packaged in individual bags and include illustrated instructions. These units must be design-certified by the American Gas Association (A.G.A.) and bear A.G.A label. The manufacturer shall provide a 5-year limited warranty on the burner and all electrical mechanical operating components and 10year limited warranty o the tubes. Manufacturers shall be as indicated in the equipment schedule.

- Aluminum Louvers

- A. Louvers are to be furnished and all connections made by the Mechanical contractor. Louvers shall be fixed, drain-able type, 12-gauge extruded aluminum. Louvers shall be AMCA certified rated for no water carry-over at free area velocities less than 100 fpm. In no case shall free area be less than 50% of the face area. Frames shall be box channel flanged type as selected by Architect for mounting in a wall. A 1/4" galvanized mesh insect screen shall be provided behind louver. Aluminum louvers shall be anodized in color selected by Architect. Louvers to be Airo-lite (K6776), Venco, Ruskin, American Warning and Ventilating, Air Balance or Louvers and Dampers.

- Volume Dampers

- A. Dampers used in low velocity branch ducts to control the volume of air flow shall be Young No. 817 volume damper or equal. All operating head shall be placed on the side of the duct and shall be locked in position by a set key where the damper is accessible. Where the damper is not accessible, Young No. 817A or 817B volume control damper or equal consisting of an end bearing or miter gear, coupling, 3/8-inch square shaft, and regulator for operating the unit from the ceiling shall be provided.

- Temperature Controls

- A. Thermostats shall be provided with the air conditioning units. They shall be installed and wired by the HVAC contractor. T-stats for roof top units shall be programmable with night setback and override control.

- Insulation

- A. Thermal/Acoustical duct insulation: Line the first 10' of supply air and return air ducts from the mechanical unit, unless otherwise specified with Knauf or equal. Duct Liner shall be mat-faced to provide a smooth air-steam surface, mold resistant, 1-1/2" thick insulation wrapped entirely around duct with joints lapped at least 2" and secured with 16 gauge galvanized wire on 12" centers. Insulation shall cover all surfaces including standing seams.
- B. Rectangular supply ducts and return air ducts located on unconditioned spaces shall be lined with Knauf un-acoustic or equal. 1 inch of 1-1/2 lb. thermal resistive value of duct liner shall be a minimum of R-6. Rectangular supply ducts and return air ducts located outside the building envelope shall be lined with Knauf un-acoustic or equal. 2 inch, 1-1/2 lb. thermal resistive value of duct liner shall be a minimum of R-8. Density coated fiberglass duct liner complying with friction correction factor not greater than 1.1 at a velocity of 3000 fpm. Apply insulation to inside of ducts with an approved fire retardant adhesive to provide 100% coverage and a smooth surface. In ducts with one side more than 12" secure insulation with mechanical fasteners in addition to adhesive, spaced at 14" centers in both directions. Mechanical fasteners shall be flush with the liner surface and shall start within 2" of the leading edge of each section and within 3" of the leading edge of all cross joints of the liner shall be heavily coated with an approved fire resistant adhesive. The duct liner shall be cut to assure snug closing corner joints. The black surface of the liner shall face the air stream. Transverse joints shall be neatly butted and all damaged areas shall be heavily coated with a approved adhesive.
- C. All duct insulation shall have an NRC rating of not less than 0.60 and a K factor of not more than 0.27. Duct dimensions shall be increased 2 inches on each side from those shown on drawings to accommodate insulation.

- Ceiling Mounted Fan

- A. Ceiling type exhaust fans of the capacity shown on the drawings shall be furnished and installed. Fans shall be direct drive of RPM shown and shall be complete with fan housing, inlet grille, backdraft damper and motor. Noise level shall not exceed 3.8 sones. Air quantities shall be certified by AMCA. Fans shall be from manufacturer listed in the equipment schedule.

- Split System Indoor Furnace

- A. Furnish and install a natural gas fired furnace of the size and capacity as listed on the drawings. Each furnace shall be up-flow, horizontal flow as indicated, completely factory assembled, certified by AGA. Complete with blower section, furnace section, filter section and steel casing. Unit shall come piped and wired. Cooling coil shall be provided as indicated.
- B. Blower section shall consist of 22 GA. cold rolled steel cabinet with finish coat of baked-on enamel. Blower shall be class 1, full DWD and statically and dynamically balanced. Blower shall be driven by a motor with adjustable pitch V-belt or by multi-speed direct driven motor.
- C. Cooling coil shall be provided with heavy gauge steel cabinet with baked-on enamel finish to match furnace. Coil shall have aluminum fins bonded to seamless copper tubing and shall be ARI rated. Drain pan with connections at either end shall be provided at each coil.
- D. Filters shall be one-inch thick throw-away type as furnished by the furnace manufacturer.
- E. Heat exchanger section shall be enclosed in a 22-gauge or heavier enameled steel casing lined with foil covered insulation. Exchanger shall be ceramic or glass coated, stainless steel or 18-gauge aluminized steel.
- F. Unit shall be of manufacturer listed in equipment schedule.

- Split System Condensing Unit

- A. Condensing unit shall be by the same manufacturer as the furnace and of size and capacity indicated. Units shall be completely assembled and tested complete with refrigerant charge and ready to operate. Unit shall be UL listed and carry a UL Label.
 1. Cabinet shall be constructed of galvanized steel, bonderized and coated with a powder coat paint.
 2. Coils shall be of nonferrous construction with aluminum plate fins mechanically bonded to seamless copper tubes with all joints brazed.
 3. Compressors shall be hermetically sealed. Compressor will be mounted on rubber vibrations isolators.
 4. Refrigerant circuit components shall include the following: Liquid tube shutoff valve with sweat connections, suction tube shutoff valves with sweat connections. System charged with Refrigerant R-410, Compressor oil, accumulator, and reversing valve. System shall have a low ambient kit installed.
 5. Compressor fans shall be direct drive propeller type, discharging air upward. Fan motors shall be totally enclosed 1-phase type with class B insulation and permanently lubricated bearings. Shafts shall be corrosion resistant. Fan blades shall be statically and dynamically balanced. Condenser fan openings shall be equipped with steel wire safety guards.
 6. Unit shall be of manufacturer listed in the equipment schedule.

- Duct Penetrations

- A. All ducts penetrating through the fire rated walls and floors shall be properly safed with Dow Corning 3-6548 silicone RTV foam or equal. Install per manufacture's directions.

- Turning Vanes

- A. Turning vanes shall be furnished and installed in all 90-degree turns in supply, return, mixed air and fresh air ducts, and elsewhere as shown on the drawings. Material of turning vanes shall match ductwork. Vanes are to be single blade, of size, gauge, and fabrication in accordance with SMACNA recommendations.

- Equal Materials and Substitutions

- A. In addition to manufacturers specified, the following shall also be considered equal. Provided corresponding models meet specified requirements. Equivalent substituted equipment named herein shall be submitted to Architect for approval. Submit alternate selections for prior approval. Must be received by Engineer 10 days prior to due date/bid opening.

Insulation:	Certainteed, Manville, Fiberglas
Air Filters:	AAF, Farr or Engineer approved equivalent.
Split System:	From manufacturers listed in the schedule.
Diffusers and Grilles:	Titus, Nailor, Price, Krueger, Hart and Cooley, Carnes, or Engineer approved equivalent.
Ceiling Exhaust Fan:	Braon, Fantech, Acme, Carnes, Penn, Cook, Breidert, Coolair, Captive aire, S&P, Greenheck, Twin City Fan, Delta Breez, Air King. (subject to project document conformance)
Roof Top Unit:	From manufacturers listed in the schedule.

- Gas Fired Unit Heater

- A. Furnish and install horizontal gas fired unit heaters of size and capacity shown on the drawings. These units shall be complete with die formed burners constructed of aluminized steel and include flared ports (burner air shutters) and stainless steel insert. Propeller fan, fan and motor guard housing, heavy gauge enclosure, discharge louvers, supporting lugs and clips, stainless steel heat exchanger, resilient mounting. The unit shall include and intermittent spark pilot and single stage 24 volt gas valve. The unit is to include all required limit and safety controls, including an energy cut off device. Units must be certified by the American Gas Association and bear the AGA label. With manufacturer listed in the equipment schedule.

- Fire and Smoke Dampers (AS REQUIRED)

- A. Fire/smoke dampers shall be Ruskin FSD-36 multiblade, Venco, Louvers and Dampers, Greenheck, C&S, Safe Air, NCA, or Air Balance, complete with blade lever arm 120 volt, electric damper motor, fusible and blade reset fusible link.
- B. Fire/Smoke dampers shall be interlocked to the fire detection system by the electrical contractor. Damper motors shall be capable of closing the damper against system air pressure when the fan is operating. Each damper shall be complete with duct connections for round or rectangular ducts. Minimum 1-1/2 foot by 1-1/2 inch 14-gauge mounting angles shall be provided for all dampers.
- C. Damper motors, where required, are to be supplied as an integral part of the assembly to meet UL rating requirements. Damper installation shall conform to manufacturer's instructions.
- D. Access opening shall be provided at each damper for servicing the damper. The opening or openings shall be of sufficient size and locations so that the damper can be easily inspected and serviced. A sheet metal-hinged door and cover shall be provided and shall be insulated.
- E. Fire damper and fire smoke combination damper manufacturer installation instructions to be submitted as a deferred submittal by the mechanical contractor.

- Motorized Volume Dampers

- A. Motorized dampers used in low velocity branch ducts to control the volume or air flow shall be Carrier model Damprnd-B for round ducts and Damprec-B rectangle ducts or equal.

- High Efficiency Branch Take-Offs

- A. Expanded throat high efficiency takeoffs shall be used for all branch takeoffs unless shown otherwise on the drawings. An opposed blade volume damper with locking quadrant shall be provided at each branch takeoff. Where dampers are not accessible for adjustment from above, concealed ceiling regulators with adjustable chrome-plated covers shall be provided. High efficiency take-offs shall be Hercules, Southwork or equal.

These plans, drawings, and designs are the exclusive property of WPA Architecture and shall be reproduced in any form without written consent. All rights reserved.

Date: 03.03.2023

Revision:

Alan R. Poulson
Bruce T. Fallon

WPA
Architecture

475 North Freedom Blvd.
Provo, Utah 84601

Tel: (801) 374-0800
info@wpa-architecture.com

SPANISH FORK, UTAH 84680

FACILITIES SHOP

SPANISH FORK CITY

433 SOUTH MAIN STREET

M7.2

MECHANICAL SPECIFICATIONS

BID/PERMIT SET - 05.19.2023

ROYAL ENGINEERING

ELECTRICAL 1837 S. EAST BAY BLVD. PHONE: 801.375.2228

MECHANICAL 1837 S. EAST BAY BLVD. PROVO, UTAH 84606 FAX: 801.375.2676

COPYRIGHT © JOB# J22162.00 DATE PLOTTED: 03/29/2023

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INCOMPLETE UNLESS IN CONJUNCTION WITH ARCHITECTURAL PREPARATIONS, DESCRIPTIONS, OBSERVATIONS AND ADMINISTRATIONS. USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT WRITTEN PERMISSION CONSTITUTES A VIOLATION OF THE PROFESSIONAL ETHICS AND OTHER RESERVED RIGHTS OF THE UTAH BOARD OF PROFESSIONAL ENGINEERS AND ARCHITECTS. THESE DOCUMENTS ARE NOT TO BE USED FOR ANY OTHER PURPOSES WITHOUT THE WRITTEN CONSENT OF THE ENGINEER OR ARCHITECT. THESE DOCUMENTS ARE NOT TO BE USED FOR ANY OTHER PURPOSES WITHOUT THE WRITTEN CONSENT OF THE ENGINEER OR ARCHITECT. THESE DOCUMENTS ARE NOT TO BE USED FOR ANY OTHER PURPOSES WITHOUT THE WRITTEN CONSENT OF THE ENGINEER OR ARCHITECT.

PART 3 – EXECUTION

– Verification of Dimensions:

- A. Scaled and figured dimensions are approximate only. Before proceeding with work, carefully check and verify dimensions at site, and be responsible for properly fitting equipment and materials together and to the structure in spaces provided.
- B. Drawings are essentially diagrammatic and many offsets, bends, special fittings and exact locations are not indicated. Carefully study drawings and premises in order to determine best methods, exact locations, routes, building obstructions, and install apparatus and equipment in available locations. Install apparatus and equipment in manner and in locations to avoid obstructions, preserve headroom, and keep openings and passageways clear.

– Cutting and Patching:

Cut work and patch per Division 1 as necessary to properly install the new work. As the work progresses, coordinate necessary openings, holes, chases, etc., in their correct location. If the required openings, holes and chases are not in their correct locations, make the necessary corrections at no cost to the Owner. Avoid excessive cutting and do not cut structural members without the consent of the Architect. Patching by General Contractor at Mechanical, Plumbing or Fire Protection Contractor's expense. Include as a part of the work under this contract all structural framing required by penetrations through the roof and necessary steel to support ducts and pipes between structural steel unless shown on the structural drawings.

– Closing-in of Unfinished Work:

Cover no work until inspected, tested and approved. Where work is covered before inspection and test, uncover it, and when inspected, tested and approved, restore all work to original proper condition.

– Excavation and Backfill:

- A. Perform all necessary excavation, shoring and backfilling required for the proper laying of all pipes and conduits inside the building and premises, and outside as may be necessary. Conform to Division 2 requirements. Remove all excess excavated materials from the site or dispose of on site as directed by General Contractor.
- B. Excavate all trenches open cut, keep trench banks as nearly vertical as practicable, and sheet and brace trenches where required for stability and safety. Excavate trenches true to line and make bottoms not less than 18" wide but no wider than necessary to provide ample work room. Grade trench bottoms accurately to provide uniform bearing and support for each section of pipe on undisturbed soil along its entire length. Dig "bell" holes after the trench bottom has been graded. Machine grade only to the top line of the pipes, doing the balance by hand. Do not cut any trench near or under footings without first consulting the Architect. Comply with OSHA requirements.
- C. Provide backfilling and compaction in accordance with requirement of Division 2 and under the direction of the Architect and the Owner's testing firm to the required density. Make the first 2 feet of fill in 6" layers, each thoroughly compacted as directed, and free from rocks, large clods of earth, leaves, branches, and debris. Compact the rest of the backfill to prevent settlement as directed, using in the backfill no rocks larger than 4" in diameter, and using no rocks at all in the top 12".

– Accessibility:

- A. Install valves, dampers, thermometers, gauges, traps, cleanouts, control devices or other specialties requiring reading, adjustment, inspection, repairs, removal or replacement conveniently and accessibly throughout the finished building. Where any of these devices are shown on the contract drawings to be installed above any inaccessible ceiling, the Mechanical Contractor shall furnish access doors or panels as required.
- B. All access doors or panels in walls and ceilings required for access to control devices, traps, valves and similar devices are to be furnished and installed as part of the work under this section. Provide type as specified under Division 8.
- C. Provide ducts which pierce a fire separation with fire dampers of same fire rating as the separation.
- D. Refer to drawings and "Finish Schedule" for type of wall and ceiling in each area and for rated construction.
- E. Coordinate work of various sections to locate valves, traps, and dampers with others to avoid unnecessary duplication of access doors.

– Roof Flashings:

Flash and counterflash all piping, conduits and ductwork penetrating roofing membrane with flashing per roofing manufacturer's recommendations. Refer to architectural and mechanical drawings for detailing of duct and pipe penetrations through roof.

– Equipment Rough-in:

- A. Rough in all equipment and fixtures as designated on the drawings and in the specifications. The drawings indicate only the approximate location of rough-ins. The exact rough-in locations must be determined from large-scale certified drawings. The Contractor shall obtain all certified rough-in information before progressing with any work for rough-in final connections.
- B. Contractor shall provide all outlets and services of proper size at the required locations.
- C. Minor changes in the contract drawings shall be anticipated and provided for under this division of the specifications.
- D. Rough-in only (unless otherwise designated on the drawings) shall include the following:
 - D.1. Mechanical: Provide all services as indicated and required, including all ductwork, piping and valves. Valve and cap all piping stub-outs. Cap all ductwork stub-outs in a manner suitable for future extension.
- E. Mechanical equipment installed on the roof shall not be installed any closer than 10'-0" to the edge of the roof unless there is a 42" high parapet or equipment guardrail.

– Owner-Furnished and Other Equipment:

- A. Rough-in only for all Owner-furnished equipment (see Division 1) and all equipment furnished under other sections of the specifications, except as otherwise specified and/or noted on the drawings.

– Equipment Identification

- A. All major equipment shall bear firmly attached metal nameplates which state name of manufacturer, model number and electrical data.

– Discrepancies

- A. In the event of discrepancy, immediately notify the Owner.
- B. Do not proceed with installation in areas of discrepancy until all such discrepancies have been fully resolved.

– Initial Lubrication, Adjusting, and Filling Systems

- A. Before operating any mechanical system, equipment bearings shall be lubricated and bolts, pulleys, and other moving parts checked for alignment and tolerances in accordance with manufacturer's operating instructions. Vibrations and noise shall be suppressed.

– Cleaning of Equipment, Materials and Premises

- A. Be painted smooth and clean, ready for painters. Clean entire premises of unused materials, rubbish, debris, grease spots and dirt left by subcontractor.

– Equipment and Material

- A. Install all equipment and material per manufacturer's recommendations.

– Accessibility

- A. Install work readily accessible for normal operation, reading of instruments, adjustment, service inspection and repair, provide access panels where indicated and required. Access panels shall be the responsibility of respective subcontractors.
- B. Provide all services designated, valve and cap all piping, cap all waste piping and ductwork and leave in a clean and orderly manner.
- C. Rough-in requirements shall be as outlined in the preceding paragraph titled "Equipment Rough-in."

– Equipment Final Connections:

- A. Provide all piping and duct final connections for all equipment under Division 22 and 23 as required herein specified and indicated on the drawings.
- B. Air Conditioning, Heating, and Ventilating: Provide final connections complete with necessary valves, drains, unions, flanges and duct connections for equipment furnished and installed under other sections of the specifications, except as otherwise designated. Included under the HVAC sections of the specifications are the final connections to the following:
 - B.1. Condensate and evaporative cooler drain piping from air conditioning equipment.
 - B.2. Supply, return, relief, outside air and exhaust duct connections for all equipment including exhaust fans.
 - B.3. Piping connections for all equipment.
 - B.4. Duct connections for all kitchen hoods.

– Machinery Drives: After tests have been performed on the air conditioning and air handling systems, make without cost no more than two changes in the size of the nonadjustable sheaves to obtain the required air quantities.

– Machinery Accessories:

- A. Application: Do not install any equipment in an application not recommended by the manufacturer.
- B. Installation: Align, level and adjust all equipment for proper operation. Install so connecting and disconnecting of piping and accessories can readily be done and so all parts are readily accessible for inspection, service and repair. Install equipment in accordance with manufacturer's recommendations.

– Pipe and Equipment Supports:

- A. Where supports, foundations, stands, suspended platforms for machinery, tanks, or other equipment are indicated or specified, perform the following:
 - A.1. Locate support members to avoid equipment strains and interference with piping connections, tube pulling or other maintenance operations.
 - A.2. Where saddles are required, use cast iron or welded steel saddles with curvature to fit the tank shell.
 - A.3. Mount power-driven equipment on common base with driver.
- B. Concrete Inserts: Furnish and install all concrete inserts required for all materials and equipment specified and/or shown on the drawings for Division 22.
- C. Concrete Foundations: Work under this section includes coordination of construction of all concrete foundations indicated or required for equipment specified herein or in other sections under Division 22. Materials and workmanship shall be described under Division 3.
- D. Grout under all equipment after leveling, filling completely the space between machinery bed plate and foundation surface as specified in Division 3. Finish exposed surface of grout for a neat appearance.
- E. Floor Stands: Where equipment is mounted standard or on legs, construct of structural steel or steel pipe and fittings, cross-brace and fasten with flanges or plates bolted to floor.
- F. Ceiling or Wall Supports: Use suspended platform, strap hangers, bracket or shelf, whichever is most suitable for equipment and location. Construct of structural steel members, steel plates, rods or pipe as required. Cross-brace and fasten to building structure or inserts in an approved manner.
- G. Steel Work: Neatly fabricate and erect steel work with burrs and welding spatter ground off. Paint after fabrication with a rust-inhibitive primer.
- H. Roof Mounted Equipment (Steel Supported): Provide curbs and flashings for metal support structures as shown in the latest SMACNA manual for roof supports.

– Cleanup:

- A. In addition to cleanup specified under Division 1, thoroughly clean all parts of the equipment. Where exposed parts are to be painted, thoroughly clean off any splattered construction materials and remove all oil and grease spots. Wipe the surface carefully and scrape out all cracks and corners.
- B. Thoroughly flush and clean out all water circulating systems. Remove, clean and replace all strainer elements.
- C. During the progress of the work, keep the premises clean and free of debris.

– Painting:

- A. Except as otherwise specified or indicated in the architectural drawings and/or specifications, paint all exposed unfinished metal with one coat of rust-inhibiting primer. (Galvanized ductwork and factory painted equipment shall be considered as having primed surface.)
- B. Finished painting is specified under Division 9.

– Objectionable Noise and Vibration: Construct and brace the metal partitions, ducts and sheet metal housings to prevent vibration or rattling when systems are in operation. Install connections to equipment so noise and vibration will not reach the conditioned area through ducts, piping, conduit, sheet metal work, or the building structure. Provide power-driven equipment suspended from the structure with spring type isolation.

– Welding:

- A. Procedures:
 - A.1. All procedures and welders must be qualified in accordance with the requirements of Section IX, ASME Boiler and Pressure Vessel Code and ANSI code for power piping B31.1. Procedure qualification test records and acceptance shall be submitted with the welding procedure prior to the start of fabrication.
 - A.2. Architect's inspector or authorized representative will review performance qualification records of individual welders.
- B. Welding Processes: The following welding processes are permitted, provided that the procedure is qualified in accordance with Section IX, ASME Boiler and Pressure Vessel Code.
 - B.1. Manual shielded metal-arc.
 - B.2. Gas tungsten-arc.
 - B.3. Other welding processes may be used providing they are qualified in accordance with Section IX, ASME Boiler and Pressure Vessel Code.
- C. Restrictions: Weld bevel preparations shall be provided on all welding fittings and shall be machined or ground to remove all discoloration if flame or arc cut.
- D. Welding Filler Material:
 - D.1. A filler material control procedure shall be submitted to Owner for review and acceptance prior to performing any welding.
 - D.2. All shielded metal-arc welding shall be performed using low-hydrogen type electrodes such as E 7018.
- E. Preheat and Interpass Temperature:
- F. Preheat for pressure components shall be as specified in Table 132 of ANSI B.1.

– System Balancing

A. Balancing work included:

- A.1. Complete testing and balancing of the HVAC system as herein specified.
- B. Verification of Conditions: Prior to testing and balancing, inspect equipment and materials and arrange with contractor for satisfactory correction of all defects in workmanship and/or material that could affect the work specified herein.
- C. Protection: As specified herein.
- D. System Operation: contractor shall put all parts of systems in full operation and shall continue to operation of some during each working day of testing and balancing.
- E. Test Data: Submit copy of test data to Owner on completion of work under this section.
- F. Test and balance contractor shall certify in writing that system has been adjusted and balanced and design conditions have been attained in all areas of the building.
- G. Instruments: Instruments used by contractor shall be accurately calibrated and maintained in good working order.
- H. Air Distribution Testing and Balancing:
 - H.1. Test and record motor full load amperes and RPM.
 - H.2. Test and record system static pressures, suction and discharge.
 - H.3. Adjust all supply and return air ducts to proper design CFM.
 - H.4. In cooperation with the control manufacturer's representative, the setting adjustment of automatically operated controls to operate as specified indicated and/or noted.
- I. Witness: Notify Owner in writing two weeks prior to testing and balancing of all major equipment in order to arrange that Owner's representative will witness the test.

– Operation

- D. Place system in operation and regulate and adjust to Owner's satisfaction. System shall operate quietly and without vibration or noise.
- E. Contractor shall make necessary field adjustments for even temperatures throughout the project.

– Certification

- A. Upon completion, the contractor shall inspect work of this section and deliver to Owner a written certification that installed materials and workmanship conform to specifications.

These plans, drawings, and designs are the exclusive property of WPA Architecture and shall be reproduced in any form without written consent. All rights reserved.

Date: 03.03.2023
Revision:

Alan R. Poulson
Bruce T. Fallon

WPA Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

SPANISH FORK, UTAH 84680

SPANISH FORK CITY

433 SOUTH MAIN STREET

M7.3
MECHANICAL SPECIFICATIONS

BID/PERMIT SET - 05.19.2023

ROYAL ENGINEERING


ELECTRICAL MECHANICAL
1837 S. EAST BAY BLVD. PROVO, UTAH 84606
PHONE: 801.375.2228 FAX: 801.375.2876

COPYRIGHT JOB# J22162.00 DATE PLOTTED: 03/29/2023

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INCOMPLETE UNLESS IN CONJUNCTION WITH OTHER ENGINEERING PREPARATIONS, CALCULATIONS, OBSERVATIONS AND ADMINISTRATIVE USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT WRITTEN PERMISSION CONSTITUTES A VIOLATION OF UTAH PROFESSIONAL ENGINEERING AND OTHER RELATED STATUTES AND ACTS AND U.S.C. PAR. 31.11981-1, WHICH FORECLOSE STATE AND LOCAL PUBLIC RECORD ACTS. REFER TO ACT 10 U.S.C. PAR. 301 (1991).



Alan R. Poulson
Bruce T. Fallon

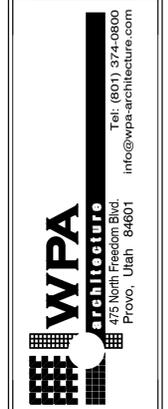

SPANISH FORK, UTAH 84680

FACILITIES SHOP
SPANISH FORK CITY

433 SOUTH MAIN STREET

P0.1
PLUMBING NOTES AND LEGENDS

BID/PERMIT SET - 05.19.2023

- PROJECT PLUMBING NOTES:**
- SEE PIPING SCHEMATIC(S) FOR ADDITIONAL INFORMATION ON CULINARY WATER, GAS, WASTE, AND VENT PIPING DIAMETERS.
 - COORDINATE ALL WORK WITH OTHER TRADES AS REQUIRED. CONCEAL ALL PIPING IN FINISHED AREAS.
 - PROVIDE AND INSTALL ALL REQUIRED VALVES IN PIPING SYSTEM.
 - PROVIDE AND INSTALL NEW 2" WATER METER WITH 1-1/2" MAIN WATER SUPPLY LINE. PROVIDE AND INSTALL MAIN SHUT-OFF, PRV, ETC. (FIELD VERIFY LOCATION WITH SITE CONDITIONS AND OWNER'S REPRESENTATIVE.)
 - PROVIDE AND INSTALL 4" SEWER LINE. FIELD LOCATE. MAKE CONNECTION TO COMPLETE BUILDING SEWER SYSTEM. VERIFY ALL INVERT ELEVATIONS AND ALL REQUIREMENTS WITH OWNER'S REPRESENTATIVE AND CIVIL PLANS.
 - FIELD LOCATE NEW 2 POUND GAS METER. VERIFY LOCATION AND ALL REQUIREMENTS WITH GAS COMPANY.
 - WHERE REQUIRED PLUMBING CONTRACTOR SHALL PROVIDE AND INSTALL 2 POUND TO 4 OUNCE PRESSURE REGULATORS WITH LEAK-LIMITING DEVICE AND TEST TEE FITTING. IFGC 410.
 - INSULATE ALL HOT AND COLD WATER PIPING PER APPLICABLE CODES. ALL EXPOSED HOT AND COLD WATER PIPING SHALL BE INSULATED. INSULATE HOT WATER PIPING THAT IS PLACED IN UN-INSULATED INTERIOR WALLS. EXCEPTION: VERTICAL AND HORIZONTAL COLD WATER PIPING LOCATED INSIDE OF INTERIOR WALLS MAY HAVE THE INSULATION OMITTED.
 - MAKE PROVISIONS FOR A TRAP GUARD WHERE NOTED AND/OR CALLED FOR.
 - PIPING LOCATIONS ARE GRAPHICALLY SHOWN. PLUMBING CONTRACTOR SHALL DETERMINE ACTUAL PIPE ROUTING IN FIELD PER AVAILABLE SPACE AND BUILDING CONSTRUCTION.
 - NOT ALL CLEANOUTS ARE SHOWN. PROVIDE AND INSTALL ALL REQUIRED CLEANOUTS. CLEANOUTS FOR HORIZONTAL DRAINS SHALL BE INSTALLED NO MORE THAN 100' APART. CLEANOUTS SHALL BE INSTALLED AT EACH CHANGE OF DIRECTION GREATER THAN 45°. A CLEANOUT SHALL BE PROVIDED AT THE BASE OF EACH WASTE OR SOIL STACK. CLEANOUTS SHALL BE ACCESSIBLE AND THE SAME SIZE AS THE WASTE LINES ON WHICH THEY ARE INSTALLED.
 - COORDINATE WITH OTHER TRADES TO ENSURE AND ALL PLUMBING VENTS ARE A MINIMUM OF 10- FEET FROM ALL FRESH AIR INTAKES.
 - WATER PIPING MATERIAL SHALL MEET THE STANDARDS SET FORTH IN 2018 IPC TABLES 605.3, 605.4, AND 605.5.
 - SANITARY WASTE AND VENT PIPING MATERIAL SHALL MEET THE STANDARDS SET FORTH IN 2018 IPC TABLES 702.1, 702.2, 702.3, AND 702.4.
 - NATURAL GAS PIPING MATERIAL SHALL MEET THE STANDARDS SET FORTH IN 2018 IFGC SECTION 403.
 - PROVIDE AND INSTALL WATER HAMMER ARRESTORS WHERE QUICK-CLOSING VALVES ARE UTILIZED. THIS INCLUDES BUT IS NOT LIMITED TO: ICE MAKERS, DISHWASHERS, FLUSH VALVE TOILETS AND URINALS.
 - TRENCHES THAT ARE EXCAVATED BELOW THE INSTALLATION LEVEL OF PIPE (SUCH THAT THE TRENCH BOTTOM DOES NOT FORM THE BED FOR THE PIPE) SHALL BE BACKFILLED TO THE INSTALLATION LEVEL OF THE BOTTOM OF THE PIPE WITH SAND OR FINE GRAVEL PLACED IN LAYERS OF 6 INCHES MAXIMUM DEPTH. THE BACKFILL SHALL BE COMPACTED AFTER EACH PLACEMENT. 2018 IPC 306.2.1.
 - PROVIDE AND INSTALL MARKING/LOCATING TAPE FOR ALL BURIED GAS LINES.
 - PLUMBING CONTRACTOR SHALL PROVIDE AND INSTALL WATER TEMPERING DEVICE (SHALL CONFORM TO ASSE 1070) FOR ALL HAND WASH AREAS IN PROJECT. HOT WATER TEMPERATURE SHALL HAVE A MAXIMUM TEMPERATURE OF 110° F. 2018 IPC 607.1.2.
 - PLUMBING CONTRACTOR TO PROVIDE AND INSTALL A BACK-FLOW PREVENTER AND SHUT-OFF VALVE AT ALL HOSE BIB LOCATIONS.
 - PAINT ALL EXTERIOR GAS PIPING WITH WEATHER RESISTANT PAINT.
 - CONTRACTOR SHALL VERIFY LOCATION, SIZE, AND DEPTH OF ALL UTILITIES PRIOR TO BEGINNING OF CONSTRUCTION.

PLUMBING SYMBOLS

NOTES:
1. ALL SYMBOLS MAY NOT BE USED.
2. DOTTED SYMBOLS INDICATE EXISTING EQUIPMENT, ETC

	SANITARY OR WASTE PIPING
	VENT PIPING
	COLD WATER PIPING
	HOT WATER PIPING
	GAS PIPING
	STORM DRAIN PIPING
	ROOF DRAIN PIPING
	OVERFLOW ROOF DRAIN PIPING
	GREASE PIPING
	RECIRCULATION WATER PIPING
	PIPE RISER OR FIXTURE CONNECTION
	WALL HYDRANT/HOSE BIB
	FLOOR DRAIN
	AREA DRAIN
	ROOF DRAIN
	ROUND MEASUREMENT.
	PLUMBING FIXTURE SYMBOL
	MECHANICAL EQUIPMENT SYMBOL
	KEYED NOTE REFERENCE
	PRESSURE REDUCING VALVE STATION
	GATE VALVE AND BACKFLOW PREVENTOR

DESIGN CONTACTS

MECHANICAL ENGINEER:	MARK MAKIN
MECHANICAL PROJECT MANAGER:	CHRIS FALSLEV
MECHANICAL DESIGNER:	TRE PRESSON

SHEET INDEX

SHEET NUMBER	SHEET TITLE
P0.1	PLUMBING NOTES AND LEGENDS
P1.1	PLUMBING FLOOR PLAN
P1.2	PLUMBING MEZZ. PLAN
P4.1	ENLARGED FRONT ENTERANCE
P5.1	PLUMBING DETAILS
P5.2	PLUMBING DETAILS
P6.1	PLUMBING SCHEDULES AND SCHEMATICS
P7.1	PLUMBING SPECIFICATIONS
P7.2	PLUMBING SPECIFICATIONS


- PIPING SEISMIC SUPPORT NOTES:**
- PER ASCE STANDARD 7-22 SEISMIC SUPPORTS ARE NOT REQUIRED FOR THE FOLLOWING CONDITION:
 - 1.1. PIPING IS SUPPORTED BY ROD HANGERS 12" OR LESS IN LENGTH FROM THE TOP OF THE PIPE TO THE SUPPORTING STRUCTURE.
 - 1.2. HIGH-DEFORMABILITY PIPING IS USED.
 - IF INSTANCES OCCUR WHERE PIPING IS SUSPENDED BY HANGERS GREATER THAN 12" IN LENGTH. SYSTEM CONNECTORS AND COMPONENTS SHALL BE COMPATIBLE AND DESIGNED FOR THE APPLICATION THAT THEY ARE USED FOR. SHALL HAVE A MINIMUM OF TWO TRANSVERSE BRACES PER STRAIGHT PIPING RUN. THE MAXIMUM DISTANCE BETWEEN TRANSVERSE BRACES WILL BE DETERMINED BY PIPE SIZE AND PIPING COMPOSITION. SHALL HAVE A MINIMUM OF ONE LONGITUDINAL BRACE PER STRAIGHT DUCT RUN. IF LENGTH OF PIPING EXCEEDS LONGITUDINAL BRACE SPACING, ADDITIONAL LONGITUDINAL BRACES WILL BE REQUIRED.
 - FOR SEISMIC BRACING OF PLUMBING EQUIPMENT AND PIPING AN INDEPENDENT SEISMIC AND VIBRATION CONTROL SUBCONTRACTOR WITH EXPERIENCE, COMPUTING CAPABILITIES, AND MANUFACTURED PRODUCTS SHALL BE FURNISHED BY PLUMBING CONTRACTOR. INDEPENDENT SEISMIC CONSULTANT SHALL PROVIDE REQUIRED COMPUTATIONS, SHOP DRAWINGS, AND MANUFACTURED PRODUCTS TO MEET THE MINIMUM REQUIREMENTS OF ASCE 7-22 AND INTERNATIONAL BUILDING CODES (LATEST ADOPTED EDITION) FOR THE RESPECTIVE SEISMIC DESIGN FOR SEISMIC ZONE WITH IMPORTANCE FACTOR 1.5. SEISMIC SUBCONTRACTOR SHALL EXERCISE THE QUALITY CONTROL FOR THIS WORK AND SHALL NOT BE LIMITED TO INSTRUCTIONS DIRECTED TO THE PLUMBING CONTRACTOR. THE SEISMIC SUBCONTRACTOR SHALL CERTIFY IN WRITING THAT THEY HAVE INSPECTED THE INSTALLATION AND THAT ALL ISOLATION ANCHORS AND SEISMIC RESTRAINT MATERIALS ARE INSTALLED CORRECTLY AND FUNCTIONING PROPERLY. CERTIFICATION SHALL BE PROVIDED AFTER ALL CORRECTIVE WORK HAS BEEN COMPLETED

- SUBMITTAL NOTES:**
- CONTRACTOR TO ALLOW 10 WORKING DAYS FOR SUBMITTAL TURNAROUND.
 - CONTRACTOR TO PROVIDE SUBMITTALS FOR ALL EQUIPMENT AND MATERIALS IN A SINGLE PACKAGE. PIECEMEAL SUBMITTALS WILL BE RETURNED WITH A NOTE TO REVISE AND RESUBMIT.
 - SUBMITTALS WILL BE CHECKED FOR COMPLIANCE WITH CAPACITY REQUIREMENTS AND ELECTRICAL REQUIREMENTS. CONTRACTOR TO VERIFY THAT WEIGHTS, DIMENSIONS, AND DUCT CONNECTIONS ON SUBMITTED EQUIPMENT IS CONSISTENT WITH SCHEDULED EQUIPMENT PRIOR TO SUBMITTAL. CHANGES IN SCOPE BROUGHT ABOUT BY SUBMITTED EQUIPMENT THAT DOES NOT COMPLY WITH THE WEIGHTS, DIMENSIONS, OR CONNECTION LOCATIONS ON SCHEDULED EQUIPMENT SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR.

ROYAL ENGINEERING
ELECTRICAL 1837 S. EAST BAY BLVD. PHONE: 801.375.2228
MECHANICAL PROVO, UTAH 84606 FAX: 801.375.2676

COPYRIGHT JOB# J22162.00 DATE PLOTTED: 03/29/2023

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INCOMPLETE UNLESS IN CONJUNCTION WITH ARCHITECTURAL PREPARATIONS, DESIGN, OBSERVATIONS AND ADMINISTRATION. USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT WRITTEN PERMISSION CONSTITUTES VIOLATION OF UTAH U.C.A. § 33-2-10(1), WHICH DOES AND OTHER STATES WITHIN THE SCOPE OF U.C.A. § 33-2-10(1), WHICH DOES AND OTHER STATES WITHIN THE SCOPE OF U.C.A. § 33-2-10(1).

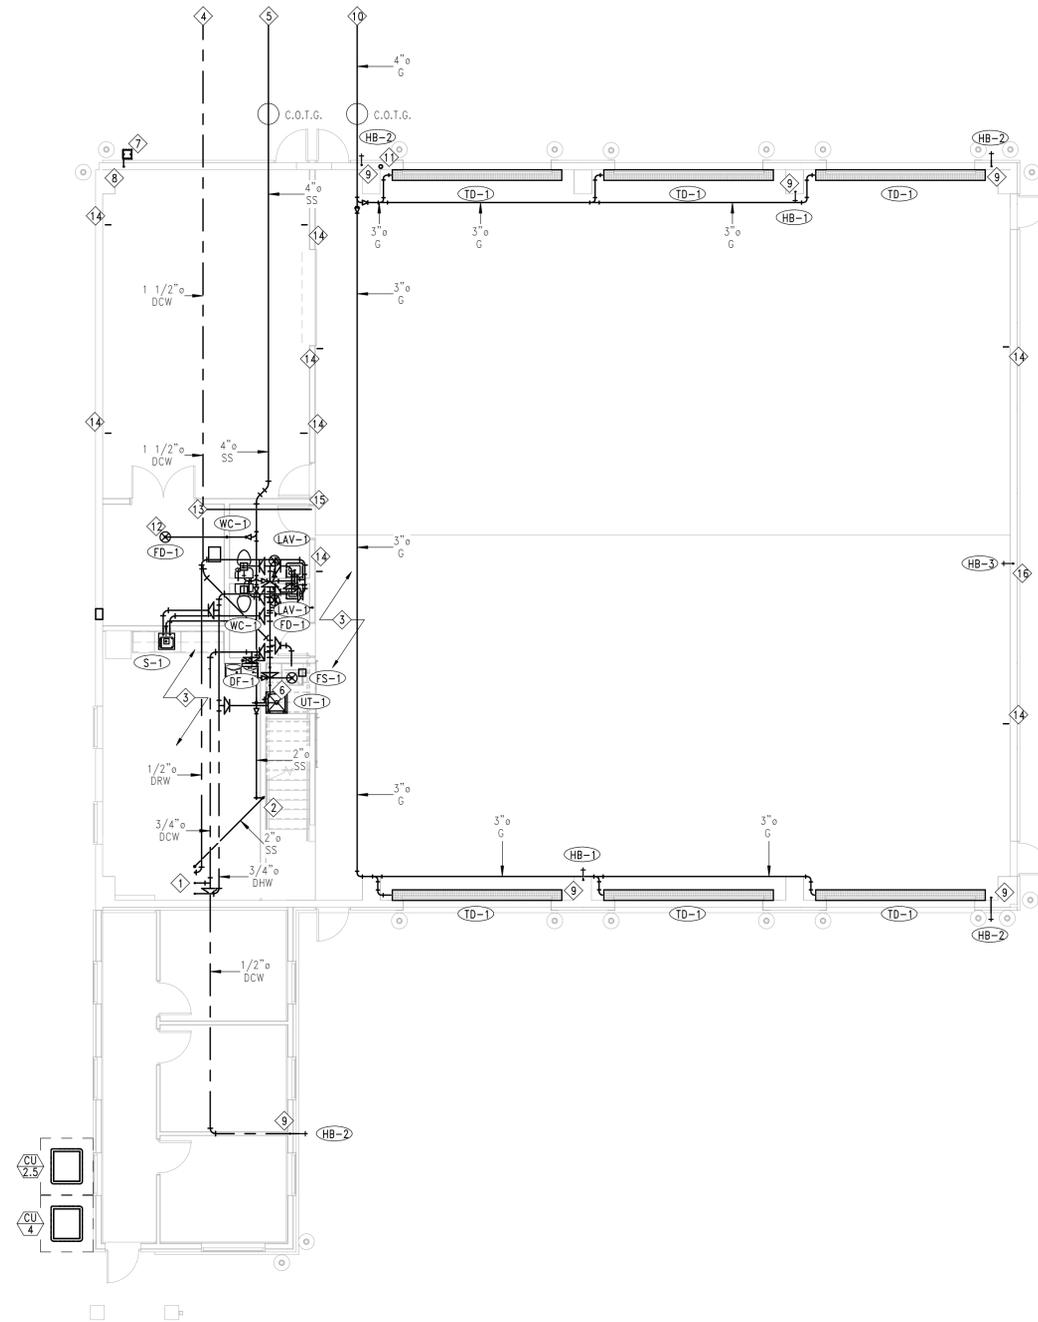

MAIN FLOOR PLUMBING PLAN - BUILDING #1

1/8" = 1'-0"

PLUMBING KEYED NOTES:

- 1 ANTICIPATED LOCATION OF 3/4" HOT WATER DROP, 3/4" COLD WATER RISER, AND 1/2" RETURN WATER RISER.
- 2 PROPOSED LOCATION OF 2" SANITARY SEWER DROP TO LEVEL BELOW. SEE PLUMBING SCHEMATICS FOR STACK SIZING AND VENT SIZING. FIELD VERIFY FINAL LOCATION WITH STRUCTURE.
- 3 SEE SHEET P4.1 FOR ENLARGED VIEW OF THIS AREA.
- 4 FIELD VERIFY EXACT LOCATION OF DOMESTIC WATER LINE. SEE WATER PIPING SCHEMATICS FOR METER AND PIPING SIZING. SEE CIVIL UTILITIES PLAN FOR CONTINUATION.
- 5 FIELD VERIFY 4" SEWER LINE CONNECTION LOCATION AND INVERT DEPTH WITH CIVIL UTILITIES. FINAL ROUTING DETERMINED IN FIELD WITH STRUCTURE AND SITE CONDITIONS. ANTICIPATED MINIMUM INVERT ELEVATION 43" B.F.F..
- 6 PROPOSED LOCATION FOR PRV STATION, BUILDING CHECK VALVE, AND MAIN BUILDING SHUT-OFF VALVE. INSTALL 1-1/2" WATER PIPING RISER TO CEILING SPACE FOR BUILDING DISTRIBUTION. SEE PLUMBING DETAILS.
- 7 PROPOSED LOCATION FOR GAS METER, COORDINATE LOCATION AND ALL REQUIREMENTS WITH GAS COMPANY.
- 8 PROPOSED LOCATION OF 3/4" NATURAL GAS RISER TO ABOVE FROM CEILING LEVEL.
- 9 ANTICIPATED LOCATION OF 1/2" CULINARY WATER DROP TO HOSE BIB BELOW.
- 10 PROPOSED LOCATION OF SAND-OIL SEPARATOR (500 GALLON MINIMUM). 4" MAIN DRAINAGE TO CONNECT TO MAIN SEWER LINE AFTER SAND-OIL SEPARATOR. SAND OIL SEPARATOR SHALL HAVE A SAMPLING MANHOLE (SAND-OIL SEPARATOR SAMPLING MANHOLE SHALL BE 4" DIAMETER PER APWA STANDARD PLAN 411) AND 3" VENT TO ROOF. COORDINATE FINAL SAND-OIL SEPARATOR LOCATION AND SIZING WITH OWNER'S REPRESENTATIVE. ALL COVERS SHALL BE TRAFFIC RATED. ANTICIPATED MINIMUM INVERT ELEVATION 18" B.F.F..
- 11 ANTICIPATED LOCATION OF SAND-OIL INTERCEPTOR VENT TO ROOF.
- 12 PROPOSED LOCATION OF FLOOR DRAIN INSTALLED IN FLOOR SYSTEM (FLOOR SYSTEM SHALL SLOPE TO DRAIN). INSTALL PER MANUFACTURER'S RECOMMENDATIONS AND COORDINATE FINAL LOCATION IN FIELD WITH OWNER'S REPRESENTATIVE.
- 13 APPROXIMATE LOCATION OF OWNER PROVIDED COMPRESSOR WITH 2" AIR LINE RISER TO CEILING LEVEL. COORDINATE EXACT REQUIREMENTS WITH OWNER'S REPRESENTATIVE. PIPING REFLECTS A COMPRESSOR CAPABLE OF 160 SCFM.
- 14 PROPOSED LOCATION OF 1" COMPRESSED AIR LINE DROP WITH SHUT-OFF VALVE AND SPLIT TEE AT WORK TABLE LEVEL. FIELD COORDINATE TERMINATION HEIGHT AND ALL REQUIREMENTS WITH OWNER'S REPRESENTATIVE.
- 15 ANTICIPATED LOCATION OF 2" COMPRESSED AIR RISER TO LEVEL ABOVE.
- 16 ANTICIPATED LOCATION OF 3/4" CULINARY WATER DROP TO HOSE BIB BELOW.

These plans, drawings, and designs are the property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 03.03.2023
Revision:



Alan R. Poulsen
Bruce T. Fallon

WPA Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

BID/PERMIT SET - 05.19.2023

FACILITES SHOP

SPANISH FORK CITY


SPANISH FORK, UTAH 84660

433 SOUTH MAIN STREET

P1.1

PLUMBING FLOOR PLAN

ROYAL ENGINEERING
ELECTRICAL MECHANICAL
1837 S. EAST BAY BLVD. PROVO, UTAH 84606
PHONE: 801.375.2228 FAX: 801.375.2676
COPYRIGHT © JOB# J22162.00 DATE PLOTTED: 03/03/2022
THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INCOMPLETE UNLESS IN CONJUNCTION WITH ORAL ENGINEERING INTERPRETATIONS, SPECIFICATIONS, OBSERVATIONS AND ADMINISTRATIVE RECORDS. USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT WRITTEN PERMISSION OF ROYAL ENGINEERING IS PROHIBITED. COPYRIGHT ©, STATUTORY AND OTHER RESERVED RIGHTS REFER TO 2022 U.S.G. PAR. 51.119911, WHICH PREEMPTS STATE AND LOCAL PUBLIC RECORD ACTS. REFER TO ACT 17 U.S.G. PAR. 201.119911.

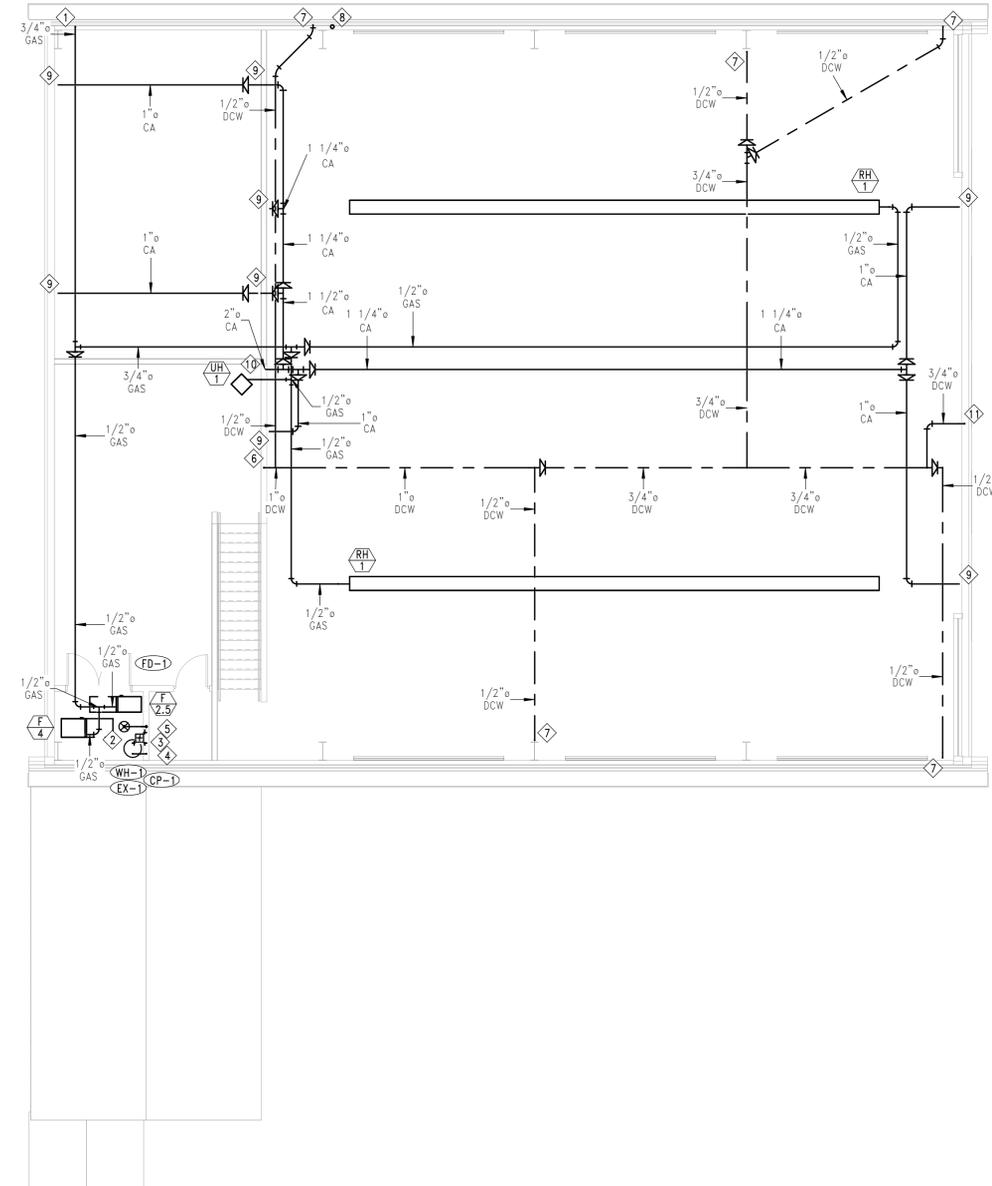

MEZZANINE PLUMBING PLAN - BUILDING #1

1/8" = 1'-0"

PLUMBING KEYED NOTES:

- 1 PROPOSED LOCATION OF 3/4" NATURAL GAS RISER TO ABOVE FROM CEILING LEVEL.
- 2 PROPOSED LOCATION OF FLOOR DRAIN INSTALLED IN FLOOR SYSTEM (FLOOR SYSTEM SHALL SLOPE TO DRAIN). INSTALL PER MANUFACTURER'S RECOMMENDATIONS AND COORDINATE FINAL LOCATION IN FIELD WITH OWNER'S REPRESENTATIVE.
- 3 ANTICIPATED LOCATION OF 3/4" HOT WATER DROP, 3/4" COLD WATER RISER, AND 1/2" RETURN WATER RISER.
- 4 PROVIDE AND INSTALL CP-1 WITH 1/2" HOT WATER RETURN PIPING FROM THE FURTHEST FIXTURE GROUP(S) TO A COMMON 1/2" HOT WATER RETURN LOOP. INSTALL CP-1 PER MANUFACTURER'S RECOMMENDATIONS IN MECHANICAL ROOM. ROUTE PIPING WITHIN CONCEALED WALL/CEILING/DROP CAVITIES.
- 5 PROPOSED LOCATION OF 2" SANITARY SEWER DROP TO LEVEL BELOW. SEE PLUMBING SCHEMATICS FOR STACK SIZING AND VENT SIZING. FIELD VERIFY FINAL LOCATION WITH STRUCTURE.
- 6 ANTICIPATED LOCATION OF 1" CULINARY WATER RISER TO LEVEL ABOVE.
- 7 ANTICIPATED LOCATION OF 1/2" CULINARY WATER DROP TO HOSE BIB BELOW.
- 8 ANTICIPATED LOCATION OF SAND-OIL INTERCEPTOR VENT TO ROOF.
- 9 PROPOSED LOCATION OF 1" COMPRESSED AIR LINE DROP WITH SHUT-OFF VALVE AND SPLIT TEE AT WORK TABLE LEVEL. FIELD COORDINATE TERMINATION HEIGHT AND ALL REQUIREMENTS WITH OWNER'S REPRESENTATIVE.
- 10 ANTICIPATED LOCATION OF 2" COMPRESSED AIR RISER TO LEVEL ABOVE.
- 11 ANTICIPATED LOCATION OF 3/4" CULINARY WATER DROP TO HOSE BIB BELOW.

These plans, drawings, and designs are the exclusive property of WPA-Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 03.03.2023
Revision:



Alan R. Pouison
Bruce T. Fallon

WPA Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com



BID/PERMIT SET - 05.19.2023

FACILITES SHOP

SPANISH FORK CITY

SPANISH FORK, UTAH 84660

433 SOUTH MAIN STREET

P1.2





PLUMBING MEZZ PLAN



ELECTRICAL 1837 S. EAST BAY BLVD. PHONE: 801.375.2228
MECHANICAL PROVO, UTAH 84606 FAX: 801.375.2676

COPYRIGHT © JOB# J2162.00 DATE PLOTTED: 03/03/2022

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INCOMPLETE UNLESS IN CONNECTION WITH ROYAL ENGINEERING'S INTERPRETATIONS, SECTIONS, OBSERVATIONS AND ADMINISTRATIONS. USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT ROYAL ENGINEERING'S CONSENT IS A VIOLATION OF FEDERAL COPYRIGHT STATUTE AND OTHER RESERVED RIGHTS. REFER TO UTAH P.E. PAR. 31-11901, WHICH PREEMPTS STATE AND LOCAL PUBLIC RECORD ACTS. REFER TO ACT 17 U.S.C. PAR. 201 (1991).

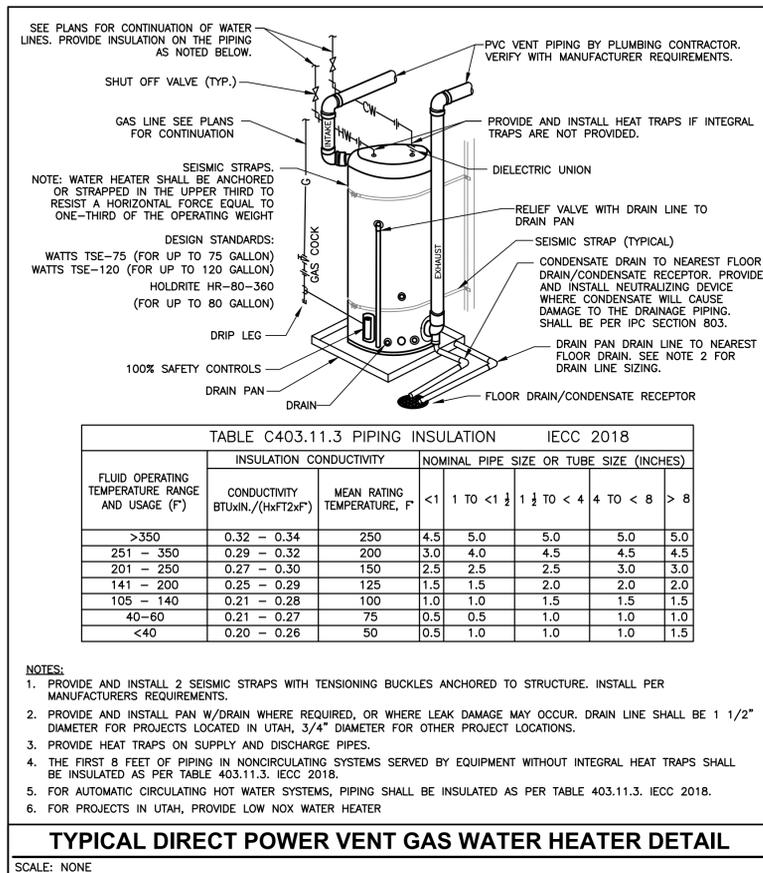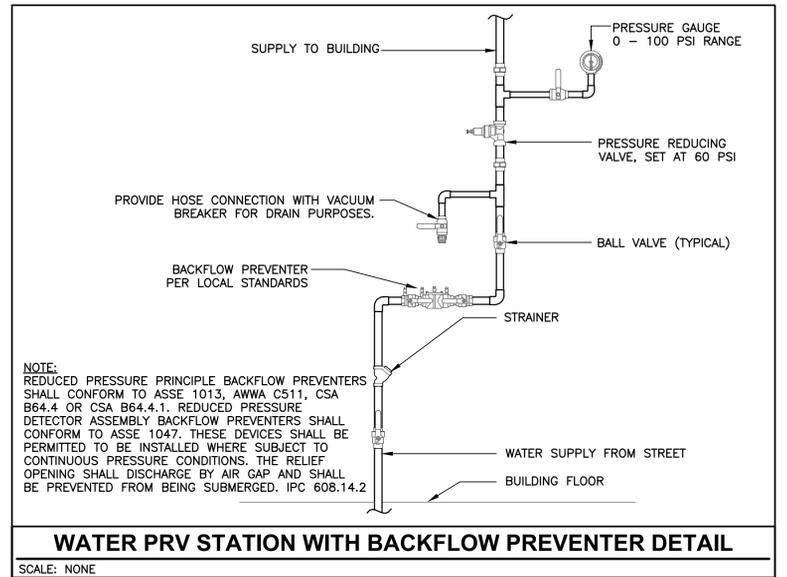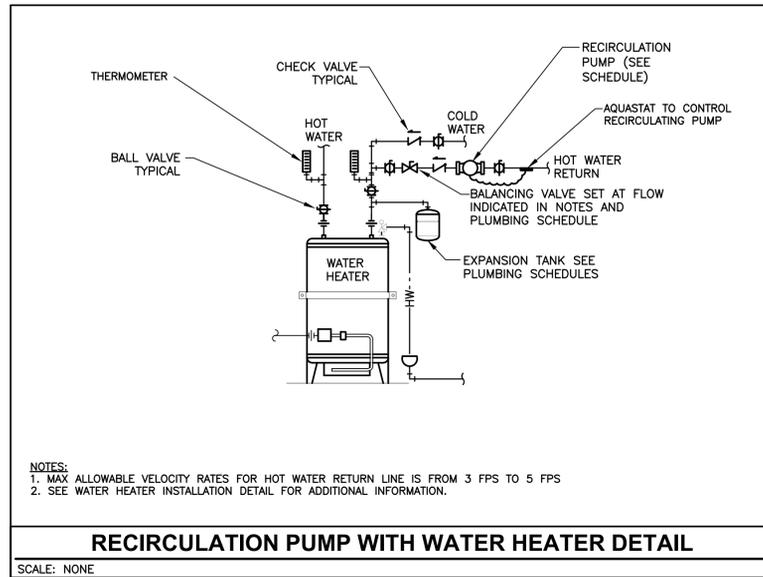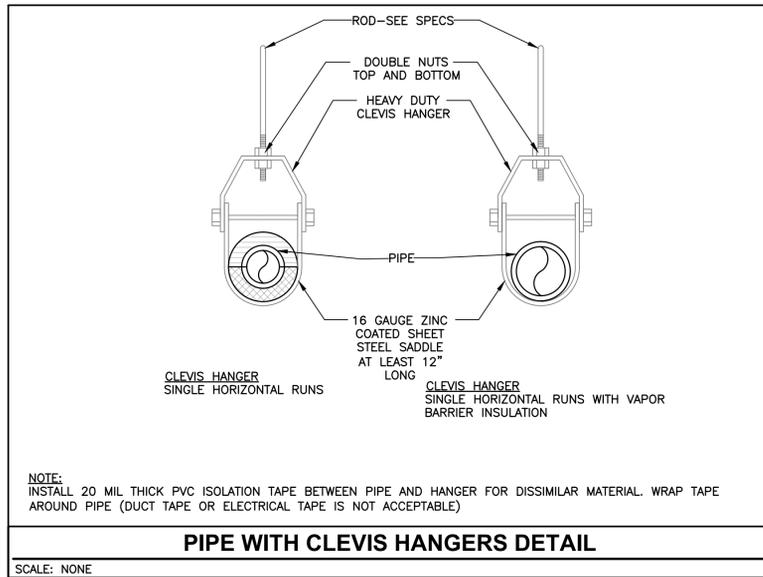

MECHANICAL PIPING - MINIMUM INSULATION THICKNESS

SERVICE	TEMPERATURE RANGE (°F)	PIPE SIZE (IN.)						NOTES
		< 1	1 TO 1-1/2	2 TO 3-1/2	4 TO 7-1/2	8 & LARGER		
> 120 PSI STEAM	> 350	2.5	3	3	4	4	1, 2, 3, 5, 6	
16 - 120 PSI STEAM	251 - 350	1.5	2.5	3	3	3	1, 2, 3, 5, 6	
0 - 15 PSI STEAM	201 - 250	1.5	1.5	3	3	3	1, 2, 3, 5, 6	
HOT WATER	141 - 200	1.5	1.5	2	2	2	1, 3, 5, 6	
HOT WATER	105 - 140	1.5	1.5	2	2	2	1, 3, 5, 6	
COOLING SYSTEMS	40 - 60	1.5	1.5	2	2	2	1, 3, 4, 5, 6	
COOLING COIL CONDENSATE	32 - 65	.5	.5	.5	.5	.5	1, 5, 6	

- INSULATION CONDUCTIVITY NOT TO EXCEED 0.27 BTU PER INCH. WHERE INSULATION IS NOT EQUAL TO 0.27 BTU PER INCH THE INSULATION THICKNESS SHALL BE INCREASE AS DIRECTED IN THE INTERNATIONAL ENERGY CONSERVATION CODE.
- STEAM SERVICE INCLUDES BOTH STEAM AND CONDENSATE RETURN PIPING.
- INSULATION THICKNESS FOR RUN-OUT PIPING BETWEEN THE CONTROL VALVE AND HVAC EQUIPMENT MAY BE REDUCED TO 1".
- COOLING SYSTEMS INCLUDE CHILLED WATER, CHILLED BRINE, REFRIGERANT SUCTION, REFRIGERANT HOT GAS, AND CONDENSER WATER AND HEAT RECOVERY PIPING FALLING WITHIN THE LISTED TEMPERATURE RANGE.
- INSULATION THICKNESS FOR PIPING LOCATED OUTDOORS OR EXPOSED TO OUTSIDE AIR SHALL BE INCREASED BY 1".
- WHERE SCHEDULED THICKNESS DIFFERS FROM SPECIFICATIONS THE THICKER DIMENSION SHALL BE USED.


PLUMBING PIPING - MINIMUM INSULATION THICKNESS

SERVICE	TEMPERATURE RANGE (°F)	PIPE SIZE (IN.)						NOTES
		< 1	1 TO 1-1/2	2 TO 3-1/2	4 TO 7-1/2	8 & LARGER		
DOMESTIC COLD WATER	45 - 90	1	1	1	1	1	1, 2, 3	
DOMESTIC HOT WATER	90+	1	1	1.5	1.5	1.5	1, 2, 3, 4	
SERVICE HOT WATER	90+	1	1	1.5	1.5	1.5	1, 2, 3, 4	
ROOF DRAIN PIPING	32+	1	1	1	1	1	1, 2, 3, 5	

- INSULATION CONDUCTIVITY NOT TO EXCEED 0.27 BTU PER INCH. WHERE INSULATION IS NOT EQUAL TO 0.27 BTU PER INCH THE INSULATION THICKNESS SHALL BE INCREASE AS DIRECTED IN THE INTERNATIONAL ENERGY CONSERVATION CODE.
- INSULATION THICKNESS FOR PIPING LOCATED OUTDOORS OR EXPOSED TO OUTSIDE AIR SHALL BE INCREASED BY 1".
- WHERE SCHEDULED THICKNESS DIFFERS FROM SPECIFICATIONS THE THICKER DIMENSION SHALL BE USED.
- SERVICE AND DOMESTIC HOT WATER INCLUDES RE-CIRCULATION LOOP PIPING.
- ROOF DRAIN PIPING INCLUDES DRAIN BOWELS AND OVERFLOW DRAIN PIPING.









PIPING INSULATION DETAIL

SCALE: NONE

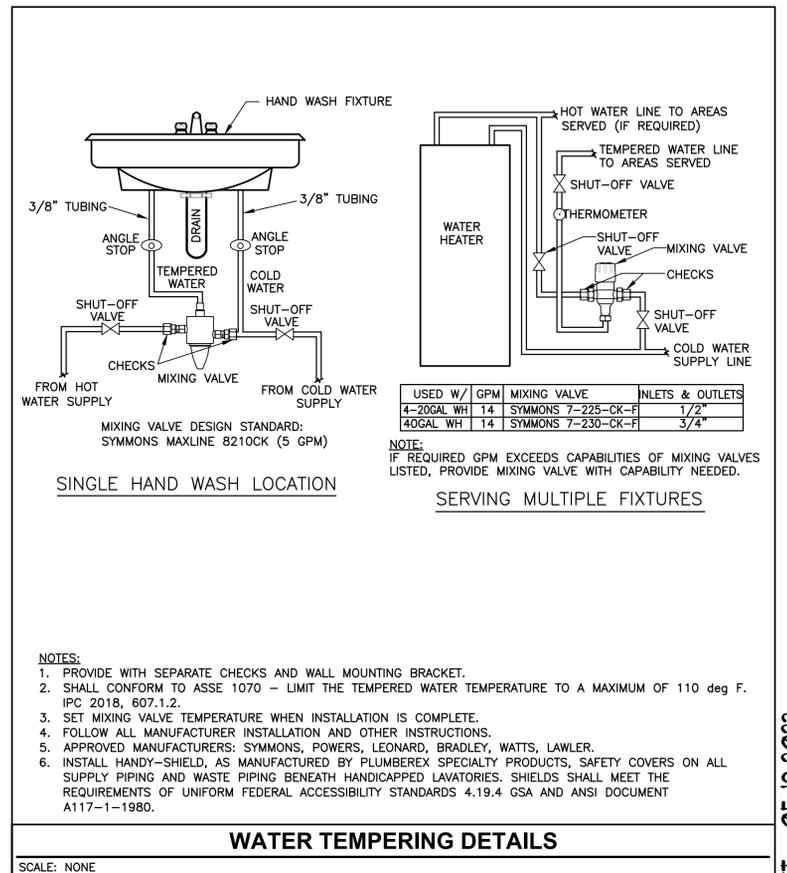

ROYAL ENGINEERING
 ELECTRICAL 1837 S. EAST BAY BLVD. PHONE: 801.375.2228
 MECHANICAL PROVO, UTAH 84606 FAX: 801.375.2676
 COPYRIGHT © JOB# J22162.00 DATE PLOTTED: 03/29/2023

Date: 03.03.2023
 Revision:
 Alan R. Poulson
 Bruce T. Fallon
 WPA architecture
 475 North Freedom Blvd.
 Provo, Utah 84601
 Tel: (801) 374-0800
 info@wpa-architecture.com
 SPANISH FORK, UTAH 84680
 SPANISH FORK CITY
 433 SOUTH MAIN STREET
 FACILITIES SHOP
 BID/PERMIT SET - 05.19.2023
 P5.1
 PLUMBING DETAILS

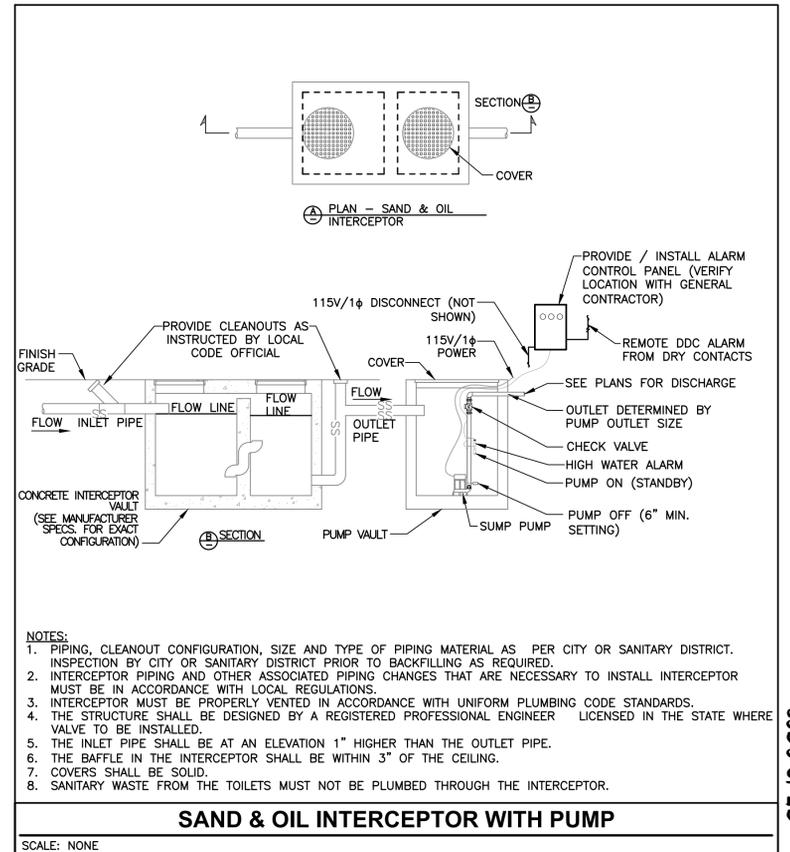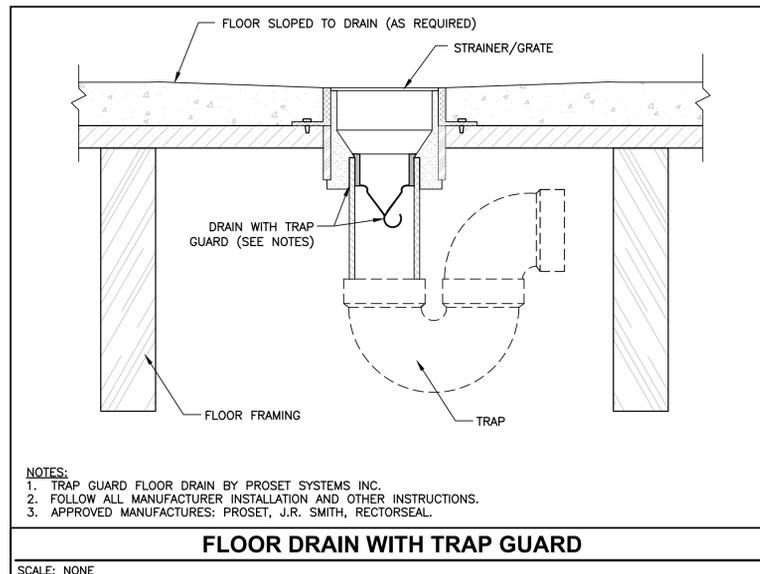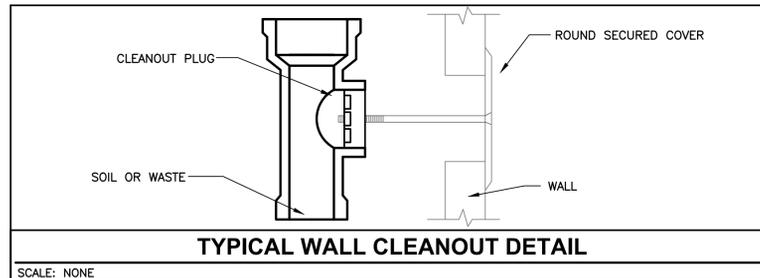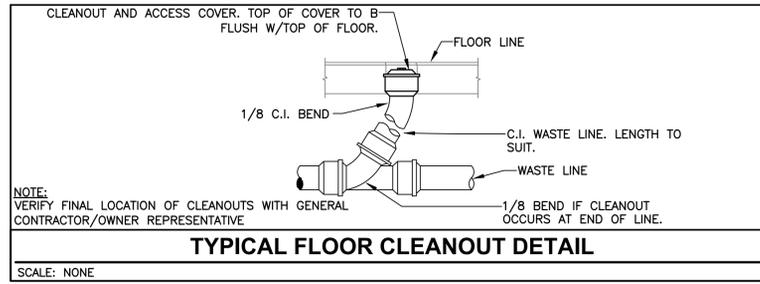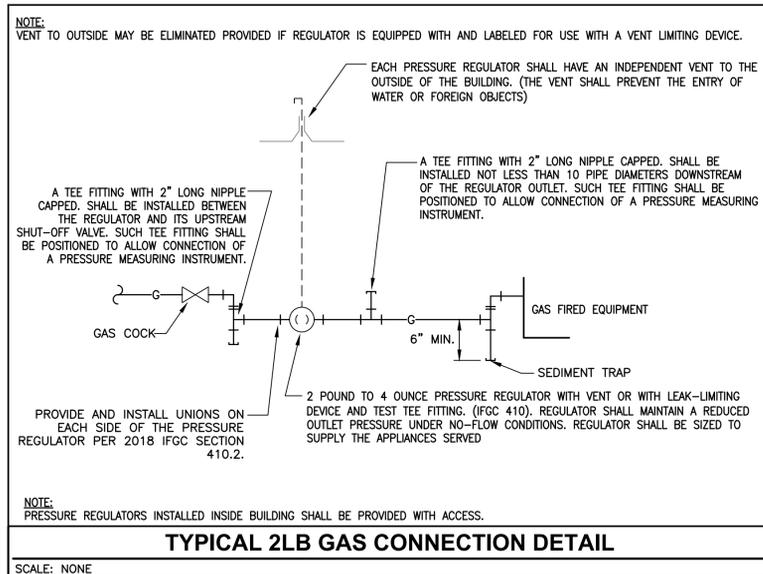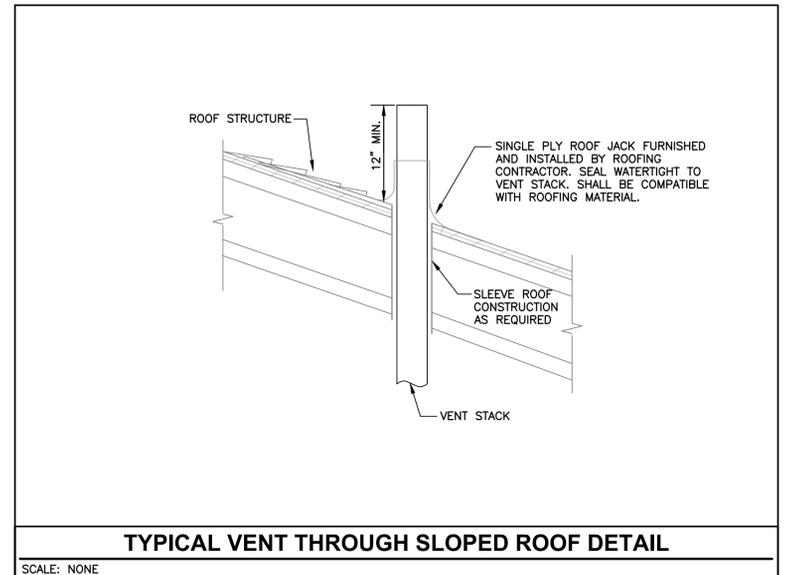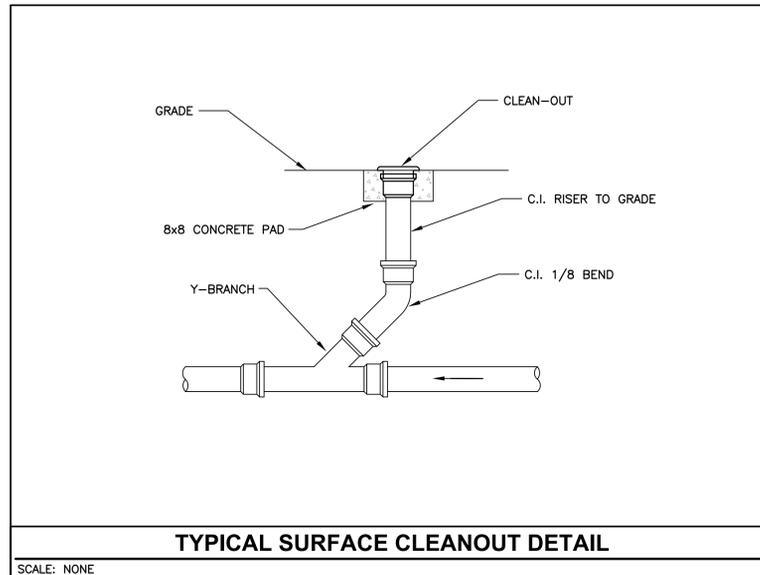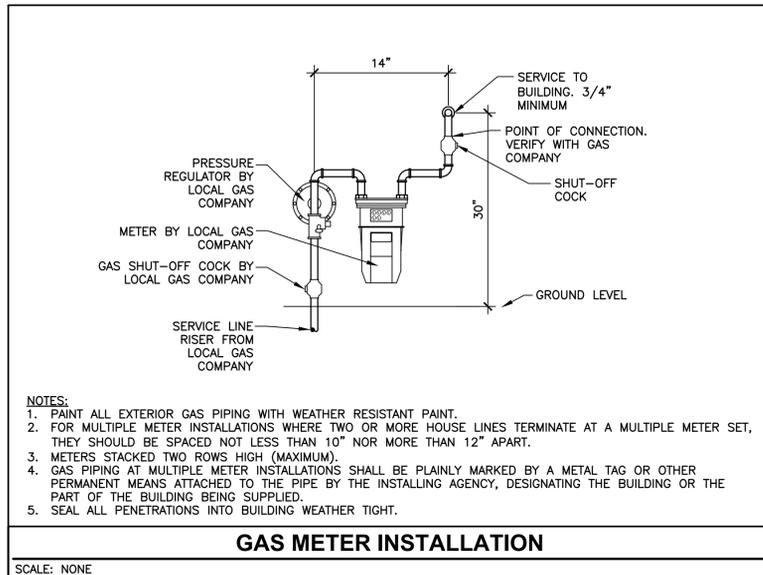

These plans, drawings, and designs are the exclusive property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 03.03.2023
 Revision:

Alan R. Poulson
 Bruce T. Fallon

WPA Architecture
 475 North Freedom Blvd.
 Provo, Utah 84601
 Tel: (801) 374-0800
 info@wpa-architecture.com

SPANISH FORK, UTAH 84660

FACILITIES SHOP
 SPANISH FORK CITY

433 SOUTH MAIN STREET

BID/PERMIT SET - 05.19.2023


P5.2
 PLUMBING DETAILS

ROYAL ENGINEERING


ELECTRICAL MECHANICAL
 1837 S. EAST BAY BLVD. PROVO, UTAH 84606
 PHONE: 801.375.2228 FAX: 801.375.2676

COPYRIGHT JOB# J22162.00 DATE PLOTTED: 03/29/2023

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INCOMPLETE UNLESS IN CONJUNCTION WITH OTHER ENGINEERING INFORMATION. CONSULTING, OBSERVATIONS AND ADMINISTRATIVE USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT THE WRITTEN CONSENT OF THE ENGINEER IS PROHIBITED. ALL RIGHTS RESERVED. DESIGN AND OTHER RESERVED RIGHTS AREV. OF ACT 17-1, I.C. PAR. 31-11-108(1), WHICH DOES NOT STATE AND LOCAL PUBLIC RECORD ACT. REFER TO ACT 17-1, I.C. PAR. 30-11-109(1).

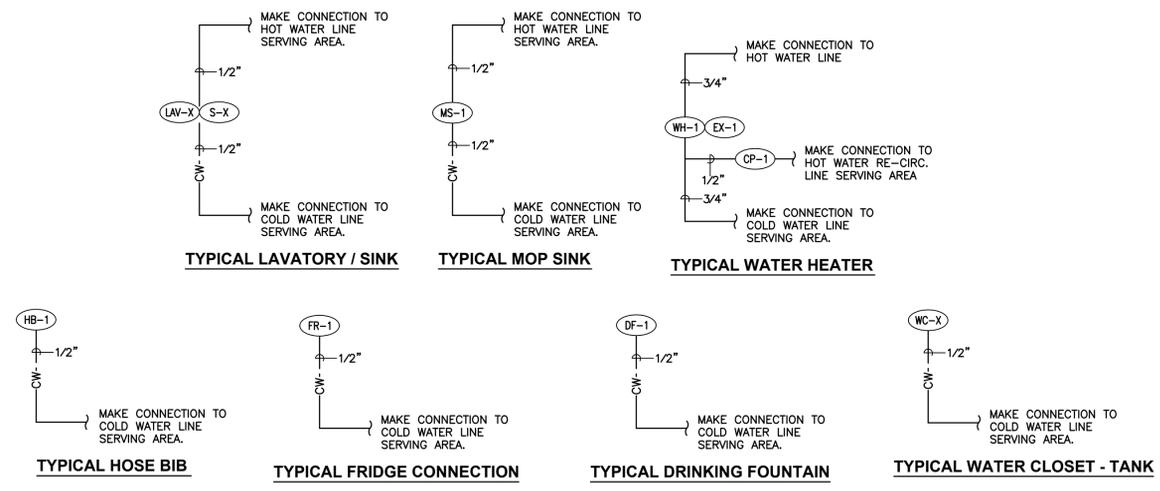

WATER PIPING SCHEMATICS
SCALE: NONE

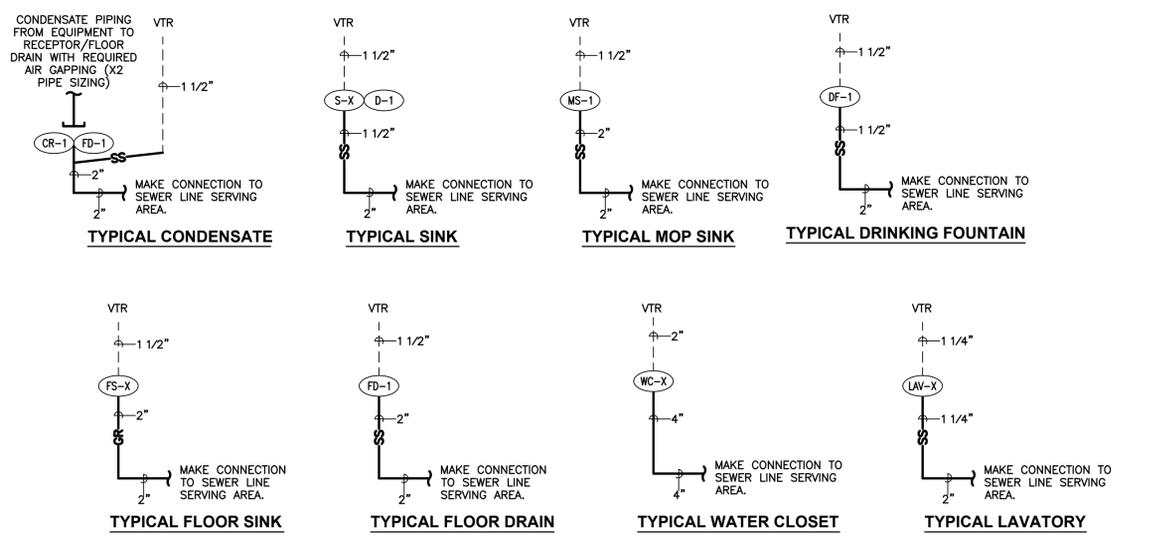


WASTE AND VENT PIPING SCHEMATICS
SCALE: NONE

GENERAL NOTE: VENT AND CONDENSATE SHALL BE 12"-24" BELOW DECK/ROOF ABOVE TO AVOID CONDENSATION ICING

MARK	FIXTURE	PIPE SIZE					REMARKS
		TRAP	WASTE	VENT	C.W.	H.W.	
CP-1	HOT WATER RE-CIRCULATION PUMP WITH AQUASTAT.	—	—	—	—	1/2"	DESIGN GUIDE: TACO 006 CIRCULATOR 2 GPM @ 7.7 FT. HEAD, 115V/1Ø/60HZ, 1/40 HP. PROVIDE WITH AQUASTAT FOR AUTOMATIC CIRCULATION PUMP CONTROL.
CR-1	CONDENSATE RECEPTOR	2"	2"	1 1/2"	—	—	CONDENSATE RECEPTOR WITH HUB FUNNEL FOR CONDENSATE FROM HIGH EFFICIENCY EQUIPMENT. PROVIDE AND INSTALL TRAP GUARD.
D-1	DISPOSAL	—	—	—	—	—	1/2 HP, 120 VOLT, 8 AMP AVE. LOAD, WASTE DISPOSAL WITH DISHWASHER DRAIN CONNECTION. CONNECT TO SINK AND PROVIDE ALL MOUNTING HARDWARE. CONTROL BY ELECTRICAL CONTRACTOR.
DF-1	DRINKING FOUNTAIN-HI/LOW	1 1/2"	1 1/2"	1 1/2"	1/2"	—	ELKAY E2H20 ADA COMPLIANT DRINKING FOUNTAIN WITH BOTTLE FILLER, STAINLESS STEEL, WALL HUNG, HI-LO DUAL FOUNTAINS, GENERAL USE WITH FOUNTAIN CARRIER, 335 WATT, 4.4A, 120V.
EX-1	EXPANSION TANK	—	—	—	3/4"	—	WATTS PLT-5 (OR EQUAL), DRAWN STEEL POTABLE WATER EXPANSION TANK WITH DIAPHRAGM SEPARATING THE AIR CHAMBER FROM THE WATER CHAMBER. DIAPHRAGM MATERIALS SHALL BE FDA APPROVED.
FD-1	FLOOR DRAIN	2"	2"	1 1/2"	—	—	FLOOR DRAIN WITH STRAINER. PROVIDE AND INSTALL TRAP GUARD. SEE ARCHITECTURAL DRAWINGS FOR FLOOR TYPE.
FS-1	FLOOR SINK	2"	2"	1 1/2"	—	—	SANITARY FLOOR SINK WITH ACID RESISTING WHITE PORCELAIN ENAMEL COATED INTERIOR, LOOSE SET PORCELAIN ENAMEL COATED GRATE WITH ANTI-SPLASH DOME BOTTOM STRAINER.
HB-1	HOSE BIB, INTERIOR	—	—	—	1/2"	—	WALL MOUNTED HOSE BIB WITH ANTI-SIPHON VACUUM BREAKER AND VALVE.
HB-2	HOSE BIB, EXTERIOR	—	—	—	1/2"	—	FREEZELESS WALL MOUNTED HOSE BIB WITH ANTI-SIPHON VACUUM BREAKER.
HB-3	HOSE BIB, INTERIOR	—	—	—	3/4"	—	WALL MOUNTED HOSE BIB WITH ANTI-SIPHON VACUUM BREAKER AND VALVE.
LAV-1	LAVATORY-COUNTER MOUNTED-ADA COMPLIANT	1 1/4"	1 1/4"	1 1/4"	1/2"	1/2"	WESTERN POTTERY, COUNTERTOP MOUNTED, VITREOUS CHINA BASIN, SINGLE LEVER MOEN 8413 FAUCET AND SAFETY COVERS FOR ALL EXPOSED PIPING. SEE ARCHITECTURAL DRAWINGS.
S-1	SINK-COUNTER MOUNTED-SINGLE BOWL	1 1/2"	1 1/2"	1 1/2"	1/2"	1/2"	ELKAY-CELEBRITY, 18"x18" SINGLE BOWL, STAINLESS STEEL SINK, COUNTERTOP MOUNTED WITH LEDGEBACK, MOEN FAUCET (W/4" BLADE HANDLES) AND SAFETY COVERS FOR ALL EXPOSED PIPING.
TD-1	TRENCH DRAIN	3"	3"	2"	—	—	16" TRENCH DRAIN SYSTEM (12" WIDTH) INSTALLED PER MANUFACTURER'S RECOMMENDATIONS. DESIGN GUIDE: ZURN Z712 WITH CLASS D GRATE
UT-1	RAISED UTILITY SINK	2"	2"	1 1/2"	1/2"	1/2"	STAINLESS STEEL RAISED UTILITY SINK, WALL HUNG AMERICAN STANDARD FAUCET WITH THREADED HOSE CONNECTION.
WC-1	WATER CLOSET-FLOOR MOUNT-TANK-ADA COMPLIANT (COMMON AREAS) 1.28 GPF	INT.	4"	2"	1/2"	—	ADA COMPLIANT VITREOUS CHINA ELONGATED TANK TOILET, OPEN SEAT W/O COVER. SEE ARCHITECTURAL DRAWINGS FOR HEIGHTS AND CLEARANCES.
WH-1	50 GALLON WATER HEATER - POWER DIRECT VENT - LOW NOX	—	—	—	3/4"	3/4"	DESIGN GUIDE: BRADFORD WHITE URG2PDV50S6N, 50 GALLON NATURAL GAS WATER HEATER W/ DRAIN PAN AND DRAIN, 43 g.p.h RECOVERY @ 90° RISE, 40,000 BTU INPUT, 120V/1Ø, POWER DIRECT VENT.

NOTES:
1. VERIFY ALL MANUFACTURERS, FINISHES, AND OPTIONS WITH OWNER BEFORE ORDERING ANY PLUMBING FIXTURES.
2. MINIMUM UNDERGROUND SANITARY SEWER PIPING SIZE SHALL BE 2 INCHES.

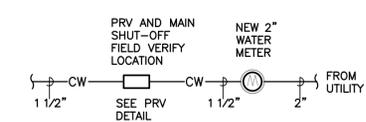

WATER METER

BUILDING WATER PIPING CALCULATIONS

DESIGN CONDITIONS

CITY	- SPANISH FORK, UTAH
DEVELOPED PIPE LENGTH	- 200 FEET (VERIFY)
WATER PRESSURE	- 60 psi MIN. (VERIFY)
ANTICIPATED FIXTURE UNITS	- 51 fu

MINIMUM COMPOUND METER SIZE: 2"
MINIMUM MAIN DISTRIBUTION LINE SIZE: 1-1/2"
51 FU = APPROXIMATELY 30 GPM

GAS PIPING CALCULATIONS

DESIGN CONDITIONS

CITY	- SPANISH FORK, UTAH
LONGEST GAS PIPE	- 200 FEET (VERIFY)
GAS PRESSURE	- 2 POUND (VERIFY)
DERATION FACTOR	- 876

EQUIPMENT

RH-1 (x2)	343 CFH	(300,000 BTU/HR)
F-2.5	69 CFH	(60,000 BTU/HR)
F-4	92 CFH	(80,000 BTU/HR)
WH-1	46 CFH	(40,000 BTU/HR)
TOTAL	418 CFH	(365,000 BTU/HR)

NOTE: SEE PLUMBING FLOOR PLANS FOR GAS SCHEMATIC LAYOUT AND ALL SIZING.

Date: 03.03.2023
Revision:

Alan R. Poulson
Bruce T. Fallon

WPA
Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

SPANISH FORK, UTAH 84680

FACILITIES SHOP
SPANISH FORK CITY
433 SOUTH MAIN STREET

BID/PERMIT SET - 05.19.2023

ROYAL ENGINEERING
ELECTRICAL MECHANICAL
1837 S. EAST BAY BLVD. PROVO, UTAH 84606
PHONE: 801.375.2228 FAX: 801.375.2676
COPYRIGHT © JOB# J22162.00 DATE PLOTTED: 03/29/2023

P6.1
PLUMBING SCHEDULES AND SCHEMATICS

SECTION 22 PLUMBING – GENERAL PROVISIONS
 Not all specification items are used in every project.

PART 1 – GENERAL

– Scope:

Furnish all labor, materials, equipment, appliances and necessary incidentals for the complete installation of all plumbing shown on the drawings and as specified.

A. Work specified in this section

1. Sanitary soil, waste and vent systems.
2. Domestic hot and cold water systems.
3. Domestic water heaters.
4. Furnish and set all sleeves for pipes passing through walls and floors.
5. Pipe covering, insulation and wrapping.
6. Excavation and backfill.
7. Rough-in and final connections to air conditioning equipment of condensate drains.
8. All plumbing fixtures, water heaters, valves, and other miscellaneous items or equipment required for a complete installation.
9. Provide collars at fire rated penetrations.

B. Provisions of this section apply to all work specified in all sections under Division 22. All items indicated on site, Architectural, Mechanical, or Plumbing drawings are to be provided complete from point of connection to finished fixture in conformance with all governing authority requirements. Nothing in these drawings or specifications shall be construed to permit work in violation of governing codes.

C. In addition, work in Division 22 is governed by the provisions of the Bidding Requirements, Contract Forms, General Conditions and all sections under Division 1, General Requirements.

1. Examination of Premises: Visit the site, verify all measurements and job conditions, and pay all costs necessary to perform the work. Coordinate division of fee responsibilities with the General Contractor.
2. The Plumbing Contractor shall be licensed and hold a current contracting license as a Plumbing Contractor that has been valid for a minimum of two years in the State where the project is located.
3. The Plumbing Contractor shall have a minimum of five years experience installing commercial plumbing systems similar to those described in these specifications and provide a list of previous projects, including name of project and contact person names and phone numbers if required by the General Contractor.
4. The Plumbing Contractor shall be able to bond work he is bidding to perform and shall provide a written statement from the bonding agency proposed to be used for this project as a separate document in addition to the plumbing bid submitted if required by the General Contractor. The bonding agency shall be one having a Best's insurance rating of A or A+.

D. Contractor is responsible for results caused by deviating from the plans.

– Regulations, Permits, Fees, Charges, Inspections:

A. Regulations: Comply with all applicable codes, rules and regulations. All materials and work must comply with local construction, mechanical, plumbing, electrical and fire codes. As a minimum, comply with the following: IMC, IPC, IECC, NEC, NFPA codes and all City codes.

B. In addition to the requirements of all governing codes, ordinances and agencies, conform to the requirements of the following codes and standards:

1. 2018 International Plumbing Code
2. 2018 International Building Code
3. 2018 International Mechanical Code
4. 2018 International Energy Conservation Code.

C. Current codes adopted by the respective jurisdiction will supercede the listed codes.

D. Fees and Permits: Pay all connection, installation, use, development, etc., fees and/or charges. Obtain and pay for all required permits and licenses. Coordinate division of fee responsibilities with the General Contractor.

E. Inspections: All work must be inspected and approved by local authorities. Prior to final approval, furnish the Architect with certificates of inspections and approvals by the local authorities in accordance with Division 1.

1. Preheat and interpass temperature shall be determined by temperature indicating crayons, contact pyrometers or other equally suitable means.

F. Postweld Heat Treatment: Postweld heat treatment for pressure components shall be as specified in Table 131 of ANSI B31.1.

– Drawings and Specifications:

A. Refer to Division 1 for information on submittals and shop drawings.

B. If a conflict exists between the drawings and specifications, promptly notify the Architect and Engineer.

– Record Drawings: Provide record drawings for all work under sections in Division 22. See Division 1 for detailed requirements covering preparation of record drawings.

– Work and Materials: Unless otherwise specified, all materials must be new and of the quality specified. The workmanship shall be of a quality that is acceptable to the Architect and is equal to the standards of the trades. Contractor must staff the project with sufficient skilled workmen, including a fully qualified construction Superintendent, to complete the work in the time allotted. The Superintendent must be qualified to supervise all of the work in his work category.

– Approvals of Materials and Equipment: Refer to Division 1 for description of material and equipment for prior approvals and substitutions. Must be received by Engineer 10 days prior to due date/bid opening.

– Maintenance Manual:

A. Prior to completion of the project, compile a complete equipment and maintenance manual for all equipment supplied under sections of Division 22 as described in Division 1.

B. Manuals shall be bound in a three-ring binder. A preliminary submittal of the manual shall be made to the Architect 90 days after receiving approved submittals. Final submittal of the manual shall be made four weeks prior to substantial completion of the project.

– Equipment Purchases: Arrange for purchase and delivery of all materials and equipment within 15 days after approval of submittals. Coordinate with General Contractor.

– Cooperative Work:

A. Correct without charge any work requiring alteration due to lack of proper supervision or failure to make proper provision in time. Correct without charge any damage to adjacent work caused by the alteration. See Division 1 for additional requirements.

B. Cooperative Work Includes:

1. General supervision and responsibility for proper location, rough-in and size of work related to Division 22 but provided under other divisions of these specifications.
2. Installation of sleeves, inserts and anchors bolts for work under sections in Division 22.
3. Electrical work as specified herein. Refer to Division 26 for requirements.

– Construction Facilities:

A. General: Under this division of the specifications execute all work in a manner to provide safe and lawful ingress and egress to the Owner's establishment and such facilities shall be kept clear of materials or equipment as directed by the Architect. Refer to Division 1 for additional requirements.

B. Furnish and maintain from the beginning to the completion of all work all lawful and necessary guards, railings, fences, canopies, lights, and warning signs. Take all necessary precautions required by city and state laws to avoid injury or damage to any and all persons and property.

– Guarantee: Guarantee all material, equipment, and workmanship for all sections under Division 22 in writing to be free from defects of material and workmanship for one year from date of final acceptance as outlined in Division 1. Replace without charge any material or equipment proving defective during this period. The guarantee shall include performance of the equipment under all conditions of load, installing any additional items of control and/or protective devices as required and the replacing of any refrigerant lost.

– Electrical Work:

A. Electrical wiring, including power wiring and control wiring (except as otherwise specified under Automatic Temperature Controls), all raceways, wiring, outlet and junction boxes, and labor for installation of the wiring and equipment shall be included in Electrical Division 26 of the specifications.

B. All starters in motor control centers are to be furnished and installed under the Electrical Division of the specifications.

C. Before ordering any motors and equipment. Verify the available voltage and phase for all motors with the Electrical Contractor.

D. Submit a complete list of all motors prior to final closeout of job indicating the locations, horsepower, voltage, phase specified in Table 132 of ANSI B.1.

E. All field wiring and equipment must conform to the applicable sections of the Electrical specifications, Division 26.

– Welding Codes and Standards: All welding and other criteria covered by this specification shall be in accordance with the following code:

- A. ASME Boiler and Pressure Vessel Code
- B. Section IX ANSI Code for Power Piping: B31.1
- C. AWS D10.12.D10.12M Welded joints for gas piping.

– Product Handling

A. Protection: Take all precautions necessary to protect the materials of this section before, during, and after installation.

B. Replacements: In the event of damage, immediately repair all damaged and defective work to the approval of the Engineer, at not additional cost to the Owner.

– Submittals:

A. Manufacturer's Literature: Within 35 days after award of contract and before any of the materials of this section are delivered to the job site submit seven complete brochures of all materials and equipment, per Division 1 of the specifications.

B. Other Submittals:

1. Shop Drawings.
2. Sterilization Test Report
3. Test Data.

C. Sets in bound booklet form of written operating and maintenance instructions and brochures for equipment specified in this section. Fully instruct Owners Operating Personnel.

D. Record Drawings: Keep an accurate dimensioned record of As-Built locations and elevations, as referred to approved base datum, of buried concealed.

E. Operation and Maintenance Instructions: Deliver to Architect two complete lines, manhole, cleanouts, valves, plugged tees, capped ends, and of work which is installed different from shown in the plans.

– Miscellaneous:

A. Examination of the site: Exercise care in examining the site and coordinate all work indicated on the drawings with existing conditions. Report to Architect in writing conditions that will prevent proper provisions of this work. Verify depth and location of all service lines with servicing companies having jurisdiction before excavating, by submission of the bid. The contractor warrants that he has familiarized himself with the existing conditions and will perform all work as required for hookup and as required by the contract documents at no additional cost.

B. Permits and fees: Arrange and pay for all permits, inspections and fee required by all governing agencies.

C. Service connections: Make all necessary arrangements with applicable utility company for connection to existing service lines. Pay all fees associated with work including meters, hookup charge and utility assessments fees.

D. Drawings: Coordinate all space requirements with other trades, drawings indicate desired location and arrangement of piping, equipment, and other items and are to be followed as closely as possible.

PART 2 – PRODUCTS

– General

A. Pipe sleeves and wrapping: Provide polished chromium plated and brass set screw flanges where plumbing piping pass through walls, floors, ceilings, and partitions in finished portions of building including flanges on pipes at fixtures. All sleeves in concrete and exterior walls shall be 20 GA. galvanized iron one inch O.D. larger than the pipe, caulked if below grade in a moisture proof manner. All pipes penetrating through fire walls and floors shall be properly safed with Dow Corning J=6548 silicone RTV foam or equal. Install per manufacturer's directions.

B. Pipe Identification:

1. Piping identification per ANSI and OSHA Standards: Each individual pipeline shall be marked for quick and easy identification as to contents and character of material carried in the pipes by set on SNA or STR Marker.
2. Markers shall be installed and spaced at not more than 20 foot intervals and so located that markers shall be visible where piping is exposed.
3. Color scheme shall be as follows:

	Background or Color Band	Identification Marker
Domestic Hot Water –	Yellow	Black on Yellow
Domestic Hot Water Return –	Yellow	Black on Yellow
Domestic Cold Water –	Green	White on Green
Sanitary Sewer –	Green	White on Green
Sanitary Vent –	Green	White on Green
Natural Gas –	Yellow	Black on Yellow
Storm Water –	Green	White on Green
Freon –	Black	White on Black

C. One marker shall installed at each side of valves, special fittings and at branch take-offs. In furred spaces install one band 2 feet above floor and 19 inches below ceiling line.

D. Materials: Materials when not otherwise definitely specified shall conform to the applicable ASTM, ASME, AGA and ASA standards.

E. All gas fired equipment shall include a label indicating that the appliance has been adjusted, modified or re-calibrated for the altitude where in the project is to be located (Green Sticker). The appliance shall also include a compliance statement indicating that the appliance has been adjusted, modified or re-calibrated for the proper operation at the altitude of the project and shall be listed capable for use with natural gas or propane gas if propane is listed on the drawings.

– Pipe and Fitting Schedule:

Pipe and Fittings:

- A. No pipe of foreign manufacturer will be acceptable on projects required to meet the Buy American Act.
- B. All piping, fittings, flanges, etc. shall be free from defects and shall comply with the appropriate ASTM specifications.
- C. Black steel pipe: ASTM A53 ERW Grade B, standard weight (schedule 40) or extra strong (schedule 80) as specified.
- D. Copper tubing: ASTM B88, Type L or K as specified.
- E. PVC pipe and fittings: ASTM D1785 Class 150 with ASTM D 2564 solvent cement joints unless otherwise specified. Schedule 40. PVC plastic pipe fittings: ASTM F 628, schedule 40.
- F. PEX–AL–HDPE distribution system: ASTM F 1986 tubing and metal–insert type with copper or stainless–steel clamp ring and matching PEX–AL–HDPE tube dimensions. Manifold: Multiple–outlet, plastic or corrosion–resistant–metal assembly complying with ASTM F 877: with plastic or corrosion–resistant–metal valve for each outlet.
- G. PP piping and fittings: ASTM F 2389; CSA B137.11
- H. Acrylonitrile Butadiene Styrene (ABS) plastic pipe: ASTM D 2661, schedule 40, ASTM F 628 schedule 40. ABS plastic pipe fittings: ASTM F 409, accessible and replaceable, solvent cement and threaded types, drain pattern.
- I. Cast iron soil pipe and fittings: ASTM A74
- J. Welded black steel fittings: ASTM A234 grade B, 150–Pound for standard weight piping, 300–Pound for extra strong piping, or of weight or schedule of matching piping.
- K. Threaded malleable iron fittings: ANSI B16.3, 150–Pound for standard weight piping, 300–Pound for extra strong piping, or weight or schedule of matching piping either black or galvanized to match piping.
- L. Welded flanges: ASTM A181 grade B, 150–Pound for standard weight piping, 300–Pound for extra strong piping or of equal weight of connected equipment.
- M. Copper fittings: Wrought copper, ANSI specification B16.22.
- N. Ball valves domestic water: Bronze, fullport, class 150, threaded. NIBCO T–585 or equal
- O. Partition stop valves: T&S B–0415, Loose key type with wall flange.
- P. Balancing cocks 2 inches and smaller shall be by Armstrong, NIBCO, Taco or Watts.
- Q. Solder: Joints in copper piping above grade shall be stay safe 50 solder or 95–5 solder shall be silfos or silverflow for all refrigerant piping joints.
- R. Condensate drains shall be Type L hard copper tubing with wrought–copper fittings (can't be used for condensing gas–fired applications) or PVC pipe and fittings where allowed. A P–trap shall be provided at drains.
- S. Gas piping in the building and not buried shall be standard weight black steel pipe and shall have welded fittings. Gas piping buried shall be polyethylene pipe with continuous 18 gauge tracing wire with schedule 40 black steel epoxy coated transition risers and/or transition fittings per ASTM D2513 and installed in accordance with Questor Supply Company (or local utility company) regulations. Point all exterior exposed gas piping.
- T. Chilled water and heating system lines shall be standard weight black steel. Pipe 2–1/2 inch and smaller shall either have welded fittings, mechanical grooved fittings or malleable iron screwed fittings.
- U. Domestic hot water, hot water return, and cold water piping shall be Type L or K hard tempered copper pipe with wrought–copper fittings using 95–5 solder. Pex tube piping may be used in lieu of copper on sizes 2–inches and smaller. Where piping is exposed outside partitions, use Type L or K hard copper tubing and wrought copper fittings.
- V. Domestic hot water and cold water piping buried below grade shall be Type K soft tempered (annealed) copper without fittings or joints and covered with IMCOA IMCOSHIELD uncellular insulation. PEX tube piping may be used in lieu of copper on sizes 2–inches and smaller.
- W. All soil, waste, vent, roof drain and roof drain overflow piping below ground shall be ABS or PVC plastic pipe, rated for domestic waste and vent, with ABS or PVC plastic socket type drain, waste vent pattern fittings, solvent cemented joints. Install ABS drainage pipe and fittings according to ASTM D661. Install PVC drainage pipe and fittings according to ASTM F891.
- X. All soil, waste, vent, roof drain and overflow piping above ground shall be standard weight cast iron with no hub coupling or approved material meeting the standards set forth in IPC tables 702.1, 702.2, 702.3, and 702.4..
- Y. Kitchen waste and vent serving fixtures capable of discharging or receiving waste liquids with temperatures in excess of 120 degrees F, shall be piped using No–Hub standard weight cast iron pipe for a minimum of 20 feet before changing to ABS pipe.

– Roof Flashing:

A. Sanitary Vent Flashings: SEMCO 1100–3 or 1100–5, with one–piece lead flashing and counterflashing sleeve.

– Pipe Sleeves:

A. At concrete walls for floors, adjust–to–crete, paramount, hole–out Sperzel Cretesleeve floor sleeves shall extend to top of concrete curbs for piping flashing through floors. Wall sleeves shall be flush with finished surface, sleeves shall be sized to allow 1/2 inch clearance around pipe insulation. Insulation and covering shall be continuous through wall and floor sleeves.

– Cleanouts:

A. Full size cleanouts shall be installed at the base of each soil waste stack. All other cleanouts shall be installed where shown on the drawings and where required by State, Local or National Plumbing Codes.

B. All cleanouts shall be installed in locations easily accessible for rodding. Cleanouts in wall shall be JR Smith 4402, in floors JR Smith 4023/ Cleanouts shall be JR Smith, Wade or Josam.

– Pipe Insulation:

A. All domestic hot water, hot water recirculation and cold water piping shall be covered with Owens Corning ASJ–25 fiberglass pipe insulation with vapor seal jacket. Insulation thickness shall be 1/2 inch for cold water and 1 inch for hot water.

B. Insulate all piping under Lavatories accessible to physically handicapped with hot water supply and "P" trap prefabricated insulation, Handi Lav Guard.

– Pipe Hangers:

A. Hangers shall be supplied with factory installed isolation and DI–Chromate finish.

B. Pipe 2 inches and smaller: Grinnel F69. Pipe 2–1/2 inch and larger: Grinnel F65. Concrete Inserts: Grinnel 281 and 282. Riser clamps for copper piping: Grinnel 261P, plastic coated. Riser clamps for other piping: Grinnel 261.

C. Hanger rods shall conform to the following: Pipe size 2 inch and smaller: 3/8 inch rods. Pipe size 2–1/2 inch and 3 inch: 1/2 inch rods. Pipe size 3 inch and larger: 5/8 inch rods.

– Plumbing Fixtures:

A. Fixtures shall be the water saving typer with maximum usage of 1.6 gallons per flush for water closets, 2.5 gallons per minute for showers, 3.0 gallons per minute for service sinks, 1.0 gallon per flush for urinals, 0.5 gallons per minute for public lavatories, 2.2 gallons per minute for private lavatories and 2.2 gallons per minute for sinks.

B. All fixtures shall be caulked to the floor or wall with water resistant white butyl rubber caulking compound. Trim for shall match in design. Supply faucets shall have renewable seats and barrels.

PLUMBING EQUIPMENT

MANUFACTURER

Floor Drains and Floor Sinks:	Zurn, JR Smith, Wade, Josam, Ancon, Mifab, Watts, or Equal
Trench Drains:	Zurn, JR Smith, Watts, Josam or approved equal
Roof Drains and Overflow:	Zurn, JR Smith, Wade, Watts, Josam, Ancon, Mifab
Cleanouts:	Zurn, JR Smith, Wade, Josam, Mikro, Mifab, Watts, or Equal
Valves:	Watts, Milwaukee, Crane, Kennedy, Stockham, Misson, Grinnell, Keystone, American Valve, or NIBCO
Shower Valves:	Powers, Symmons, Delta, Leonard, Moen, Bradley, Zurn, Acorn
Pipe Hangers and Supports:	Grinnell, Elcen, Kin–Line, Unistrut, F&S, B–Line, Michigan, Wesanco, or Piping Technology & Products
Insulation:	CertainTeed, Manville, Pittsburgh, Armstrong, LSP Michigan, Owens–Corning
Plumbing Faucets:	American Standard, Chicago, Delta, Moen, Kohler, Symmons, T&S, Gerber, Zurn
Plumbing Fixtures:	American Standard, Kohler, Toto, Gerber, Watts, Zurn, Sterling, Lasco
Plumbing Supply Stops:	Eastman, Crane, Kohler, Wolverine, McGuire, Brasscraft, EBC, Zurn, Chicago
Water Closets:	American Standard, Gerber, Kohler, Toto, Sterling
Flush Valves:	Sloan, Delany, Zurn, Moen, American Standard, Gerber
Toilet Seats:	American Standard, Bemis, Kohler, Sperzel, Olsonite, Beneke, Gerber or Church
Pressure Reducing Valves:	Watts series 223, Zurn or Wilkins
Hose Bibs:	Chicago, Acorn, Wolverine, Woodford, McGuire, Watts, Mifab, Josam, Zurn, Sioux Chief, Prier, Smith
Electric Water Coolers:	Elkay, Sunroc, Halsey Taylor, Haws Corporation, Westinghouse, Murdock
Stainless Steel Sinks:	Elkay, Just, Moen, or approved equal
Disposals:	Insinkerator, Evergrid, Kenmore, or approved equal
Gas Pressure Regulator:	Fisher, Equimeter, Pietro Fiorentini
Thermostatic Tempered Water Valves:	Symmons, Powers, Leonard, Bradley, Watts, Caleffi, Lawler, Acorn
P–Traps:	American Standard, Kohler, McGuire, Brasscraft, Dearborn, EBC
Shock Absorbers:	Zurn, Smith, Wade, Josam, PPP, Sioux Chief, Watts, Mifab
Sewer Ejectors:	Peabody–Barnes, Weil, Hydromatic, Gorman–Rupp, Swaby, Weinman, Zoeller
Gas Water Heaters:	AO Smith, Bradford White, Rheem, State, Rinnai, Ruud, National, PVI, or approved equal
Electric Water Heaters:	Lochnivar, AO Smith, Rheem, State, Ruud, PVI, National, EEMAX, Chromomite & Vaughn, or approved equal

– Gas Water Heater:

A. A gas water heater of the size and capacity shown on the drawings shall be furnished and installed. Water heater shall be an approved manufacturer (see approved manufacturer list in Plumbing Fixtures 2.10).

B. The tank shall be constructed in accordance with ASME code and stamped with the appropriate symbol for 150 PSI. Tank interior shall be glass lined. Tank cabinet to have a baked enamel finish with bonderized undercoat.

C. Heater shall have a 3 year warranty.

D. The water heater shall be insulated with a high density fiberglass insulation.

E. ASME pressure and temperature relief valve, temperature limiting device. A low water protection device, magnesium anode rod and drain valve shall be factory installed.



ROYAL ENGINEERING

ELECTRICAL 1837 S. EAST BAY BLVD. PHONE: 801.375.2228

MECHANICAL PROVO, UTAH 84606 FAX: 801.375.2876

COPYRIGHT JOB# J22162.00 DATE PLOTTED: 03/29/2023

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS PROPRIETARY UNLESS IN CONNECTION WITH ARCHITECTURAL, ENGINEERING, INTEROPERATIONS, DESIGN, OBSERVATIONS AND ADMINISTRATION. USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT WRITTEN PERMISSION CONSTITUTES A VIOLATION OF FEDERAL, STATE AND LOCAL LAWS AND OTHER APPLICABLE REGULATIONS. ALL RIGHTS RESERVED. THESE DOCUMENTS ARE THE PROPERTY OF ROYAL ENGINEERING, INC. AND SHALL REMAIN THE PROPERTY OF ROYAL ENGINEERING, INC. EVEN IF THEY ARE LOANED TO YOU. NO PART OF THESE DOCUMENTS SHALL BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT PERMISSION IN WRITING FROM ROYAL ENGINEERING, INC. © 2023. ALL RIGHTS RESERVED.

BID/PERMIT SET - 05.19.2023

FACILITIES SHOP

SPANISH FORK CITY

433 SOUTH MAIN STREET

P7.1

PLUMBING SPECIFICATIONS

Date: 03.03.2023
 Revision:



Alan R. Poulson
 Bruce T. Fallon

WPA
 Architecture
 475 North Freedom Blvd.
 Provo, Utah 84601
 Tel: (801) 374-0800
 info@wpa-architecture.com

- Recirculating Hot Water Pump:

- A. A recirculating hot water pump of the size shown on the drawings shall be furnished and installed. The pumps shall be Bell & Gossett, Taco, Chicago, Pacific, Paces, Weimann, Amtrol, Grundfos, Weil, or Armstrong of all bronze construction with mechanical seal and 1850 RPM drip-proof motor with thermal overload protection. Circulators shall be substantially supported with a full size pipe leg to the floor or by a cradle hanger from the ceiling.

- Grease Interceptor:

- A. The grease interceptor shall be a type design and construction which is acceptable to the local Plumbing Code Official
- B. All interceptors shall be constructed of reinforced concrete compartments which are factory constructed and delivered to the site for final assembly and piping. Tanks shall be water proof with no leaks.
- C. Manholes shall be provided at each compartment and shall have a gasketed and sealed air tight lid to prevent odor leakage. Required venting shall be provided and where Local Code Officials. Provide and inspection manhole for their use.
- D. All interceptors shall be installed on a 6" thick compacted gravel base.

- Domestic Expansion Tank:

- A. ASME 150 PSI steel pressurized expansion tanks for portable use with ASME stamp of the size and capacity shown on the drawings shall be furnished and installed. Tank shall be complete with internal heavy duty Butyl Rubber Diaphragm, rigid Polypropylene liner on water side of tank, complying with FDA. Air charging fitting, tank drain, pressure gauge, air vent and connections as shown on the drawings. Supports for expansion tanks shall be furnished and installed by the plumber. Tanks shall be Watts, Amtrol, Taco, Armstrong or Zurn.

PART 3 - EXECUTION

- Surface Conditions:

- A. Inspection: All plumbing shall be installed in accordance with the requirements of all governing authorities, The original design, and referenced standards.
- B. Discrepancies:
 - 1. In the event of discrepancy, immediately notify the Architect.
 - 2. Do not proceed with installation in areas of discrepancy until all such discrepancies have been fully resolved. Interferences between installed work of various trades due to lack of coordination shall be resolved by the Architect whose decision is final. Relocate or offset any work as required to accommodate work of other trades at no extra cost to the Owner when so directed by the Architect.

- Verification of Dimensions:

- A. Scaled and figured dimensions are approximate only. Before proceeding with work, carefully check and verify dimensions at site, and be responsible for properly fitting equipment and materials together and to the structure in spaces provided.
- B. Drawings are essentially diagrammatic and many offsets, bends, special fittings and exact locations are not indicated. Carefully study drawings and premises in order to determine best methods, exact locations, routes, building obstructions, and install apparatus and equipment in available locations. Install apparatus and equipment in manner and in locations to avoid obstructions, preserve headroom, and keep openings and passageways clear.

- Locations and Space Requirements:

- A. Contractor shall fully inform himself regarding peculiarities and limitation of spaces available for installation of work under this division. Drawings indicate desired location and arrangement of piping, equipment and other items and are to be followed as closely as possible. Work specified and not clearly defined by drawings shall be installed and arranged in a satisfactory manner. In any case and at any time a change in location required by obstacles or the installation of other trades not shown on the plumbing plans shall be made by contractor without additional charge provided the change is ordered before work is installed and no extra materials are required.
- B. Verify all spaces, dimensions for all fixtures, equipment, or owner-furnished equipment and equipment furnished under other sections.
- C. Obtain all necessary rough in data and dimensions for all fixtures, equipment, or owner-furnished equipment and equipment furnished under other sections.
- D. Maintain ample headroom clearances and accessibility. Maintain ceiling heights.
- E. Constantly check work of other trades to prevent interference with this installation.

- **Cutting and Patching:** Cut work and patch per Division 1 as necessary to properly install the new work. As the work progresses, coordinate necessary openings, holes, chases, etc., in their correct location. If the required openings, holes and chases are not in their correct locations, make the necessary corrections at no cost to the Owner. Avoid excessive cutting and do not cut structural members without the consent of the Architect. Patching by General Contractor at Mechanical, Plumbing or Fire Protection Contractor's expense. Include as a part of the work under this contract all structural framing required by penetrations through the roof and necessary steel to support ducts and pipes between structural steel unless shown on the structural drawings.

- **Closing-in of Unfinished Work:** Cover no work until inspected, tested and approved. Where work is covered before inspection and test, uncover it, and when inspected, tested and approved, restore all work to original proper condition.

- Excavation and Backfill:

- A. Perform all necessary excavation, shoring and backfilling required for the proper laying of all pipes and conduits inside the building and premises, and outside as may be necessary. Conform to Division 2 requirements. Remove all excess excavated materials from the site or dispose of on site as directed by General Contractor.
- B. Excavate all trenches open cut, keep trench banks as nearly vertical as practicable, and sheet and brace trenches where required for stability and safety. Excavate trenches true to line and make bottoms not less than 18" wide but no wider than necessary to provide ample work room. Grade trench bottoms accurately to provide uniform bearing and support for each section of pipe on undisturbed soil along its entire length. Dig "bell" holes after the trench bottom has been graded. Machine grade only to the top line of the pipes, doing the balance by hand. Do not cut any trench near or under footings without first consulting the Architect. Comply with OSHA requirements.
- C. Provide backfilling and compaction in accordance with requirement of Division 2 and under the direction of the Architect and the Owner's testing firm to the required density. Make the first 2 feet of fill in 6" layers, each thoroughly compacted as directed, and free from rocks, large clods of earth, leaves, branches, and debris. Compact the rest of the backfill to prevent settlement as directed, using in the backfill no rocks larger than 4" in diameter, and using no rocks at all in the top 12".

- Accessibility:

- A. Install valves, dampers, thermometers, gauges, traps, cleanouts, control devices or other specialties requiring reading, adjustment, inspection, repairs, removal or replacement conveniently and accessibly throughout the finished building. Where any of these devices are shown on the contract drawings to be installed above any inaccessible ceiling, the Mechanical Contractor shall furnish access doors or panels as required.
- B. All access doors or panels in walls and ceilings required for access to control devices, traps, valves and similar devices are to be furnished and installed as part of the work under this section. Provide type as specified under Division 8.
- C. Provide ducts which pierce a fire separation with fire dampers of same fire rating as the separation.
- D. Refer to drawings and "Finish Schedule" for type of wall and ceiling in each area and for rated construction.
- E. Coordinate work of various sections to locate valves, traps, and dampers with others to avoid unnecessary duplication of access doors.

- **Roof Flashings:** Flash and counterflash all piping, conduits and ductwork penetrating roofing membrane with flashing per roofing manufacturer's recommendations. Refer to architectural drawings for detailing of duct and pipe penetrations through roof.

- Equipment Rough-in:

- A. Rough in all equipment and fixtures as designated on the drawings and in the specifications. The drawings indicate only the approximate location of rough-ins. The exact rough-in locations must be determined from large-scale certified drawings. The Contractor shall obtain all certified rough-in information before progressing with any work for rough-in final connections.
- B. Be responsible for providing all outlets and services of proper size at the required locations.
- C. Minor changes in the contract drawings shall be anticipated and provided for under this division of the specifications.
- D. Rough-in only (unless otherwise designated on the drawings) shall include the following:
 - 1. Plumbing: Provide all services designated and required, including waste and water. Valve and cap all stub-outs for water and gas. Cap all waste and vent outlets.
 - 2. Mechanical: Provide all services as indicated and required, including all ductwork, piping and valves. Valve and cap all piping stub-outs. Cap all ductwork stub-outs in a manner suitable for future extension.

- Owner-Furnished and Other Equipment:

- A. Rough-in only for all Owner-furnished equipment (see Division 1) and all equipment furnished under other sections of the specifications, except as otherwise specified and/or noted on the drawings.
- B. Provide all services designated, valve and cap all piping, cap all waste piping and ductwork and leave in a clean and orderly manner.
- C. Rough-in requirements shall be as outlined in the preceding paragraph titled "Equipment Rough-in."

- Equipment Final Connections:

- A. Provide all piping final connections for all equipment under Division 22 as required herein specified and indicated on the drawings.
- B. Plumbing: Provide final plumbing connections complete with shutoff valves, risers, traps, vacuum breakers and indirect wastes for all equipment furnished and installed under other sections of these specifications, except as otherwise designated. Included under the Plumbing section of the specifications are the final connections to the following:
 - 1. Miscellaneous equipment specified to be furnished and installed under other divisions of the specifications.
 - 2. Cold water make-up connections to air conditioning equipment.
 - 3. Kitchen equipment, furnished under other sections of the specifications.

- Sterilization:

- A. Sterilize each unit that will have water in it, the water supply piping and distribution system with liquid chloride or hydrochloride before acceptance of operation in accordance with AWWA C601, "Standard for Disinfection Water Mains" work shall be done by contractor and unless otherwise required by Public Authorities having Jurisdiction, shall conform to the following:
 - B. Materials
 - 1. Liquid Chlorine: U.S. Army Specification 4-1. 2. Hydrochloride: Liquid shall conform to FED. Spec. O-C-11RA (INT. 4).
 - C. Method: Amount of chlorine shall provide a dosage of 50 PPM minimum. Introduce chlorinating materials into lines and distribution system in approved manner after a contact period of 24 hours during which period chlorine residual shall be maintained at 5 PPM minimum, flush out systems with clean water until residual content is not greater than 0.2 PPM. Flush entire system open and close valves in lines being sterilized several times during contact period.
 - D. Sterilization report shall be turned into the Engineer for review prior to requesting a substantial completion inspection.

- Machinery Accessories:

- A. Application: Do not install any equipment in an application not recommended by the manufacturer.
- B. Installation: Align, level and adjust all equipment for proper operation. Install so connecting and disconnecting of piping and accessories can readily be done and so all parts are readily accessible for inspection, service and repair. Install equipment in accordance with manufacturer's recommendations.

- Pipe and Equipment Supports:

- A. Where supports, foundations, stands, suspended platforms for machinery, tanks, or other equipment are indicated or specified, perform the following:
 - 1. Locate support members to avoid equipment strains and interference with piping connections, tube pulling or other maintenance operations.
 - 2. Where saddles are required, use cast iron or welded steel saddles with curvature to fit the tank shell.
 - 3. Mount power-driven equipment on common base with driver.
 - B. Concrete Inserts: Furnish and install all concrete inserts required for all materials and equipment specified and/or shown on the drawings for Division 22.
 - C. Concrete Foundations: Work under this section includes coordination of construction of all concrete foundations indicated or required for equipment specified herein or in other sections under Division 22. Materials and workmanship shall be described under Division 3.
 - D. Grout under all equipment after leveling, filling completely the space between machinery bed plate and foundation surface as specified in Division 3. Finish exposed surface of grout for a neat appearance.
 - E. Floor Stands: Where equipment is mounted standard or on legs, construct of structural steel or steel pipe and fittings, cross-brace and fasten with flanges or plates bolted to floor.
 - F. Ceiling or Wall Supports: Use suspended platform, strap hangers, bracket or shelf, whichever is most suitable for equipment and location. Construct of structural steel members, steel plates, rods or pipe as required. Cross-brace and fasten to building structure or inserts in an approved manner.
 - G. Steel Work: Neatly fabricate and erect steel work with burrs and welding spatter ground off. Paint after fabrication with a rust-inhibitive primer.
- Hangers and Supports:**
- A. Hold horizontal pipe runs firmly in place using approved steel and iron hangers, supports, and/or pipe rest unless otherwise indicated. Suspend hanger rods from concrete inserts or from approved brackets, clamps or clips. Hang pipes individually or in groups if supporting structure is adequate to support weight of piping and fluid. Except for buried piping, hang or support pipe runs so that they may expand or contract freely without strain to pipe or equipment.
 - 1. Horizontal steel piping: Provide hangers or supports every 10 ft. except every 8 ft. for piping 1-1/4 inch and smaller.
 - 2. Horizontal copper tubing: For 2 inch diameter and over, provide hangers every 10 feet, for 1-1/2 inch diameter and smaller every 6 feet.
 - 3. Horizontal cast-iron no-hub piping: Provide hangers or supports at each side of no-hub fittings. Provide anti-separation bracing at each 90 degree change in direction.
 - 4. Horizontal cast-iron hub and spigot piping: Provide hangers or supports at each hub.
 - 5. Vertical piping: Support at floor with iron pipe clamps.

- Test:

- A. Perform test to Architect's satisfaction. Make test in presence of Owner's Rep and at the time suitable to him if requested. Furnish necessary labor and equipment and bear cost for testing. Cost of replacing and/or repairing damage resulting therefor shall be borne by this contractor, should the contractor refuse or neglect to make test necessary to satisfy the Architect that requirement of specifications and drawings are met, such tests may be made by an independent testing company and the contractor charged for all expenses.
- B. Hydrostatic test: Make by completely filling piping system with water and eliminating accumulations of air so that leakage, no matter how small, will be apparent on testing gauge immediately. Maintain pressure until pipe under test has been examined, but in no case less than 24 hours. Test system at the following pressure:

SYSTEM	TEST PRESSURE
Domestic Cold Water	150 PSIG
Domestic Hot Water	150 PSIG
- C. Sanitary soil, waste, bent systems test: Before installation of fixtures, cap end of system and fill lines with water to 10 feet above the section being tested. (including bents) and allow to stand for at least fifteen (15) minutes before inspection starts. Make test in sections if necessary or convenient. However, include interconnections between new sections and previously tested section in the new test.
- D. Roof drainage system: Test as specified for sanitary system.
- E. Gas systems: Test with compressed air at 10 PSI for six hours or longer as directed to provide a tight seal without leaks. Use pressure recorder to record pressure of all lines for duration of test.
- F. Repair all leaks and retest as required.

- Cleanouts:

- A. Provide cleanouts where indicated and required. Unless otherwise indicated, cleanouts shall be accessible with extensions to grade to outside of buildings, or to floors above as indicated or required. Do not locate cleanouts in public lobbies and public corridors unless approved by Architect.
- B. Membranes: Where waterproofing membrane occurs under floor, bring membrane to cleanout without puncturing and permanently anchor to integral anchoring flange with heavy cast-iron clamping collar and rustproof bolts.
- C. Covers: Set cleanout covers with all finished wall, floor or grade. In all cases securely anchor by means of integral lugs and bolts. Where surfacing material such as resilient coverings is specified, ascertain thickness being used and set cleanout top so finished floor is smooth.
- D. Use Acorn 3500 thread compound.

- Pipe Installation:

- A. Make pipe runs straight and true. Springing or forcing piping into place is not permitted. Install in manner to prevent any undue strain on equipment. Make joints smooth and unobstructed inside and out, and ream pipe ends thoroughly to remove burrs. Conceal piping in finished portions of the building except as otherwise directed or indicated. Cap or plug ends and openings in pipe and fittings immediately to exclude dirt until equipment is installed or final connections are made.
- B. Install piping to clear beams unless sleeving is indicated. Constantly check work of other trades to prevent interference with this installation. Obtain approval from Architect if coring or cutting of concrete work is necessary due to failure to install required sleeves prior to the time of concrete pour. Cost of coring and cutting work shall be borne by the subcontractor.
- C. Exposed plated or enameled pipe: Make connections to equipment with special care. Show not tool marks or threads.
- D. Dielectric Unions: Make connections between two dissimilar metal pipes with dielectric unions.
- E. Unions: Provide a union on one side of each shutoff valve. At both sides of automatic valves. At equipment connections and elsewhere indicated or required, unless flanges are indicated.
- F. Floor, wall ceiling plates: Provide where pipes pierce finished surfaces.
- G. Noise: Install soil, waste, and water piping in a manner that prevents any unusual noise from flow of water under normal conditions.
- H. Shutoff Valves: Provide where indicated and required for adequate control of system and for isolation of fixture groups and equipment.
- I. Buried Pipe: Install with minimum 36 inches coverage unless otherwise indicated. Lay piping accurately to grade where invert elevations are indicated. When required provide thrust blocks per manufacturer's recommendations.
- J. Equipment and Materials: Install per manufacturer's recommendations.
- K. Accessibility: Install work readily accessible for normal operation, reading of instruments, adjustments, service, inspections and repair. Provide access panels where indicated and required.
- L. Pipe Joints: Make screwed joints with a minimum amount of compound applied to the male thread only. All joints shall be made per code requirements and manufacturer's recommendations.
- M. Provide pipe isolation at all hangers for non-insulated materials.
- N. Piping Rough-in for Fixtures: Support or secure to building construction of firmly anchored waste piping so that pipes cannot be displaced. Do not secure to walls. Use of makeshift devices, such as rope, wire, tape, etc. is prohibited.
- O. Horizontal drainage piping shall be installed in uniform alignment at uniform slopes. The minimum slope for horizontal pipe 4" or larger in diameter may have a slope of not less than 1% (1/8 inch per foot). The minimum slope of horizontal pipe less than 4"; may have a slope of not less than 2% (1/4 inch per foot).

- Cleanup:

- A. In addition to cleanup specified under Division 1, thoroughly clean all parts of the equipment. Where exposed parts are to be painted, thoroughly clean off any splattered construction materials and remove all oil and grease spots. Wipe the surface carefully and scrape out all cracks and corners.
- B. Thoroughly flush and clean out all water circulating systems. Remove, clean and replace all strainer elements.
- C. During the progress of the work, keep the premises clean and free of debris.

- Painting:

- A. Except as otherwise specified or indicated in the architectural drawings and/or specifications, paint all exposed unfinished metal with one coat of rust-inhibiting primer.
- B. Finished painting is specified under Division 9.

- **Connections to Services:** Provide all connections to sanitary sewer lines, storm sewer, gas lines, water lines, electrical services furnished under other contracts, except as otherwise specifically designated. Provide all necessary tees, taps and connections required to properly connect to all mains. Verify all required City requirements before making any piping connections to sanitary sewer, storm sewer, water or gas piping and conform to them during installation.

- Welding:

- A. Procedures:
 - 1. All procedures and welders must be qualified in accordance with the requirements of Section IX, ASME Boiler and Pressure Vessel Code and ANSI code for power piping B31.1. Procedure qualification test records and acceptance shall be submitted with the welding procedure prior to the start of fabrication.
 - 2. Architect's inspector or authorized representative will review performance qualification records of individual welders.
- B. Welding Processes: The following welding processes are permitted, provided that the procedure is qualified in accordance with Section IX, ASME Boiler and Pressure Vessel Code.
 - 1. Manual shielded metal-arc.
 - 2. Gas tungsten-arc.
 - 3. Other welding processes may be used providing they are qualified in accordance with Section IX, ASME Boiler and Pressure Vessel Code.
- C. Restrictions: Weld bevel preparations shall be provided on all welding fittings and shall be machined or ground to remove all discoloration if flame or arc cut.
- D. Welding Filler Material:
 - 1. A filler material control procedure shall be submitted to Owner for review and acceptance prior to performing any welding.
 - 2. All shielded metal-arc welding shall be performed using low-hydrogen type electrodes such as E 7018.
- E. Preheat and Interpass Temperature:
- F. Preheat for pressure components shall be as specified in Table 132 of ANSI B.1.

BID/PERMIT SET - 05.19.2023

FACILITIES SHOP

SPANISH FORK CITY

433 SOUTH MAIN STREET

SPANISH FORK, UTAH 84680



Tel: (801) 974-0800
info@wpa-architecture.com

Alan R. Poulson
Bruce T. Fallon



Date: 03.03.2023
Revision:

These plans, drawings, and designs are the exclusive property of WPA Architecture and shall be reproduced in any form without written consent. All rights reserved.


ROYAL ENGINEERING

ELECTRICAL MECHANICAL
1837 S. EAST BAY BLVD. PROVO, UTAH 84606
PHONE: 801.375.2228 FAX: 801.375.2676

COPYRIGHT © JOB# J22162.00 DATE PLOTTED: 03/29/2023

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INCOMPLETE UNLESS IN CONJUNCTION WITH OTHER INSTRUMENTS OF PROFESSIONAL SERVICE. REVISIONS, OBSERVATIONS AND ADMINISTRATIVE USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT THE WRITTEN CONSENT OF WPA ARCHITECTURE IS STRICTLY PROHIBITED. EXCEPT WHERE SHOWN OTHERWISE, ALL RIGHTS ARE RESERVED. UTAH PROFESSIONAL ENGINEER ACT 19-10-1, PAR. 11, 11981, WHICH PROVIDES STATE AND LOCAL PUBLIC RECORD ACTS, REFER TO AS 17 U.S.C. PAR. 201 (1991).

P7.2
PLUMBING SPECIFICATIONS

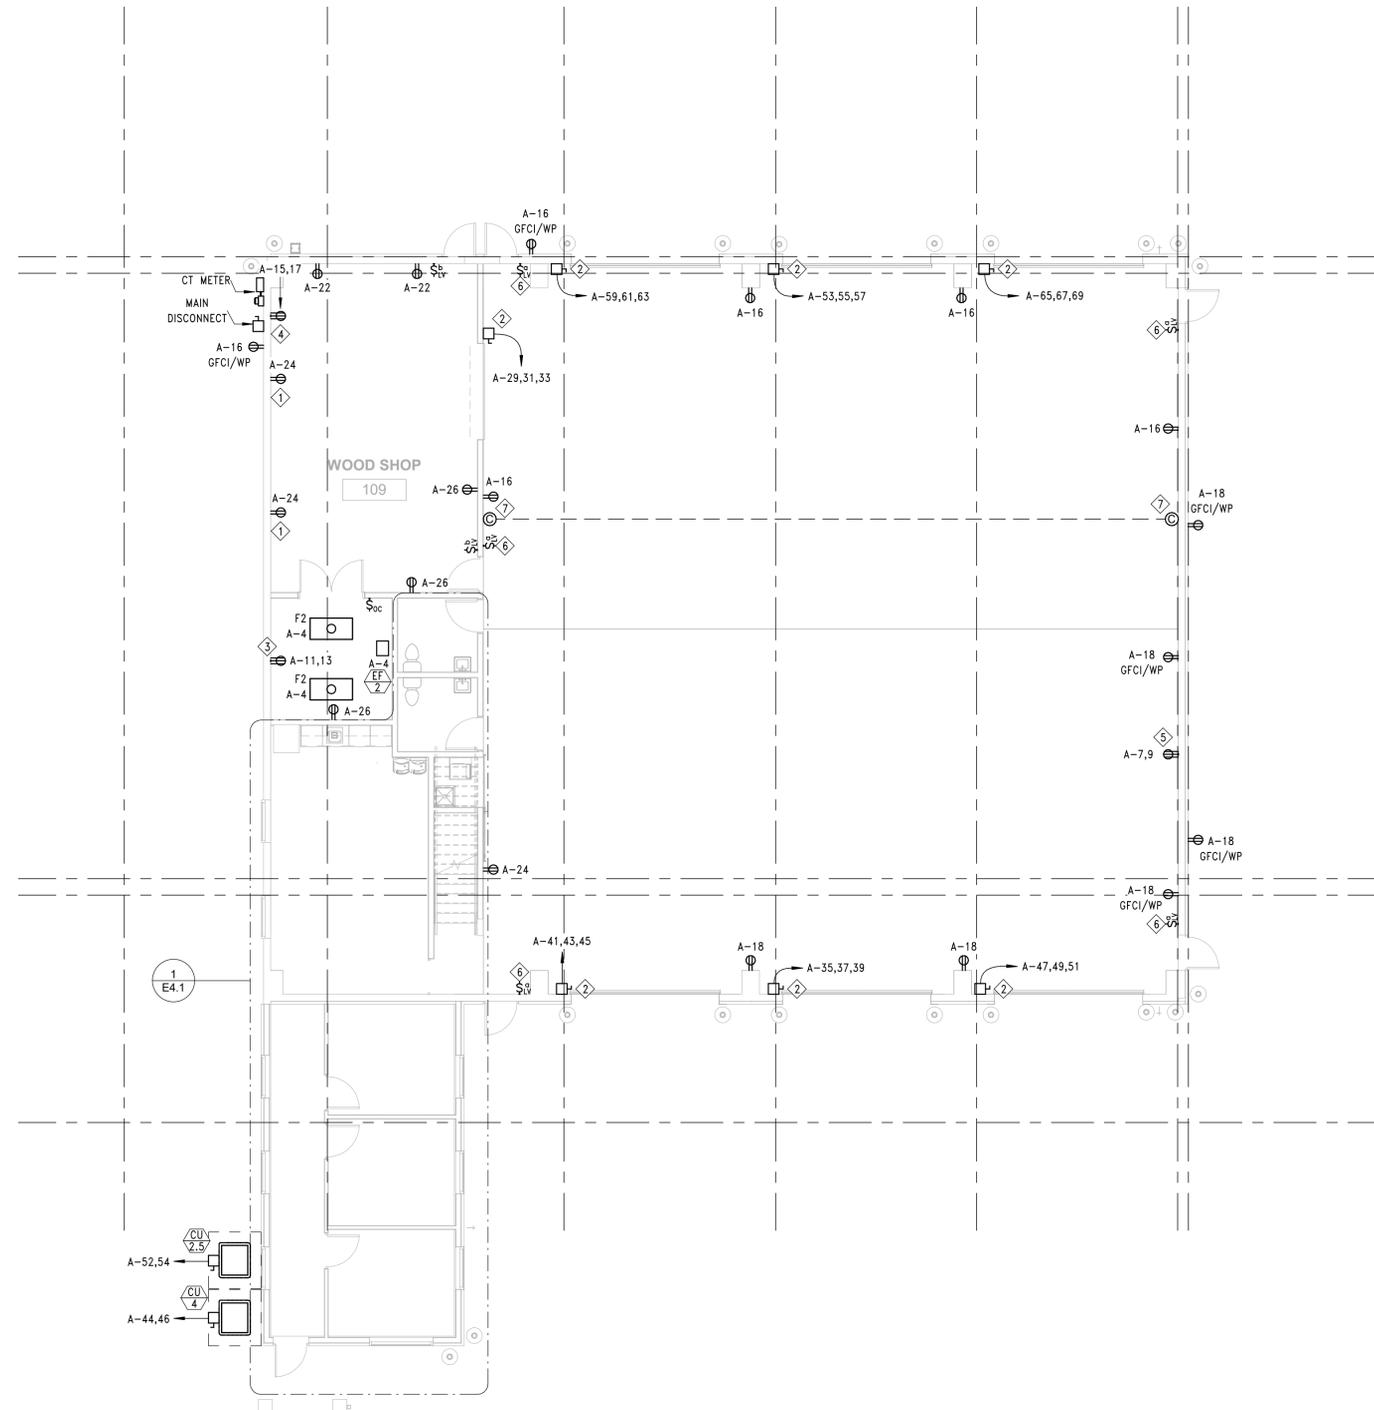

MAIN FLOOR ELECTRICAL PLAN - BUILDING #1
 1/8" = 1'-0"

ELECTRICAL KEYED NOTES:

- 1 WOODSHOP RECEPTACLES FOR BENCH. VERIFY EXACT LOCATION AND HEIGHT WITH CABINET INSTALLER PRIOR TO ROUGH-IN.
- 2 DISCONNECT FOR OVERHEAD DOOR. COORDINATE ELECTRICAL REQUIREMENTS WITH DOOR INSTALLER PRIOR TO ROUGH-IN.
- 3 RECEPTACLE FOR AIR COMPRESSOR. VERIFY EXACT LOCATION AND HEIGHT WITH OWNER REPRESENTATIVE PRIOR TO ROUGH-IN.
- 4 RECEPTACLE FOR WELDER. VERIFY EXACT LOCATION AND HEIGHT WITH CREPRESENTATIVE PRIOR TO ROUGH-IN.
- 5 RECEPTACLE FOR PRESSURE WASHER. VERIFY EXACT LOCATION AND HEIGHT WITH REPRESENTATIVE PRIOR TO ROUGH-IN.
- 6 REFER TO PAGE E1.2 FOR LIGHTING LAYOUT AND SWITCHING CONNECTION.
- 7 2" CONDUIT FROM THE PANEL ROOM TO THE SOUTH WALL AS SHOWN IN PLANS FOR FUTURE NEEDS.

These plans, drawings, and designs are the exclusive property of WPA-Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 03.30.2023
 Revision:

Alan R. Poulsen
 Bruce T. Fallon

WPA
 Architecture
 475 North Freedom Blvd.
 Provo, Utah 84601
 Tel: (801) 374-0800
 info@wpa-architecture.com

BID/PERMIT SET - 05.19.2023

SPANISH FORK CITY
 BUILDINGS & GROUNDS SHOP
 300 WEST 500 SOUTH

ROYAL ENGINEERING

ELECTRICAL 1837 S. EAST BAY BLVD. PHONE: 801.375.2228
 MECHANICAL 1837 S. EAST BAY BLVD. PROVO, UTAH 84606 FAX: 801.375.2676


COPYRIGHT © JOB# J22162.00 DATE PLOTTED: 03/30/2023

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INCOMPLETE UNLESS IN CONJUNCTION WITH ROYAL ENGINEERING'S INTERPRETATIONS, SPECIFICATIONS, OBSERVATIONS AND ADMINISTRATION. USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT WRITTEN PERMISSION IS STRICTLY PROHIBITED. ALL RIGHTS RESERVED. COPYRIGHT © 2011 BY ROYAL ENGINEERING COMPANY IS THE EXCLUSIVE PROPERTY OF ROYAL ENGINEERING COMPANY. ALL RIGHTS RESERVED. REFER TO U.T.A.C. PAR. 31-1-10(1), WHICH PREEMPTS STATE AND LOCAL PUBLIC RECORDS ACTS. REFER TO A.C.T. 17 U.S.C. PAR. 201 (1991).

E1.1
 BUILDING #1 FLOOR PLAN

ELECTRICAL KEYED NOTES:

1 RECEPTACLE FOR DROPCORD. ELECTRICAL CONTRACTOR TO PROVIDE DROPCORD FOR THE CEILING DUPLEX.

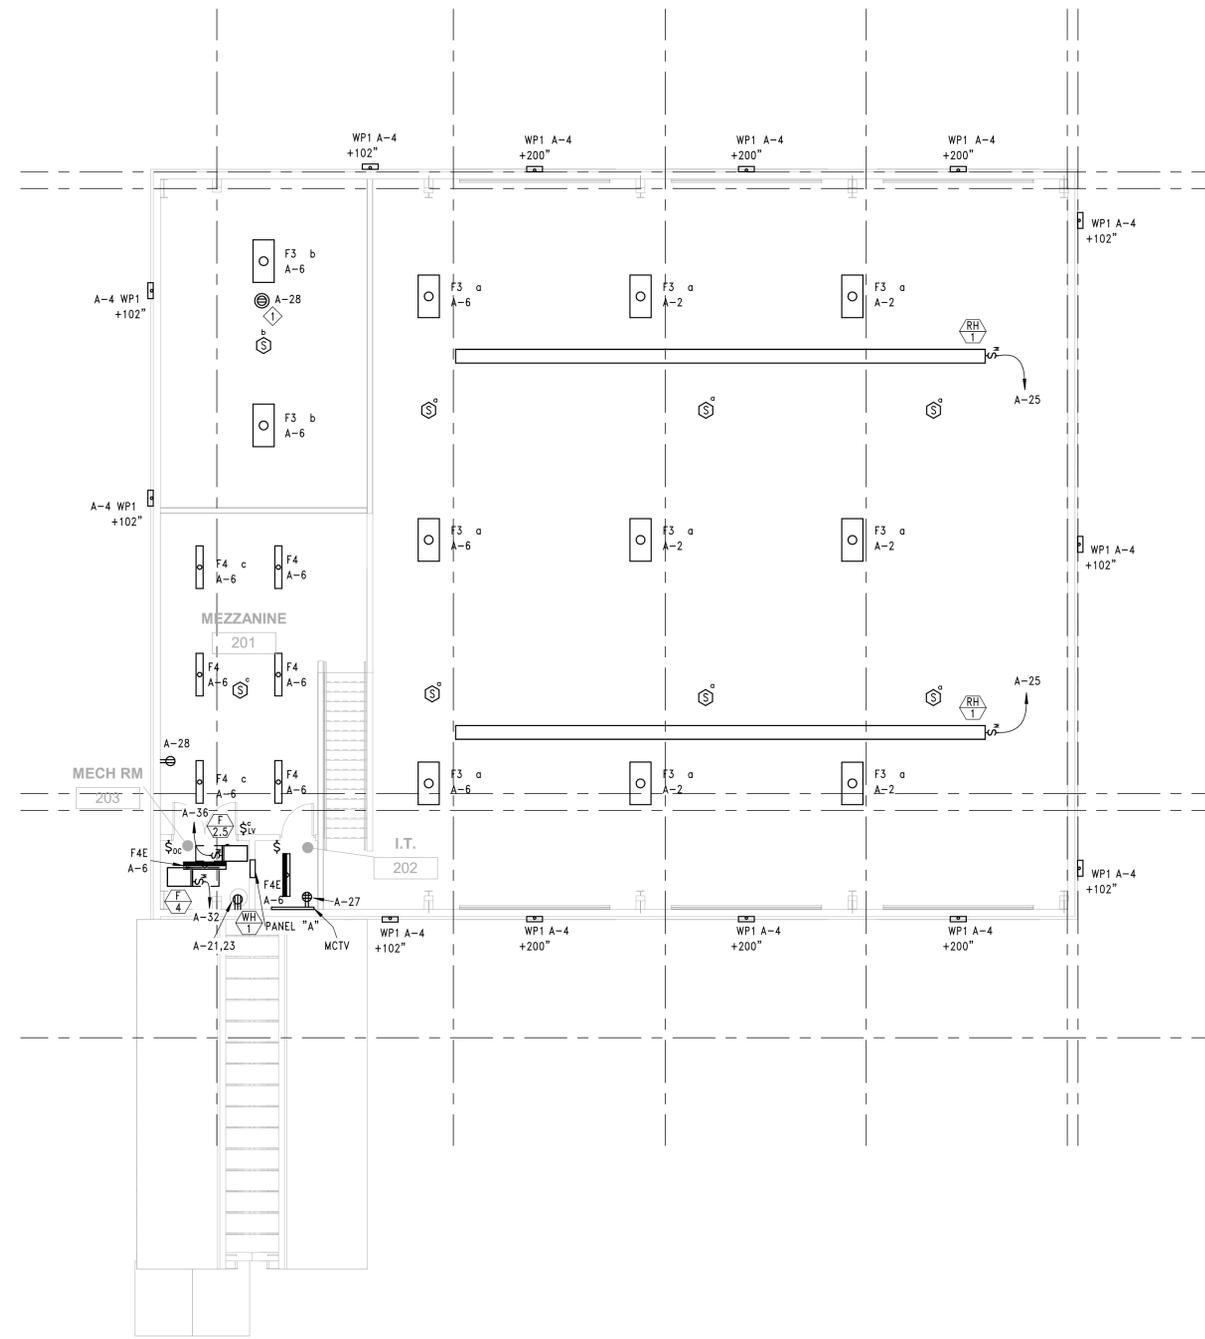


MEZZANINE ELECTRICAL PLAN - BUILDING #1

1/8" = 1'-0"

These plans, drawings, and designs are the exclusive property of WPA-Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 03.30.2023
Revision:



Alan R. Poulsen
Bruce T. Fallon

WPA
Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

SPANISH FORK CITY
BUILDINGS & GROUNDS SHOP
300 WEST 500 SOUTH

BID/PERMIT SET - 05.19.2023




ELECTRICAL: 1837 S. EAST BAY BLVD. PHONE: 801.375.2228
MECHANICAL: PROVO, UTAH 84606 FAX: 801.375.2676

COPYRIGHT © JOB# J2162.00 DATE PLOTTED: 03/30/2023

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INCOMPLETE UNLESS IN CONJUNCTION WITH ROYAL ENGINEERING'S INTERPRETATIONS, SPECIFICATIONS, OBSERVATIONS AND ADMINISTRATIONS. USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT ROYAL ENGINEERING'S CONSENT IS THE VIOLATION OF FEDERAL, STATE AND LOCAL STATUTES AND OTHER RESERVED RIGHTS. REFER TO 2017 U.L.E.P. PAR. 3.1 (1981), WHICH PREEMPTS STATE AND LOCAL PUBLIC RECORD ACTS. REFER TO ACT 17 U.S.G. PAR. 201 (1991).

E1.2

BUILDING #1 MEZZ. PLAN

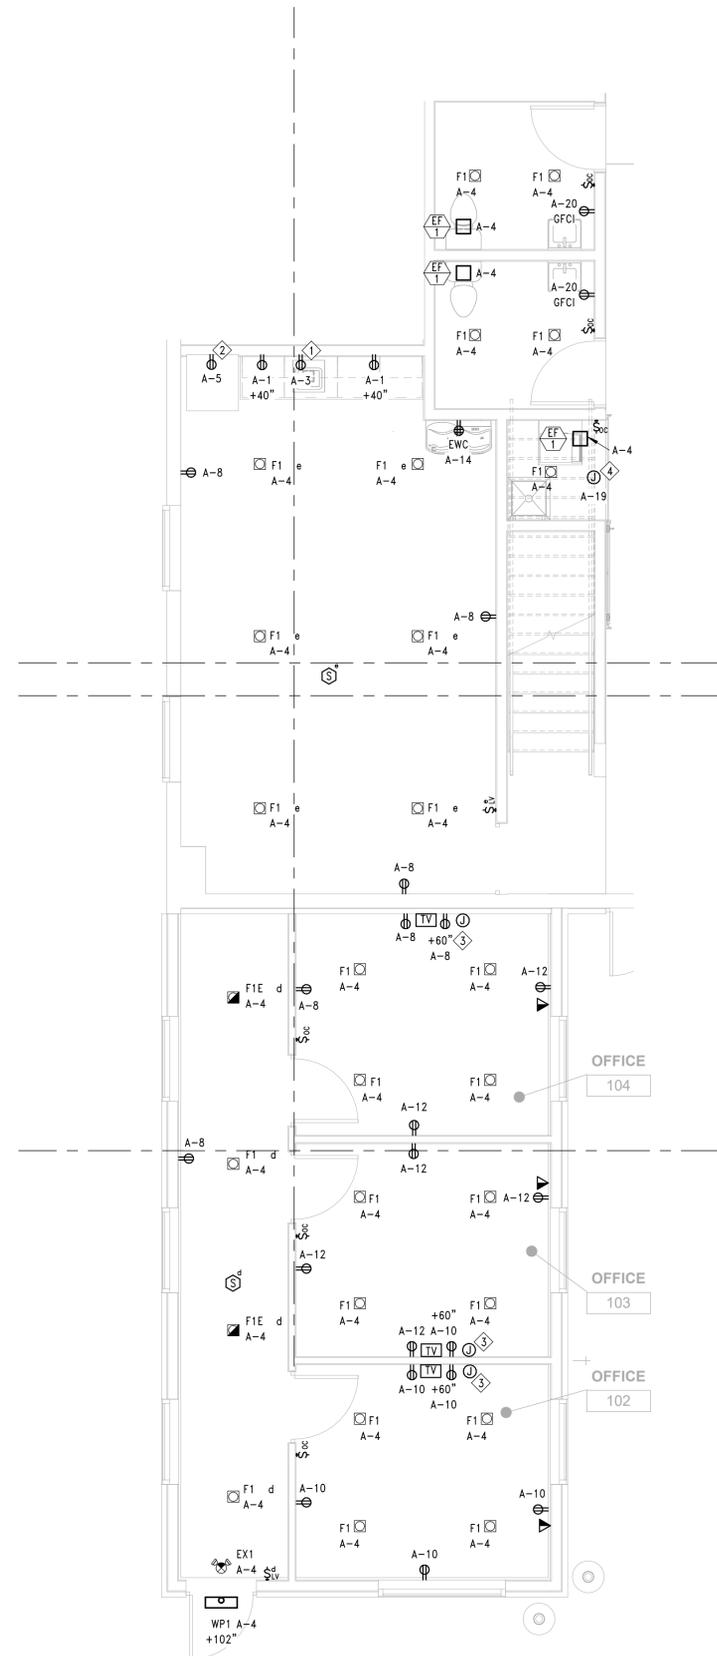

ENLARGED FRONT ENTRANCE
 1/4" = 1'-0"

- ELECTRICAL KEYED NOTES:**
- RECEPTACLE FOR DISHWASHER/DISPOSAL. VERIFY EXACT LOCATION WITH CABINET INSTALLER PRIOR TO ROUGH-IN. PROVIDE WITH AIR SWITCH FOR DISPOSAL LOCATED IN SINK.
 - RECEPTACLE FOR REFRIGERATOR. LOCATE SUCH THAT THE APPLIANCE WILL SIT TIGHT AGAINST THE WALL.
 - PROVIDE INTERFERENCE BOX FOR TV MONITOR. VERIFY EXACT LOCATION AND HEIGHT WITH OWNER'S REPRESENTATIVE PRIOR TO ROUGH-IN.
 - PROVIDE CONDUIT FOR FUTURE ICE MACHINE. VERIFY TYPE OF LOAD WITH ARCHITECT. VERIFY EXACT LOCATION AND HEIGHT WITH CABINET INSTALLER PRIOR TO ROUGH-IN.

These plans, drawings, and designs are the exclusive property of WPA-Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 03.30.2023
 Revision:



Alan R. Poulsen
 Bruce T. Fallon

WPA
 Architecture
 475 North Freedom Blvd.
 Provo, Utah 84601
 Tel: (801) 374-0800
 info@wpa-architecture.com

BID/PERMIT SET - 05.19.2023







SPANISH FORK CITY
 BUILDINGS & GROUNDS SHOP
 300 WEST 500 SOUTH

ROYAL ENGINEERING
 ELECTRICAL 1837 S. EAST BAY BLVD. PROVO, UTAH 84606
 MECHANICAL 1837 S. EAST BAY BLVD. PROVO, UTAH 84606
 PHONE: 801.375.2228 FAX: 801.375.2676

COPYRIGHT © JOB# J22162.00 DATE PLOTTED: 03/30/2023

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INCOMPLETE UNLESS IN CONNECTION WITH ROYAL ENGINEERING'S INTERPRETATIONS, SPECIFICATIONS, OBSERVATIONS AND ADMINISTRATIONS. USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT ROYAL ENGINEERING'S CONSENT IS A VIOLATION OF FEDERAL AND STATE COPYRIGHT STATUTES AND OTHER RESERVED RIGHTS. REFER TO 2017 U.L.E.P. PAR. 31.1 (2017), WHICH PREEMPTS STATE AND LOCAL PUBLIC RECORD ACTS. REFER TO ACT 17 U.S.C. PAR. 201 (1991).

E4.1
 ENLARGED FLOOR PLANS

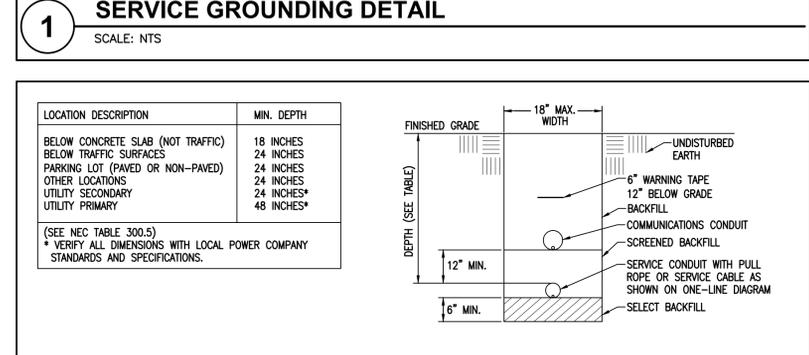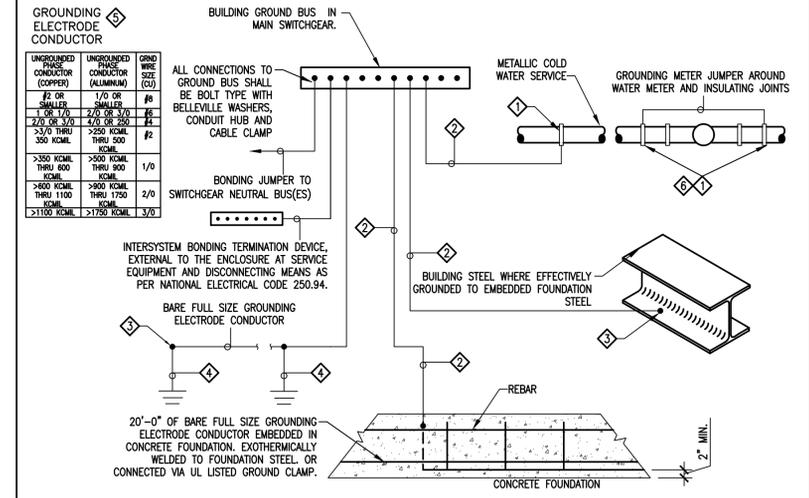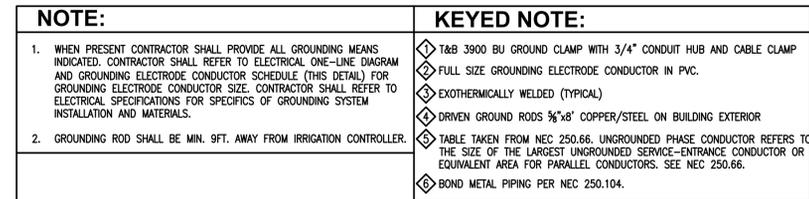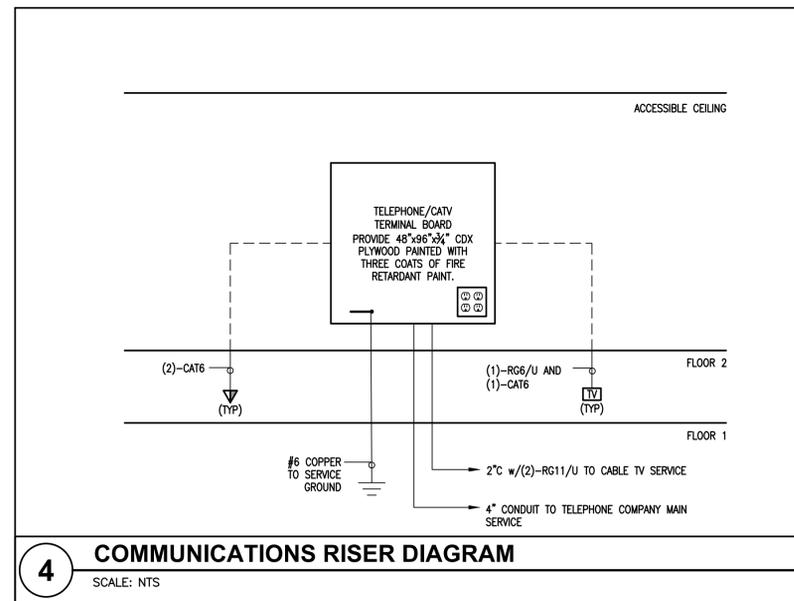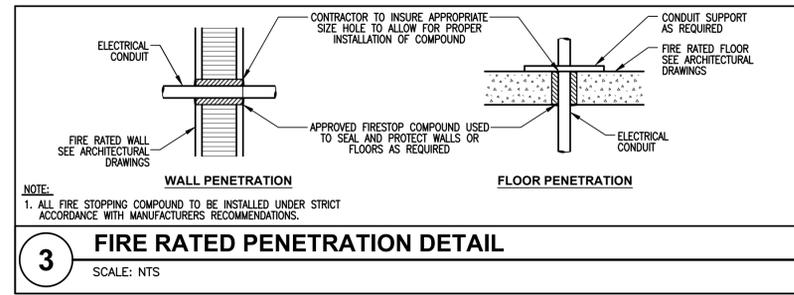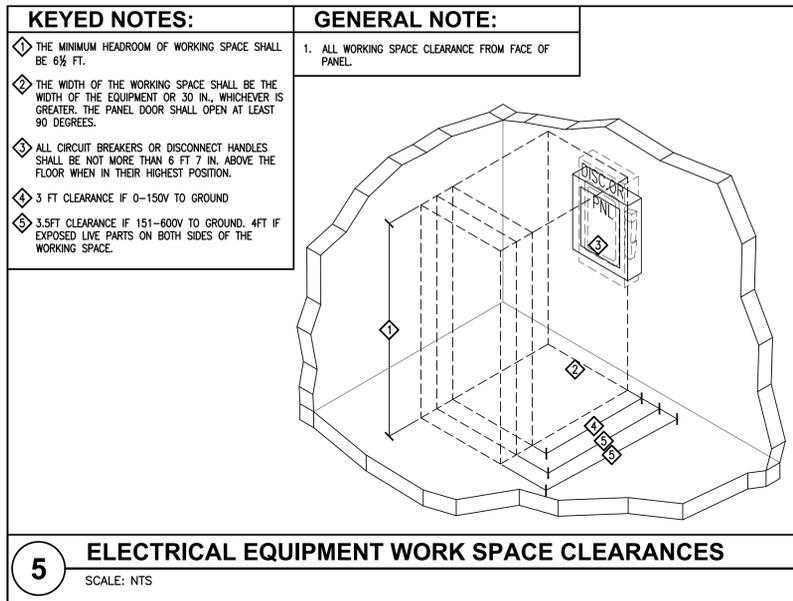

ROYAL ENGINEERING

ELECTRICAL MECHANICAL
1837 S. EAST BAY BLVD. PROVO, UTAH 84606
PHONE: 801.375.2228 FAX: 801.375.2676

COPYRIGHT JOB# J22162.00 DATE PLOTTED: 03/30/2023

THESE DOCUMENTS ARE INSTRUMENTS OF PROFESSIONAL SERVICE AND THE INFORMATION CONTAINED HEREIN IS INCOMPLETE UNLESS IN CONNECTION WITH AGENCY ENGINEERING PROFESSIONAL OBSERVATIONS, DESIGN, OBSERVATIONS AND ADMINISTRATION. USE OR REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART WITHOUT WRITTEN AGREEMENT CONSIDERED TO BE VIOLATION OF UTAH U.C.E. PAR. 31-119B(1), WHICH IS A PUBLIC STATE AND LOCAL PUBLIC RECORD ACT. REFER TO AS 31 U.S.C. PAR. 301 (1991).

These plans, drawings, and diagrams are the exclusive property of WPA Architecture and shall not be reproduced in any form without written consent. All rights reserved.

Date: 03/30/2023
 Revision:

Alan R. Poulson
 Bruce T. Fallon

WPA Architecture
 475 North Freedom Blvd.
 Provo, Utah 84601
 Tel: (801) 974-0800
 info@wpa-architecture.com

SPANISH FORK, UTAH 84680


BID/PERMIT SET - 05.19.2023

FACILITIES SHOP


SPANISH FORK CITY

433 SOUTH MAIN STREET

E5.2
 ELECTRICAL DETAILS

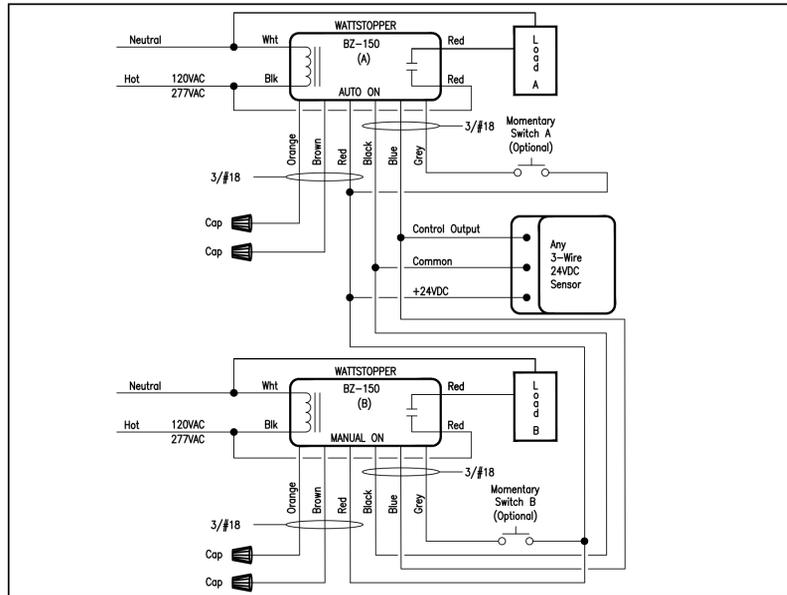

3 MOTION SENSOR WITH LV SWITCH
SCALE: NTS

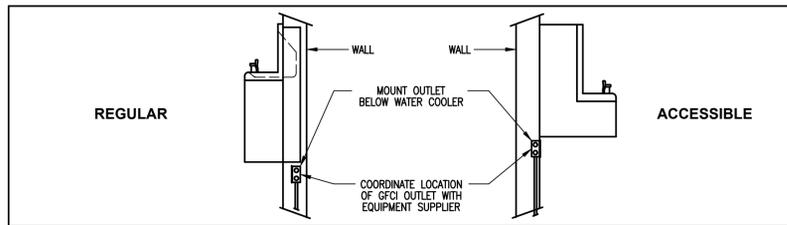

4 ELECTRIC WATER COOLER INSTALLATION DETAIL
SCALE: NTS


KEYED NOTES:

- ◇ 2-PORT SINGLE GANG FACEPLATE (HUBBELL #IFP12*)
- ◇ CAT 6 8-POSITION JACK (HUBBELL #HXJ6*)
- ◇ CAT 6 VOICE JACK (HUBBELL #HXJU*)
- ◇ COAXIAL F-TYPE JACK (HUBBELL #NSF70*)


GENERAL NOTES:

1. COORDINATE STATION AND PORT LABELING WITH OWNER.
2. ALL PATCH CABLES AND STATION CABLES SHALL BE PROVIDED AND INSTALLED BY EC.
3. ALL PATCHING AND/OR CROSS CONNECTION SHALL BE PERFORMED BY THE EC.

- MATCH FACEPLATE COLOR TO RECEPTACLES.

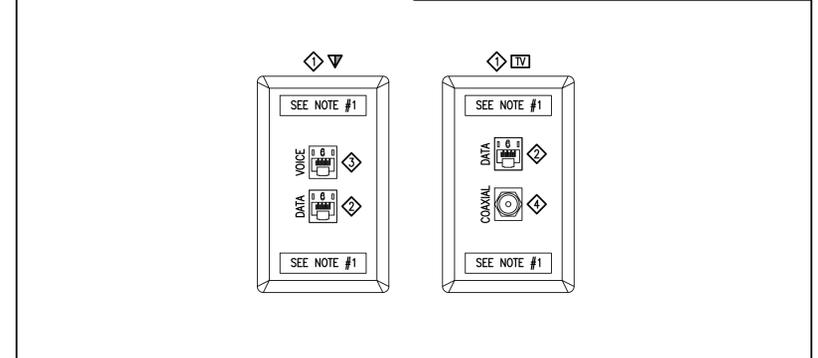

1 DATA/VOICE JACK INSTALLATION DETAIL
SCALE: NTS

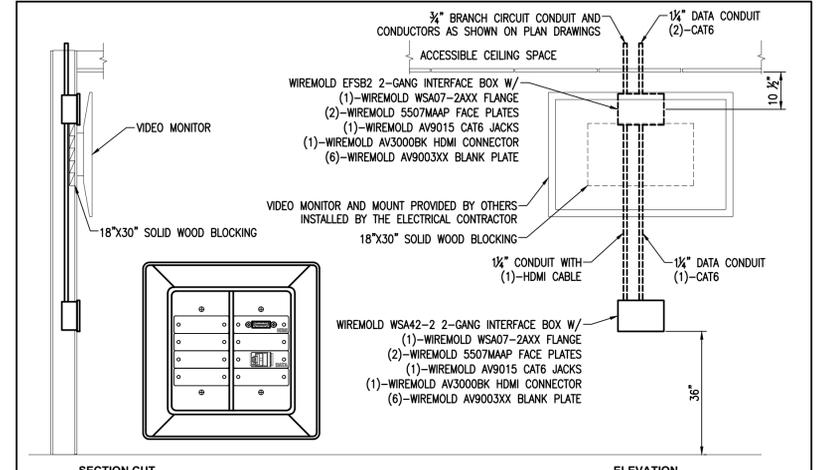


GENERAL NOTE:

1. X PORTION OF PART NUMBER IS FOR DEVICE COLOR. COORDINATE DEVICE COLORS WITH OWNER BEFORE ORDERING.

2 VIDEO MONITOR WIRING DETAIL
SCALE: NTS

Date: 03.30.2023
Revision:



Alan R. Poulson
Bruce T. Fallon

WPA Architecture
475 North Freedom Blvd.
Provo, Utah 84601
Tel: (801) 374-0800
info@wpa-architecture.com

SPANISH FORK, UTAH 84680

FACILITIES SHOP
SPANISH FORK CITY
433 SOUTH MAIN STREET

E5.3
ELECTRICAL
DETAILS

BID/PERMIT SET - 05.19.2023

ROYAL ENGINEERING
ELECTRICAL MECHANICAL
1837 S. EAST BAY BLVD. PROVO, UTAH 84606
PHONE: 801.375.2228 FAX: 801.375.2676
COPYRIGHT © JOB# J22162.00 DATE PLOTTED: 03/30/2023

LOAD CALCULATIONS		
GROSS BUILDING AREA:	7,567	SQ. FT
BUILDING VOLTAGE:	208	VOLTS
PHASE:	3	PHASE
OCCUPANCY TYPE:	BUSINESS	
GENERAL LOADS:		
LIGHTING W/ 125% DEMAND:	4,543	VA
RECEPTACLE LOAD:	14,076	VA
FIRST 10,000 VA @ 100%	10,000	VA
REMAINDER @50%	2,038	VA
ADJUSTED RECEPTACLE TOTAL LOAD:	12,038	VA
TOTAL:	16,581	VA
HVAC LOADS:		
COOLING/HEATING	8,923	VA
RESISTANCE HEATING W/ 125% DEMAND:	4,425	VA
WATER HEATING:	180	VA
TOTAL:	13,528	VA
EQUIPMENT LOADS:		
AIR COMPRESSORS:	4,800	VA
MOTORS:	25,200	VA
TOTAL:	35,760	VA
NET COMPUTED LOAD:	65,869	VA
NET COMPUTED AMPS:	183	AMPS

EQUIPMENT SCHEDULE												
SYMBOL	DESCRIPTION	SERVICE		DISCONNECT		STARTER	LOAD			MOC/ BRKR	REMARKS	
		VOLTS	PHASE	SIZE	FUSE		HP/TON	VA	AMPS			
F 2.5	FURNACE FAN	120 V	1Ø	MANUAL STARTER	-	INTEGRAL	-	1,176	9.8A	15A		
F 4	FURNACE FAN	120 V	1Ø	MANUAL STARTER	-	INTEGRAL	-	1,956	16.3A	20A		
CU 2.5	AIR COOLED CONDENSING UNIT	208 V	1Ø	30A NEMA 3R	-	INTEGRAL	2 1/2 TON	3,494	16.8A	30A		
CU 4	AIR COOLED CONDENSING UNIT	208 V	1Ø	60A NEMA 3R	-	INTEGRAL	4 TON	5,429	26.1A	40A		
EF 1	EXHAUST FAN	120 V	1Ø	INTEGRAL PLUG	-	-	-	15	0.1A	20A	EF CONTROLLED WITH LIGHTING	
EF 2	EXHAUST FAN	120 V	1Ø	INTEGRAL PLUG	-	-	-	32	0.3A	20A	EF CONTROLLED WITH LIGHTING	
EF 3	EXHAUST FAN	120 V	1Ø	MANUAL STARTER	-	-	FRAC	240	2.0A	20A	EF CONTINUOUS OPERATION TO BE WIRED TO SYSTEM CONTROL PANEL	
EF 4	EXHAUST FAN	120 V	1Ø	MANUAL STARTER	-	-	1/4 HP	696	5.8A	20A	3	
UH 1	UNIT HEATER	120 V	1Ø	MANUAL STARTER	-	-	-	228	1.9A	20A		
WH 1	WATER HEATER	208 V	1Ø	PLUG/ CORD	-	-	-	180	0.9A	30A		
CP 1	RECIRCULATION PUMP	120 V	1Ø	PLUG/ CORD	-	-	FRAC	240	2.0A	20A		
RH 1	RADIANT TUBE HEATER	120 V	1Ø	MANUAL STARTER	-	-	-	204	1.7A	20A		

NOTES:
1. VERIFY ALL EQUIPMENT LOCATIONS AND CONNECTION REQUIREMENTS (i.e. VOLTAGE, PHASE, FLA, ETC.) WITH MECHANICAL DRAWINGS/SUBMITTALS BEFORE FOR ACTUAL EQUIPMENT INSTALLED.
2. ALL FUSES SHALL BE DUAL ELEMENT TIME DELAY. FINAL BREAKER/FUSE & DISCONNECT SIZE SHALL BE DETERMINED BY MANUFACTURER'S RECOMMENDATION FOR ACTUAL EQUIPMENT INSTALLED.
3. MAXIMUM VALUES INDICATED.
4. DISCONNECTING MEANS NOT REQUIRED FOR EQUIPMENT WITHIN SIGHT (AS DEFINED IN NEC) OF BRANCH PANEL SERVING EQUIPMENT. SEE NEC 422.31 (B).
5. DISCONNECTING MEANS NOT REQUIRED FOR APPLIANCES NOT OVER 300 VA. SEE NEC 422.31 (A).

FAULT CURRENT CALCULATION TABLE														
MAIN UTILITY COMPANY TRANSFORMER		TRANSFORMER KVA	AFC AT UTILITY	%Z										
3Ø 120/208V -400A PAD MOUNTED		150	22,000 A	1.07%										
CONFIGURATION														
FROM				FEEDER			SYSTEM			FAULT CURRENT AT EQUIPMENT	FULL OR SERIES RATED	MINIMUM SYMMETRICAL EQUIPMENT AIC RATING		
TO	LENGTH	SOURCE FAULT CURRENT	FEEDER SIZE	FEEDERS PER PHASE	WIRE CONSTANT	LINE TO LINE VOLTS	XFMR SECONDARY VOLTS	PHASE	KVA				%Z	MOTOR LOAD
TRANSFORMER	UTILITY	SWITCHBOARD	METER	28'-0"	22,000 AIC	500 AL	1	21,390	208 V	3Ø	-	17,993 AIC	FULL	22,000 AIC
SWITCHBOARD	METER	PANELBOARD	A	80'-0"	17,993 AIC	3Ø CU	2	13,923	208 V	3Ø	-	12,579 AIC	FULL	22,000 AIC

NOTE: DISTANCES INDICATED ARE FOR FAULT-CURRENT ANALYSIS ONLY. CONTRACTOR SHALL USE FIELD MEASUREMENTS ESTABLISH CONDUCTOR LENGTHS FOR ORDERING PURPOSES.

LIGHT FIXTURE SCHEDULE									
FIXTURE NUMBER	FIXTURE MANUFACTURER	FIXTURE CATALOG #	LAMPS		FIXTURE			DESCRIPTION	REMARKS
			TYPE	QTY.	VOLTS	WATTS	MOUNTING		
F1	HALO COMMERCIAL LITHONIA LIGHTOLIER ATLANTIC PRESCOLITE MAXILUME	PD620ED010IPDM6A83561VC LDN6 35/20 L0BAR LSS MVOLT E21 P6RD20NZ10UVB W/P6RD835VB W/P6RDCC LED6-DLM20-35K-U-6LED10-SS LF6SL-6LFSL20L35K HH6-LED-2000L-DIM10-MVOLT-MD-35K-90HH6-6501-CL-WH	LED	-	120	24.8	RECESSED	LED DOWNLIGHT WITH ALZAK TRIM	
F1E	HALO COMMERCIAL LITHONIA LIGHTOLIER ATLANTIC PRESCOLITE MAXILUME	PD620ED010IPDM6A83561VCEM LDN6 35/20 L0BAR LSS MVOLT E21 EL P6RD20NZ10UVBEM W/P6RD835VB W/P6RDCC LED6-DLM20-35K-U-4LEM-6LED10-SS LF6SLEM-6LFSL20L35KEM HH6-LED-2000L-DIM10-MVOLT-MD-35K-90-EMG-LEDHH6-6501-CL-WH	LED	-	120	24.8	RECESSED	LED DOWNLIGHT WITH ALZAK TRIM AND EMERGENCY BATTERY PACK	
F2	METALUX LITHONIA DAY-BRITE LSI COLUMBIA ORACLE	24FR-LD4-40-JUNV-L835-CD1-U 2BLT4-40L-ADP-E21-LP835 2FGG4L835-2-D-JUNV-DIM-EMLED PEC24-LED-SS-RAD-WW-UE LTRE24-35LW-RFA-EDU 24-ODVH-LED-3000L-DIM10-MVOLT-35K-80	LED	-	120	45	LAY-IN GRID	2X4 LED LAY-IN VOLUMETRIC	
F3	NUVO METALUX	65-785R1 LED UFO HIGHBAY 200W/4000K UHB-24-UNV-L840-CD-U	LED	-	120	200	PENDANT OR SURFACE	LED HIGH BAY	
F4	METALUX LITHONIA DAY-BRITE LSI COLUMBIA ORACLE	4SNLED-LD4-30SL-LW-UNV-L835-CD1-U ZL1N-L48-3000LM-FST-MVOLT-35K-80CR-RWH FSS440L835-UNV-DIM SDL-4-LED-SS-WW-UE LCL4-35LW-EDU 4-OC1-LED-3000L-DIM10-MVOLT-35K-80	LED	-	120	29	SURFACE/CHAIN	48" LED STRIP	
F4E	METALUX LITHONIA DAY-BRITE LSI COLUMBIA ORACLE	4SNLED-LD4-30SL-LW-UNV-EL14W-L835-CD1-U ZL1N-L48-3000LM-FST-MVOLT-35K-80CR-E7W-WH FSS440L835-UNV-DIM-EMLED SDL-4-LED-SS-WW-UE-EM LCL4-35LW-EDU-ELL14 4-OC1-LED-3000L-DIM10-MVOLT-35K-80-O-EMG-LED	LED	-	120	29	SURFACE/CHAIN	48" LED STRIP WITH EMERGENCY BATTERY PACK	
WP1	LUMARK	AXCS3A-PC1-CBP	LED	-	120	27	SURFACE WALL	LED SCONCE WITH INTEGRAL PHOTOCELL FOR NORMAL AND EMERGENCY OPERATION	AS SPECIFIED OR APPROVED EQUAL
EX1	SURELITES LITHONIA LIGHTOLIER LSI MAXILUME	LPX-70-DGWHDH LHQM-S-1-G-EL-N LC18NH71GW LPRX-G-U-WH-LD11 ELX-703-G-W	INCLUDED	2	120	5.4	SURFACE WALL	2-HEAD EM WALL PACK (SURFACE) WITH EXIT LIGHT	

PANEL SCHEDULE "A"																							
VOLTAGE:		208 Y/120 VOLTS		BUS RATING (AMPS):		400		REMARKS:															
MOUNTING:		FLUSH		PHASE:		3		MAIN LUGS ONLY															
ENCLOSURE:		NEMA 1		WIRE:		4		MINIMUM EQUIPMENT RATING:		SEE FAULT CURRENT TABLE													
CIRCUIT BREAKER	No.	AMPS	POLE	MOD.	CIRCUIT NAME	FEEDER			LOAD/PHASE (VA)			FEEDER			CIRCUIT BREAKER								
						C	WIRE	GRD	ØA	ØB	ØC	WATTS	ØA	ØB	ØC	MOD.	POLE	AMPS	No.				
	1	20	1		CO-KITCHEN	3/4"	#12	#12	1.00	1,500	2,700		1,200	1.25	#12	#12	3/4"	MEZZ LIGHTING	-	1	20	2	
	3	20	1	GFCI	DISHWASHER / DISPOSAL	3/4"	#12	#12	1.00	1,200		2,402		1,202	1.25	#12	#12	3/4"	FLOOR LIGHTING	-	1	20	4
	5	20	1	GFCI	REFRIGERATOR	3/4"	#12	#12	1.00	1,200				2,432	1.25	#12	#12	3/4"	MEZZ LIGHTING	-	1	20	6
	7	30	2	GFCI	PRESSURE WASHER	3/4"	#10	#10	1.00	120	1,380		1,260	1.00	#12	#12	3/4"	OFFICE 104 BREAKROOM REC	-	1	20	8	
	9	30	-			-	#10	-	1.00	1,200		1,200	1.00	#12	#12	3/4"	OFFICE REC	-	1	20	10		
	11	30	2		AIR COMPRESSOR	3/4"	#10	#10	1.00	2,400			3,480	1.00	#12	#12	3/4"	OFFICE REC	GFCI	1	20	12	
	13	30	-			-	#10	-	1.00	2,400	3,150		1,080	1.00	#12	#12	3/4"	WATER FOUNTAIN	GFCI	1	20	14	
	15	50	2		WELDER	3/4"	#8	#10	1.00	2,880		3,960		1,080	1.00	#12	#12	3/4"	GARAGE REC	GFCI	1	20	16
	17	50	-			-	#8	-	1.00	2,880		3,960		1,080	1.00	#12	#12	3/4"	GARAGE REC	GFCI	1	20	18
	19	20	1	GFCI	ICE MACHINE	3/4"	#12	#12	1.00	1,086	1,446		360	1.00	#12	#12	3/4"	BATHROOM	-	1	20	20	
	21	30	2	GFCI	WH-1	3/4"	#10	#10	1.00	90		450		360	1.00	#12	#12	3/4"	BATHROOM	-	1	20	22
	23	-	-			-	#10	-	1.00	90			630	1.00	#12	#12	3/4"	WOOD SHOP REC	-	1	20	24	
	25	20	1		RH-1-2	3/4"	#12	#12	1.25	408	948		540	1.00	#12	#12	3/4"	WOOD SHOP BENCH REC	-	1	20	24	
	27	20	1		TERMINAL BOARD REC	3/4"	#12	#12	1.00	360		720		360	1.00	#12	#12	3/4"	WOOD SHOP REC	-	1	20	26
	29	30	3		OVERHEAD DOOR	3/4"	#10	#10	1.00	1,200			1,200	1.00	#12	#12	3/4"	CEILING REC	-	1	20	28	
	31	-	-			-	#10	-	1.00	1,200	3,156		1,956	1.25	#12	#12	3/4"	SPACE	-	1	20	32	
	33	-	-			-	#10	-	1.00	1,200		1,200	1.00	#12	#12	3/4"	SPACE	-	1	20	34		
	35	30	3		OVERHEAD DOOR	3/4"	#10	#10	1.00	1,200			2,376	1.178	1.25	#12	#12	3/4"	SPACE	-	1	20	36
	37	-	-			-	#10	-	1.00	1,200	1,200			1.00	#12	#12	3/4"	SPACE	-	1	20	38	
	39	-	-			-	#10	-	1.00	1,200		1,200		1.00	#12	#12	3/4"	SPACE	-	1	20	40	
	41	30	3		OVERHEAD DOOR	3/4"	#10	#10	1.00	1,200			1,200	1.00	#10	#8	3/4"	CU-4	-	2	40	42	
	43	-	-			-	#10	-	1.00	1,200	3,914		2,714	1.00	#10	#8	3/4"	CU-4	-	2	40	44	
	45	-	-			-	#10	-	1.00	1,200		3,914		2,714	1.00	#8	-		-	-	-	46	
	47	30	3		OVERHEAD DOOR	3/4"	#10	#10	1.00	1,200			1,200	1.00	#10	-	-		-	-	-	48	
	49	-	-			-	#10	-	1.00	1,200	1,200			1.00	#10	-	-		-	-	-	50	
	51	-	-			-	#10	-	1.00	1,200		2,947		1,747	1.00	#10	#10	3/4"	CU-2.5	-	2	30	52
	53	30	3		OVERHEAD DOOR	3/4"	#10	#10	1.00	1,200			2,947	1,747	1.00	#10	-	-		-	-	-	54
	55	-	-			-	#10	-	1.00	1,200	1,200			1.00	#10	-	-		-	-	-	56	
	57	-	-			-	#10	-	1.00	1,200		1,200		1.00	#10	-	-		-	-	-	58	
	59	30	3		OVERHEAD DOOR	3/4"	#10	#10	1.00	1,200			1,200	1.00	#10	-	-		-	-	-	60	
	61	-	-			-	#10	-	1.00	1,200	1,200			1.00	#10	-	-		-	-	-	62	
	63	-	-			-	#10	-	1.00	1,200		1,200		1.00	#10	-	-		-	-	-	64	
	65	30	3		OVERHEAD DOOR	3/4"	#10	#10	1.00	1,200	1,200		1,200	1.00	#10	-	-		-	-	-	66	
	67	-	-			-	#10	-	1.00	1,200	1,200			1.00	#10	-	-		-	-	-	68	
	69	-	-			-	#10	-	1.00	1,200		1,200		1.00	#10	-	-		-	-	-	70	
	71	-	-		SPACE	-	-	-	1.00				0	1.00	#10	-	-		-	-	-	72	
	73	-	-		SPACE	-	-	-	1.00				0	1.									

ELECTRICAL SPECIFICATIONS

GENERAL PROVISION

A. REFERENCE

- 1. THE GENERAL CONDITIONS AND OTHER CONTRACT DRAWINGS AS SET FORTH IN THE FOREGOING PAGES ARE HEREBY INCORPORATED INTO AND BECOME A PART OF THE SPECIFICATIONS FOR WORK UNDER THIS TITLE. INSOFAR AS THEY APPLY HERETO.
2. ALL SPECIFICATIONS UNDER THIS DIVISION TITLE ARE DIRECTED TO AND ARE THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR, UNLESS OTHER TRADES OR PERSONS ARE SPECIFICALLY MENTIONED. "ELECTRICAL CONTRACTOR" IS INFERRED AND INTENDED.

B. CONTRACT DRAWINGS

- 1. THE DRAWINGS ACCOMPANYING THESE SPECIFICATIONS ARE COMPLEMENTARY EACH TO THE OTHER AND WHAT IS CALLED FOR BY ONE SHALL BE AS IF CALLED FOR BY BOTH.
2. CONSULT ALL CONTRACT DRAWINGS WHICH MAY AFFECT THE LOCATION OF EQUIPMENT, CONDUIT AND WIRING AND MAKE MINOR ADJUSTMENTS IN LOCATION TO SECURE COORDINATION.
3. WIRING LAYOUT IS SCHEMATIC AND EXACT LOCATIONS SHALL BE DETERMINED BY FIELD CONDITIONS.
4. OTHER THAN MINOR ADJUSTMENTS SHALL BE SUBMITTED TO THE OWNER'S REPRESENTATIVE FOR APPROVAL BEFORE PROCEEDING WITH THE WORK.

C. JOB-SITE COPY OF DOCUMENTS

- 1. MAINTAIN AT THE SITE, ONE COPY OF ALL DRAWINGS, SPECIFICATIONS, ADDENDA APPROVED SHOP DRAWINGS, CHANGE ORDERS AND OTHER MODIFICATIONS, IN GOOD ORDER AND MARKED TO RECORD ALL CHANGES MADE DURING CONSTRUCTION. THESE SHALL BE AVAILABLE TO THE OWNER'S REPRESENTATIVE. THE DRAWINGS MARKED TO RECORD ALL CHANGES MADE DURING CONSTRUCTION SHALL BE DELIVERED TO THE OWNER'S REPRESENTATIVE FOR THE OWNER UPON COMPLETION OF THE WORK. AN ADDITIONAL SET OF DRAWINGS WILL BE FURNISHED BY THE OWNER'S REPRESENTATIVE FOR THIS PURPOSE UPON REQUEST.

D. MANUFACTURER'S DRAWINGS

- 1. THE CONTRACTOR SHALL SUBMIT TO THE ARCHITECT FOR REVIEW, (6) COPIES OF MANUFACTURER'S DRAWINGS AND WIRING DIAGRAMS. THE ENGINEER WILL REVIEW CONTRACTOR'S SHOP DRAWINGS AND RELATED SUBMITTALS (AS INDICATED BELOW) WITH RESPECT TO THE ABILITY OF THE DETAILED WORK, WHEN COMPLETE, TO BE A PROPERLY FUNCTIONING INTEGRAL ELEMENT OF THE OVERALL SYSTEM DESIGNED BY THE ENGINEER. BEFORE SUBMITTING A SHOP DRAWING OR ANY RELATED MATERIAL TO THE ENGINEER, CONTRACTOR SHALL: REVIEW EACH SUCH SUBMISSION FOR CONFORMANCE WITH THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND OPERATIONS OF CONSTRUCTION, AND SAFETY PRECAUTIONS AND PROGRAMS INCIDENTAL THERETO, ALL OF WHICH ARE THE SOLE RESPONSIBILITY OF CONTRACTOR; APPROVE EACH SUCH SUBMISSION BEFORE SUBMITTING IT; AND SO STAMP EACH SUCH SUBMISSION BEFORE SUBMITTING IT. THE ENGINEER SHALL ASSUME THAT NO SHOP DRAWING OR RELATED SUBMITTAL COMPRISES A VARIATION UNLESS CONTRACTOR ADVISES ENGINEER OTHERWISE VIA A WRITTEN INSTRUMENT WHICH IS ACKNOWLEDGED BY ENGINEER IN WRITING. THE ITEMS, TYPES OF SUBMITTALS AND RELATED MATERIAL (IF ANY) CALLED FOR ARE INDICATED BELOW:

Table with 2 columns: ITEMS, TYPE SUBMITTALS REQUESTED. Rows include LIGHTING AND POWER PANELS, LIGHTING FIXTURES, SHOP DRAWINGS, CATALOG CUTS.

E. GUARANTEES

- 1. THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR ALL DEFECTS, REPAIRS AND REPLACEMENTS IN MATERIALS AND WORKMANSHIP FOR A PERIOD OF ONE (1) YEAR AFTER DATE OF SUBSTANTIAL COMPLETION AS DETERMINED BY THE OWNER'S REPRESENTATIVE. PRODUCT GUARANTEES GREATER THAN ONE (1) YEAR SHALL BE PASSED ALONG TO THE OWNER FOR FULL BENEFIT OF THE MANUFACTURER'S WARRANTY.

WORK INCLUDED

A. INSTALLATION, MATERIALS, AND WORKMANSHIP

- 1. FURNISH AND INSTALL ALL NECESSARY ANCHORS, SUPPORTS, STRAPS, BOXES, FITTINGS AND OTHER SIMILAR APPURTENANCES NOT INDICATED ON THE DRAWINGS BUT WHICH ARE REQUIRED FOR A COMPLETE AND PROPERLY INSTALLED SYSTEM CONSISTENT WITH THE ARCHITECTURAL TREATMENT OF THE BUILDING.
2. THE ELECTRICAL CONTRACTOR, INSOFAR AS THE WORK IS CONCERNED, SHALL AT ALL TIMES KEEP THE PREMISES IN A NEAT AND ORDERLY CONDITION, AND AT THE COMPLETION OF THE WORK, SHALL PROPERLY CLEAN UP AND CART AWAY DEBRIS AND EXCESS MATERIALS. ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR THE COST OF DUMPSTER & REFUSED DISPOSAL AS REQUIRED FOR ELECTRICAL WORK. ALL MATERIALS SHALL BE NEW AND UNDETERIORATED AND OF A QUALITY NOT LESS THAN THE MINIMUM SPECIFIED.

B. COORDINATION OF PLANS AND SPECIFICATIONS

- 1. CONTACT THE OWNER'S REPRESENTATIVE IMMEDIATELY IF THERE IS ANY QUESTIONS REGARDING THE MEANING OR INTENT OF EITHER PLANS OR SPECIFICATIONS, OR UPON NOTICING ANY DISCREPANCIES OR OMISSIONS IN EITHER PLANS OR SPECIFICATIONS.

C. CUTTING AND PATCHING

- 1. ALL ELECTRICAL EQUIPMENT SHALL BE KEPT DRY AND CLEAN DURING THE CONSTRUCTION PERIOD. INTERIOR OF ALL ENCLOSURES SHALL BE CLEANED OF DIRT AND DEBRIS BEFORE INSTALLING TRIM OR COVERS.
2. ALL FINISHED SURFACES OF EQUIPMENT FURNISHED UNDER THIS CONTRACT SHALL BE THOROUGHLY CLEANED OF DIRT AND ALL SCRATCHED OR DAMAGED SURFACES SHALL BE TOUCHED UP WITH MATCHING MATERIALS BEFORE FINAL ACCEPTANCE OF THE WORK.
3. WHEN ALL WORK IS COMPLETED AND ALL WORK HAS BEEN SATISFACTORILY TESTED AND ACCEPTED BY THE OWNER'S REPRESENTATIVE, ALL CONDUIT AND OTHER EXPOSED SURFACES SHALL BE THOROUGHLY CLEANED.

CODES AND FEES

A. CODES:

- 1. ALL WORK PERFORMED UNDER THIS SPECIFICATION SHALL BE DONE IN ACCORDANCE WITH THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE AS PREPARED AND PUBLISHED BY THE NATIONAL FIRE PROTECTION ASSOCIATION AND ANY APPLICABLE STATE OR LOCAL CODES.

B. FEES:

- 1. OBTAIN AND PAY FOR ANY AND ALL PERMITS REQUIRED BY ALL LAWS AND REGULATIONS AND PUBLIC AUTHORITY HAVING SUCH JURISDICTION.

TESTS AND INSPECTIONS

- A. OBTAIN ALL INSPECTIONS REQUIRED BY ALL LAWS, ORDINANCES, RULES, REGULATIONS OR PUBLIC AUTHORITY HAVING JURISDICTION AND OBTAIN CERTIFICATES OF SUCH INSPECTIONS AND SUBMIT SAME TO THE OWNER'S REPRESENTATIVE. PAY ALL FEES, CHARGES AND OTHER EXPENSES IN CONNECTION THEREIN. OBTAIN OCCUPANCY PERMIT AS REQUIRED BY OWNER. FINAL PAYMENT SHALL NOT BE MADE UNTIL OCCUPANCY PERMIT IS OBTAINED.
B. WORK SHALL BE UNACCEPTABLE WHEN FOUND TO BE DEFECTIVE OR CONTRARY TO THE PLANS SPECIFICATIONS, CODES SPECIFIED OR ACCEPTED STANDARDS OF GOOD WORKMANSHIP.
C. THE CONTRACTOR SHALL PROMPTLY CORRECT ALL WORK FOUND UNACCEPTABLE BY THE OWNER'S REPRESENTATIVE WHETHER OBSERVED BEFORE OR AFTER SUBSTANTIAL COMPLETION AND WHETHER OR NOT FABRICATED, INSTALLED OR COMPLETED. THE CONTRACTOR SHALL BEAR ALL COSTS OF CORRECTING SUCH UNACCEPTABLE WORK, INCLUDING COMPENSATION FOR THE OWNERS REPRESENTATIVE ADDITIONAL SERVICES MADE NECESSARY THEREBY.

CONDUIT

- A. FURNISH AND INSTALL ALL CONDUITS, BOXES, FITTINGS, ETC., FOR A COMPLETE RACEWAY SYSTEM.
B. ALL WIRING SHALL BE RUN IN EMT CONDUIT OR MC CABLE WITH GROUND CONDUCTOR UNLESS OTHERWISE NOTED.
C. ALL CONDUIT SIZES STATED HEREIN OR MARKED ON THE DRAWINGS ARE MINIMUM SIZE AND SHALL BE NO LESS THAN 1/2" UNLESS OTHERWISE NOTED.
D. ALL CONDUIT SHALL BE SUBSTANTIALLY SUPPORTED BY PIPE STRAPS OR SUITABLE CLAMPS OR HANGERS ATTACHED TO THE ELEMENTS OF THE BUILDING STRUCTURE TO PROVIDE RIGID INSTALLATION; IN NO CASE SHALL CONDUIT BE ATTACHED OR SUPPORTED FROM ADJOINING PIPE OR INSTALLED IN SUCH A MANNER AS TO PREVENT THE READY REMOVAL OF OTHER PIPE FOR REPAIRS.

WIRE AND CABLE

- A. ALL CONDUCTORS SHALL BE COPPER AND OF THE AWG SIZE AND TYPE SHOWN ON THE DRAWINGS. WHERE NO SIZE OR TYPE IS SHOWN, CONDUCTORS SHALL NOT BE LESS THAN #12 TYPE XHHW, THHN, OR THWN. CONDUCTORS #8 AWG AND LARGER SHALL BE STRANDED COPPER AND HAVE 600 VOLT INSULATION, BE UL LABELED AND OF AMERICAN MANUFACTURER.
B. ALL BRANCH CIRCUITS SHALL BE MC CABLE.
C. ALL CONNECTIONS ARE TO BE MADE USING PRESSURE TYPE TERMINALS.
D. THE FOLLOWING COLOR CODE SHALL BE USED:
PHASE A: BLACK, BLACK, BROWN
PHASE B: RED, RED, ORANGE
PHASE C: BLUE, BLUE, YELLOW
NEUTRAL: WHITE, WHITE, WHITE
GROUND: GREEN, GREEN, GREEN
E. CONDUCTORS NO. 10 AWG OR SMALLER SHALL HAVE INSULATION COLORED AS NOTED ABOVE.
F. CONDUCTORS NO. 8 AWG OR LARGER SHALL HAVE INSULATION COLORED AS NOTED ABOVE OR COLORED TAPE, MINIMUM SIZE 1/2", WRAPPED TWICE AROUND AT THE FOLLOWING POINTS:
1. AT EACH TERMINAL.
2. AT EACH CONDUIT ENTRANCE.
3. AT INTERVALS NOT MORE THAN 12 INCHES APART IN ALL BOXES, PANEL TUBS, SWITCHBOARDS, ETC.

- G. ALL BRANCH CIRCUITS SHALL BE MARKED IN THE PANEL BOARD GUTTERS. MARKERS SHALL INDICATE CORRESPONDING BRANCH-CIRCUIT NUMBERS.
H. EACH BRANCH CIRCUIT REQUIRING A NEUTRAL SHALL BE FURNISHED WITH A SEPARATE INDIVIDUAL NEUTRAL CONDUCTOR.

BOXES AND PLATES

- A. FURNISH AND INSTALL, ALL OUTLET, JUNCTION, AND PULL BOXES AS INDICATED ON THE DRAWINGS AND AS NECESSARY TO INSTALL THE REQUIRED CONDUIT AND WIRING IN A NEAT AND WORKMANLIKE MANNER.
B. PULL BOXES AND JUNCTION BOXES SHALL BE GALVANIZED AND OF THE CORRECT SIZE AND GAUGE, SIZED IN ACCORDANCE WITH CODE REQUIREMENTS AND SHALL BE U.L. LABELED.
C. BOXES AT EXTERIOR AREAS TO BE WATERTIGHT AND DUST-TIGHT WITH CASKETED COVERS.
D. ALL BOXES FOR EXPOSED WORK IN FINISHED SPACES SHALL BE "FS" TYPE WITH THREADED HUBS WITH RIGID CONDUIT RISER (DEEP WIRE MOLD BOXES).
E. ALL BOXES SHALL BE RIGIDLY SUPPORTED INDEPENDENT OF THE CONDUIT SYSTEM. BOXES CAST INTO MASONRY OR CONCRETE ARE CONSIDERED TO BE RIGIDLY SUPPORTED.

WIRING DEVICES

- F. WIRING DEVICES SHALL BE SIMILAR TO THOSE LISTED BELOW AND OF SPECIFIED AMPERAGE. OTHER SPECIAL PURPOSE DEVICES SHALL BE AS SPECIFIED ON THE DRAWINGS.
G. DUPLEX GROUNDING TYPE RECEPTACLE - 20 AMP, 125 VOLT
1. HUBBELL 5352
2. ARROW HART 5352
J. SINGLE POLE SWITCHES - 20 AMP, 120 VOLT
K. WEATHERPROOF RECEPTACLES - 20 AMP, 125 VOLT - NEMA 5-20R
1. HUBBELL 5352 WITH 5205 COVER INTERMATIC GUARDIAN
2. I SERIES, NEMA 3R COVER
3. ARROW HART 5352 WITH 4500 COVER
E. G.F.C.I. RECEPTACLE - 20 AMP, 125 VOLT - NEMA 5-20 R
1. HUBBELL GF 5282 WITH MATCHING NYLON COVER PLATE OR WO-26 W.P. COVER
F. GROUND ALL RECEPTACLES IN ACCORDANCE WITH ARTICLE 250.146 OF NEC AND AS INDICATED IN THE GROUNDING SECTION OF THIS SPECIFICATION.

IDENTIFICATION

- A. EACH PIECE OF SERVICE EQUIPMENT AND INDIVIDUAL SWITCHES, ALL DISCONNECTS, STARTERS, ALL EXHAUST FAN MANUAL STARTING SWITCHES.
B. IDENTIFICATION SHALL BE IN THE FORM OF LAMINATED PLASTIC NAMEPLATES, BLACK RACE, WITH THE LETTERS ENGRAVED INTO THE WHITE BACKGROUND, MINIMUM 1/4" HIGH. PLATES SHALL BE DRILLED ON EACH END FOR SHEET METAL SCREW ATTACHMENT. NO "DYMO" OR SIMILAR TYPE LABELS WILL BE ALLOWED.
C. PANEL BOARD DIRECTORY: A TYPED CIRCUIT DIRECTORY SHALL BE PROVIDED INDICATING LOCAL AREA SERVED AND LOCATION FOR EACH BRANCH CIRCUIT.

GROUNDING

- A. ALL FEEDERS AND BRANCH CIRCUITS OVER 100 VOLTS SHALL INCLUDE A GROUNDING CONDUCTOR SIZED IN ACCORDANCE WITH NEC TABLE 250-122, EXCEPT NOT BE SMALLER THAN #12 FOR POWER AND LIGHTING CIRCUITS AND #14 FOR CONTROL CIRCUITS. ALL GROUND CONDUCTORS SHALL BE GREEN, OR AS SPECIFIED UNDER THE WIRE AND CABLE SECTION OF THIS SPECIFICATION.
B. ALL GROUND CLAMPS SHALL BE PENN-UNION "GPL" TYPE OR SIMILAR BY O.Z. OR BURNDY.
C. CONDUIT FOR SOLITARY GROUND CONDUCTORS SHALL BE RIGID SCHEDULE 40 PVC NON-METALLIC ELECTRICAL CONDUIT WITH U.L. LABEL. SOLITARY GROUND CONDUCTORS SHALL NOT BE PLACED THROUGH METALLIC SLEEVES OR CONDUITS AND SHALL NOT BE COMPLETELY ENCIRCLED BY METALLIC HANGERS OR SUPPORTS.
D. THE GROUND CONDUCTOR SHALL BE CONNECTED TO THE NEUTRAL IN ONLY TWO LOCATIONS - ON THE SUPPLY SIDE OF THE SERVICE DISCONNECT MEANS PER NEC-250-24 AND ON SEPARATELY DERIVED SYSTEMS PER NEC 250-30.
E. AT EACH RECEPTACLE BOX, THE GROUND CONDUCTOR SHALL ENTER AND CONNECT, WITH NORMAL WIRING CONNECTOR, TO: 1) THE GROUND PIGTAIL TO RECEPTACLE; 2) THE GROUND PIGTAIL TO THE BOX GROUND SCREW; AND 3) THE OUTGOING GROUND CONDUCTOR TO NEXT DEVICE, IF NOT AT END OF RUN. METAL TO METAL CONTACT BETWEEN THE DEVICE YOKE AND THE OUTLET BOX IS NOT ACCEPTABLE AS A BOND FOR EITHER SURFACE. MOUNTED BOXES OR FLUSH TYPE BOXES.
F. CONDUIT SYSTEM SHALL BE ELECTRICALLY CONTINUOUS. ALL LOCK NUTS SHALL CUT THROUGH ENAMELED OR PAINTED SURFACES ON ENCLOSURES, WHERE ENCLOSURES AND NON-CURRENT CARRYING METALS ARE ISOLATED FROM THE CONDUIT SYSTEM. USE BONDING JUMPERS WITH APPROVED CLAMPS. WHERE REDUCING WASHERS ARE USED AND WHERE CONCENTRIC OR ECCENTRIC KNOCKOUTS ARE NOT COMPLETELY REMOVED BONDING BUSHINGS SHALL BE REQUIRED.

POWER AND LIGHTING PANELS

- A. FURNISH AND INSTALL, AS SCHEDULED AND SHOWN ON THE DRAWINGS, POWER PANELS FOR OPERATION ON VOLTAGES INDICATED.
B. ALL TERMINATIONS SHALL BE MARKED "75°C ONLY", "60/75° C" OR LISTED FOR USE OF 75° C INSULATED CONDUCTORS AT FULL 75° C AMPACITY.
C. ALL BUS BARS SHALL BE SILVER OR TIN PLATED COPPER.
D. CABINETS SHALL BE OF COMMERCIAL GALVANIZED SHEET STEEL, CODE GAUGE AND SIZE, SURFACE OR RECESSED MOUNTED AS CALLED FOR IN THE DRAWINGS.
E. NEUTRAL ASSEMBLY SHALL HAVE INDIVIDUAL ANTI-TURN SOLDERLESS TERMINALS, SIMILAR TO SQUARE D TYPE PK, FOR CONNECTION OF ULTIMATE NUMBER OF NEUTRAL WIRES. SHEET METAL TERMINAL STRIPS AND CONNECTIONS WILL BE REJECTED.
F. PANEL SHALL HAVE A COPPER GROUND BAR SIMILAR TO NEUTRAL BAR IN NUMBER, SIZE, AND TYPE OF ANTI-TURN SOLDERLESS LUGS. THIS GROUND BAR SHALL BE FACTORY BONDED TO THE PANEL TUB IN THE GUTTER SPACE OPPOSITE THE MAINS AND THE NEUTRAL ASSEMBLY AND SHALL HAVE THE SCREWDRIVER SLOTS FACING THE FRONT OF THE PANEL.
G. QUALITY STANDARD: SQUARE D TYPE NQ.

LIGHTING FIXTURES

- A. CONTRACTOR SHALL FURNISH AND INSTALL LIGHTING FIXTURES AS INDICATED IN FIXTURE SCHEDULE SHOWN ON DRAWINGS, AND SPECIFIED HEREIN.
B. NEUTRAL ASSEMBLY SHALL HAVE INDIVIDUAL ANTI-TURN SOLDERLESS TERMINALS, SIMILAR TO SQUARE D TYPE PK, FOR CONNECTION OF ULTIMATE NUMBER OF NEUTRAL WIRES. SHEET METAL TERMINAL STRIPS AND CONNECTIONS WILL BE REJECTED.
C. ALL LIGHTING FIXTURES INSTALLED BY THE ELECTRICAL CONTRACTOR SHALL BE FURNISHED COMPLETE WITH AS INDICATED ON THE FIXTURE SCHEDULE.
D. ANY LIGHTING FIXTURES SCRATCHED, BENT, CRACKED OR IN ANY WAY DAMAGED BEFORE ACCEPTANCE BY OWNER SHALL BE REPLACED AT THIS CONTRACTOR'S EXPENSE.
E. ALL LIGHTING FIXTURES SHALL BE IN WORKING ORDER AT THE TIME OF FINAL ACCEPTANCE OF THE WORK BY THE OWNER.
F. ALL LIGHTING FIXTURES ARE TO BE GROUNDED ON THE INTERIOR OF THE FIXTURE HOUSING, ON CLEAN BARE METAL (FREE OF PAINT), BY USE OF PIGTAIL AND FASTENED BY A SCREW USED FOR NO OTHER PURPOSE.

TELEPHONE/DATA SYSTEMS

A. SUMMARY

- 1. INCLUDES BUT NOT LIMITED TO
a. FURNISH AND INSTALL BUILDING TELEPHONE AND COMPUTER NETWORK RACEWAY AND CABLE SYSTEM AS DESCRIBED IN CONTRACT DOCUMENTS INCLUDING, BUT NOT LIMITED TO, RACEWAY, OUTLETS, MODULAR JACKS, DEVICE PLATES, CABLES, PUNCH DOWN BLOCKS, BACKBOARDS, CABINETS, PATCH PANELS, GROUNDING AND OTHER MISCELLANEOUS ITEMS REQUIRED FOR A COMPLETE SYSTEM.
b. FURNISH AND INSTALL MAIN SERVICE RACEWAY AS DESCRIBED IN CONTRACT DOCUMENTS AND TO COMPLY WITH TELEPHONE COMPANY REQUIREMENTS.

B. COMPONENTS

- 1. TELEPHONE OUTLET BOX SHALL BE SINGLE DEVICE BOX.
2. BUILDING TELEPHONE AND COMPUTER NETWORK SYSTEM CABLE
a. 23 GAUGE, SOLID TINNED COPPER, FOUR TWISTED PAIRS, CATEGORY 6
b. USE PLENUM-RATED CABLE IN CEILINGS AND AREAS USED FOR PLENUM AIR RETURN
3. TELEPHONE TERMINATION BLOCKS
a. UL VERIFIED CATEGORY 6
b. 110 TERMINATION WITH TIN LEAD PLATED IDC
4. NETWORK PATCH PANELS
a. UL VERIFIED CATEGORY 6
b. 110 TERMINATION WITH TIN LEAD PLATED IDC
c. 19" RACK MOUNT WITH BACKBOARD MOUNTING FRAME.
d. 48 PORTS
5. TELEPHONE NETWORK JACKS
a. WALL JACKS
1) CAT6 - HUBBELL HXJ6 OR ALTERNATE MANUFACTURER WITH EQUIVALENT PERFORMANCE STANDARD.
b. PLATES
1) HUBBELL - JFP SERIES (PORT QUANTITY AS REQUIRED, COLOR BY ARCHITECT)
6. BACKBOARDS: INTERIOR GRADE PLYWOOD WITHOUT VOIDS, 1/4" INCH THICK, UL-LABELED FIRE RETARDANT.
a. SIZE: 48 INCHES WIDE 96 INCHES HIGH.
b. DO NOT PAINT OVER UL LABEL.

- c. PROVIDE ONE 48" MULTI-OUTLET POWER STRIP WITH INTEGRAL SURGE PROTECTION AND OUTLETS AT 6" O.C. (MINIMUM 7 OUTLETS) MOUNTED AT CENTER OF TERMINAL BOARD.

C. INSTALLATION

- 1. INSTALL CABLE FROM TERMINAL BOARD TO EACH TELEPHONE/NETWORK OUTLET.
2. TERMINATE CABLES AT EACH OUTLET WITH SPECIFIED MODULAR JACK ASSEMBLY.
3. TERMINATE CABLES ON PUNCH DOWN BLOCKS OR PATCH PANELS AT TERMINAL BOARD.
4. PROVIDE TYPED LABELS AT ALL JACKS CORRESPONDING TO TYPED NUMBERING SYSTEM AT PATCH PANEL OR TERMINAL STRIP.
D. QUALITY ASSURANCE
1. COMPLY WITH APPLICABLE PORTIONS OF NEC ANSI/EIA/TA 568 AS TO TYPE PRODUCTS USED AND INSTALLATION OF COMPONENTS. PROVIDE PRODUCTS AND MATERIALS WHICH HAVE BEEN UL-LISTED AND LABELED.

Professional Engineer seal for Alan R. Poulson, State of Utah, No. 13073, dated 3/30/23.

Alan R. Poulson
Bruce T. Fallon

WPA Architecture logo and contact information: 475 North Freedom Blvd., Provo, Utah 84601. Tel: (801) 374-0800, info@wpa-architecture.com

SPANISH FORK, UTAH 84680

FACILITIES SHOP
SPANISH FORK CITY

433 SOUTH MAIN STREET

E7.1
ELECTRICAL SPECIFICATIONS

BID/PERMIT SET - 05.19.2023

ROYAL ENGINEERING logo and contact information: 1837 S. EAST BAY BLVD., PROVO, UTAH 84606. PHONE: 801.375.2228, FAX: 801.375.2676. Includes copyright notice for 03/30/2023.